

SYSMAC
C200H-CT001-V1/CT002
High-speed Counter Units

OPERATION MANUAL


OMRON

C200H-CT001-V1/CT002

High-speed Counter Units

Operation Manual


Revised September 2000

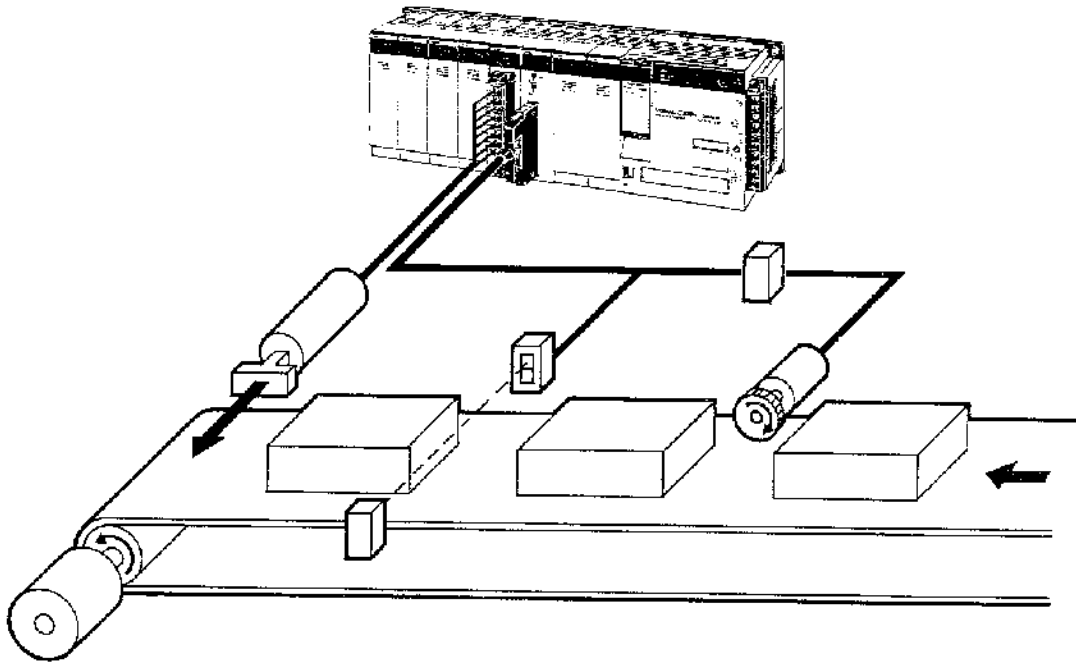



Notice:

OMRON products are manufactured for use according to proper procedures by a qualified operator and only for the purposes described in this manual.

The following conventions are used to indicate and classify precautions in this manual. Always heed the information provided with them. Failure to heed precautions can result in injury to people or damage to property.

 **DANGER** Indicates an imminently hazardous situation which, if not avoided, will result in death or serious injury.

 **WARNING** Indicates a potentially hazardous situation which, if not avoided, could result in death or serious injury.

 **Caution** Indicates a potentially hazardous situation which, if not avoided, may result in minor or moderate injury, or property damage.

OMRON Product References

All OMRON products are capitalized in this manual. The word “Unit” is also capitalized when it refers to an OMRON product, regardless of whether or not it appears in the proper name of the product.

The abbreviation “Ch,” which appears in some displays and on some OMRON products, often means “word” and is abbreviated “Wd” in documentation in this sense.

The abbreviation “PC” means Programmable Controller and is not used as an abbreviation for anything else.

Visual Aids

The following headings appear in the left column of the manual to help you locate different types of information.

Note Indicates information of particular interest for efficient and convenient operation of the product.

1, 2, 3... 1. Indicates lists of one sort or another, such as procedures, checklists, etc.

© OMRON, 1990

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted, in any form, or by any means, mechanical, electronic, photocopying, recording, or otherwise, without the prior written permission of OMRON.

No patent liability is assumed with respect to the use of the information contained herein. Moreover, because OMRON is constantly striving to improve its high-quality products, the information contained in this manual is subject to change without notice. Every precaution has been taken in the preparation of this manual. Nevertheless, OMRON assumes no responsibility for errors or omissions. Neither is any liability assumed for damages resulting from the use of the information contained in this publication.

About this Manual:

This manual covers specifications and procedures necessary for the installation and operation of the C200H-CT001-V1 and C200H-CT002 High-speed Counter Units. It includes example system configurations to ease the implementation cycle. The C200H-CT001-V1 and C200H-CT002 are Special I/O Units for C200H PCs. The C200H-CT001-V1 is a high-speed, reversible counter capable of counting at a maximum of 50 kcps. The C200H-CT002 is a high-speed, reversible counter capable of counting at a maximum of 75 kcps.

Please read this manual carefully and be sure you understand the information provided before attempting to install and operate the C200H-CT001-V1 and C200H-CT002 High-speed Counter Units.

Section 1 contains a brief description of the Units and how they can be used. The Units are displayed and their indicators are explained. An example system configuration is included to demonstrate Unit application. The operating modes and their associated ranges of operation are also described.

Section 2 shows the Unit settings and connector cable pin specifications. Instructions for the construction of input and output connectors are provided. Electrical schematics and examples are presented to further explain Unit operation.

Section 3 describes the operational flow of the counting system. The input types are identified along with instructions for their use. Data transfer timing is described in relation to the PC cycle time.

Section 4 describes the various operating modes in detail. Each mode is described by data allocation, timing charts, commands, flags, and examples. Data formats are explained.

Section 5 presents possible errors and solutions and describes how to handle errors from the PC. The AR area Error and Restart Flags are described.

The following **Appendices** are also provided: Error Codes, Specifications, IR Area Allocations, and DM Area Coding Sheets.

**WARNING**

Failure to read and understand the information provided in this manual may result in personal injury or death, damage to the product, or product failure. Please read each section in its entirety and be sure you understand the information provided in the section and related sections before attempting any of the procedures or operations given.

TABLE OF CONTENTS

PRECAUTIONS	vii
1 Intended Audience	viii
2 General Precautions	viii
3 Safety Precautions	viii
4 Operating Environment Precautions	ix
5 Application Precautions	ix
SECTION 1 – Introduction	1
1-1 Introduction	2
1-2 Nomenclature	2
1-3 System Configuration	3
1-4 Operating Modes	4
SECTION 2 – Switch Settings and Wiring	7
2-1 Switch Settings	8
2-2 Wiring	10
2-3 Input Circuit Wiring Examples	18
2-3-1 C200H-CT001-V1	18
2-3-2 C200H-CT002	21
2-4 Dimensions	24
SECTION 3 – Operation	25
3-1 Operational Flow	26
3-2 Input Selection	26
3-2-1 Offset Phases	26
3-2-2 Up and Down Pulses	28
3-2-3 Pulse and Direction	28
3-3 Counter Reset Conditions	29
3-4 Data Transfer Timing	30
SECTION 4 – Data Allocation and Operating Modes	33
4-1 Data Configuration and Allocation	34
4-2 Linear and Circular Modes	36
4-2-1 Data Allocation	36
4-2-2 DM Area Settings	39
4-2-3 IR Area Settings	40
4-2-4 Timing Chart	46
4-2-5 Application Examples	47
4-3 Preset Mode	52
4-3-1 Data Allocation	52
4-3-2 DM Area Settings	55
4-3-3 IR Area Settings	56
4-3-4 Timing Chart	60
4-3-5 Application Example	61
4-4 Gate, Latch, and Sampling Modes	63
4-4-1 Data Allocation	64
4-4-2 DM Area Settings	65
4-4-3 IR Area Settings	65
4-4-4 Timing Charts	66
4-4-5 Application Examples	70

Table of contents

SECTION 5 – Error Processing	79
5-1 Error Indications	80
5-2 Troubleshooting from the PC	80
Appendix	83
A – Error Codes	83
B – Specifications	85
C – IR Area Allocations	89
D – DM Area Coding Sheets	91
Index	93

PRECAUTIONS

This section provides general precautions for using C200H-CT001-V1/CT002 High-speed Counter Units and related devices.

The information contained in this section is important for the safe and reliable application of the C200H-CT001-V1/CT002 High-speed Counter Units. You must read this section and understand the information contained before attempting to set up or operate a C200H-CT001-V1/CT002 High-speed Counter Unit.

1	Intended Audience	viii
2	General Precautions	viii
3	Safety Precautions	viii
4	Operating Environment Precautions	ix
5	Application Precautions	ix

1 Intended Audience

This manual is intended for the following personnel, who must also have knowledge of electrical systems (an electrical engineer or the equivalent).

- Personnel in charge of installing FA systems.
- Personnel in charge of designing FA systems.
- Personnel in charge of managing FA systems and facilities.


2 General Precautions

The user must operate the product according to the performance specifications described in the relevant manuals.




Before using the product under conditions which are not described in the manual or applying the product to nuclear control systems, railroad systems, aviation systems, vehicles, combustion systems, medical equipment, amusement machines, safety equipment, and other systems, machines, and equipment that may have a serious influence on lives and property if used improperly, consult your OMRON representative.

Make sure that the ratings and performance characteristics of the product are sufficient for the systems, machines, and equipment, and be sure to provide the systems, machines, and equipment with double safety mechanisms.




This manual provides information for programming and operating the Unit. Be sure to read this manual before attempting to use the Unit and keep this manual close at hand for reference during operation.

-  **WARNING** It is extremely important that a PC and all PC Units be used for the specified purpose and under the specified conditions, especially in applications that can directly or indirectly affect human life. You must consult with your OMRON representative before applying a PC system to the above-mentioned applications.

3 Safety Precautions



-  **WARNING** Do not attempt to take any Unit apart while the power is being supplied. Doing so may result in electric shock.
-  **WARNING** Do not touch any of the terminals or terminal blocks while the power is being supplied. Doing so may result in electric shock.
-  **WARNING** Do not attempt to disassemble, repair, or modify any Units. Any attempt to do so may result in malfunction, fire, or electric shock.

4 Operating Environment Precautions

-  **Caution** Do not operate the control system in the following locations:
- Locations subject to direct sunlight.
 - Locations subject to temperatures or humidity outside the range specified in the specifications.
 - Locations subject to condensation as the result of severe changes in temperature.
 - Locations subject to corrosive or flammable gases.
 - Locations subject to dust (especially iron dust) or salts.
 - Locations subject to exposure to water, oil, or chemicals.
 - Locations subject to shock or vibration.
-  **Caution** Take appropriate and sufficient countermeasures when installing systems in the following locations:
- Locations subject to static electricity or other forms of noise.
 - Locations subject to strong electromagnetic fields.
 - Locations subject to possible exposure to radioactivity.
 - Locations close to power supplies.
-  **Caution** The operating environment of the PC system can have a large effect on the longevity and reliability of the system. Improper operating environments can lead to malfunction, failure, and other unforeseeable problems with the PC system. Be sure that the operating environment is within the specified conditions at installation and remains within the specified conditions during the life of the system.

5 Application Precautions

Observe the following precautions when using the PC system.

-  **WARNING** Always heed these precautions. Failure to abide by the following precautions could lead to serious or possibly fatal injury.
- Always ground the system to 100 Ω or less when installing the Units. Not connecting to a ground of 100 Ω or less may result in electric shock.
 - Always turn OFF the power supply to the PC before attempting any of the following. Not turning OFF the power supply may result in malfunction or electric shock.
 - Mounting or dismounting Power Supply Units, I/O Units, CPU Units, Memory Units, or any other Units.
 - Assembling the Units.
 - Setting DIP switches or rotary switches.
 - Connecting cables or wiring the system.
 - Connecting or disconnecting the connectors.
-  **Caution** Failure to abide by the following precautions could lead to faulty operation of the PC or the system, or could damage the PC or PC Units. Always heed these precautions.
- Fail-safe measures must be taken by the customer to ensure safety in the event of incorrect, missing, or abnormal signals caused by broken signal lines, momentary power interruptions, or other causes.

- Interlock circuits, limit circuits, and similar safety measures in external circuits (i.e., not in the Programmable Controller) must be provided by the customer.
- Always use the power supply voltages specified in this manual. An incorrect voltage may result in malfunction or burning.
- Take appropriate measures to ensure that the specified power with the rated voltage and frequency is supplied. Be particularly careful in places where the power supply is unstable. An incorrect power supply may result in malfunction.
- Install external breakers and take other safety measures against short-circuiting in external wiring. Insufficient safety measures against short-circuiting may result in burning.
- Do not apply voltages to the Input Units in excess of the rated input voltage. Excess voltages may result in burning.
- Do not apply voltages or connect loads to the Output Units in excess of the maximum switching capacity. Excess voltage or loads may result in burning.
- Disconnect the functional ground terminal when performing withstand voltage tests. Not disconnecting the functional ground terminal may result in burning.
- Be sure that all the mounting screws, terminal screws, and cable connector screws are tightened to the torque specified in this manual. Incorrect tightening torque may result in malfunction.
- Leave the label attached to the Unit when wiring. Removing the label may result in malfunction if foreign matter enters the Unit.
- Remove the label after the completion of wiring to ensure proper heat dissipation. Leaving the label attached may result in malfunction.
- Double-check all wiring and switch settings before turning ON the power supply. Incorrect wiring may result in burning.
- Wire correctly. Incorrect wiring may result in burning.
- Mount Units only after checking terminal blocks and connectors completely.
- Be sure that the terminal blocks, Memory Units, expansion cables, and other items with locking devices are properly locked into place. Improper locking may result in malfunction.
- Check the user program for proper execution before actually running it on the Unit. Not checking the program may result in an unexpected operation.
- Confirm that no adverse effect will occur in the system before attempting any of the following. Not doing so may result in an unexpected operation.
 - Changing the operating mode of the PC.
 - Force-setting/force-resetting any bit in memory.
 - Changing the present value of any word or any set value in memory.
- Resume operation only after transferring to the new CPU Unit the contents of the DM Area, HR Area, and other data required for resuming operation. Not doing so may result in an unexpected operation.
- Do not pull on the cables or bend the cables beyond their natural limit. Doing either of these may break the cables.
- Do not place objects on top of the cables or other wiring lines. Doing so may break the cables.
- Use crimp terminals for wiring. Do not connect bare stranded wires directly to terminals. Connection of bare stranded wires may result in burning.
- When replacing parts, be sure to confirm that the rating of a new part is correct. Not doing so may result in malfunction or burning.
- Before touching a Unit, be sure to first touch a grounded metallic object in order to discharge any static built-up. Not doing so may result in malfunction or damage.

SECTION 1

Introduction

This section introduces the High-speed Counter Unit. It starts by describing Unit nomenclature and then describes the type of system the Units are generally incorporated in. This section ends with an introduction to the six operating modes, which are described in more detail in *Section 4*.

1-1	Introduction	2
1-2	Nomenclature	2
1-3	System Configuration	3
1-4	Operating Modes	4

1-1 Introduction


The C200H-CT001-V1 and C200H-CT002 are Special I/O Units for C200H PCs. The C200H-CT001-V1 can be connected directly to an incremental encoder with an open-collector output or source output to function as a high-speed, reversible counter capable of counting at a maximum of 50 kcps.

The C200H-CT002 can be connected directly to an incremental encoder with an RS-422 line driver output or through an Encoder Adapter to an incremental encoder with an open-collector output to function as a high-speed, reversible counter capable of counting at a maximum of 75 kcps.

The C200H-CT002 is more resistive to noise than the C200H-CT001-V1 and should be used wherever excessive cable length or a noise-prone environment is anticipated. Unless otherwise specified, all information presented applies to both High-Speed Counter Units. Both the High-Speed Counter Units are referred to generically as the Counter Unit.

1-2 Nomenclature

The nomenclature is the same for both the C200H-CT001-V1 and the C200H-CT002. The C200H-CT001-V1 is shown below.

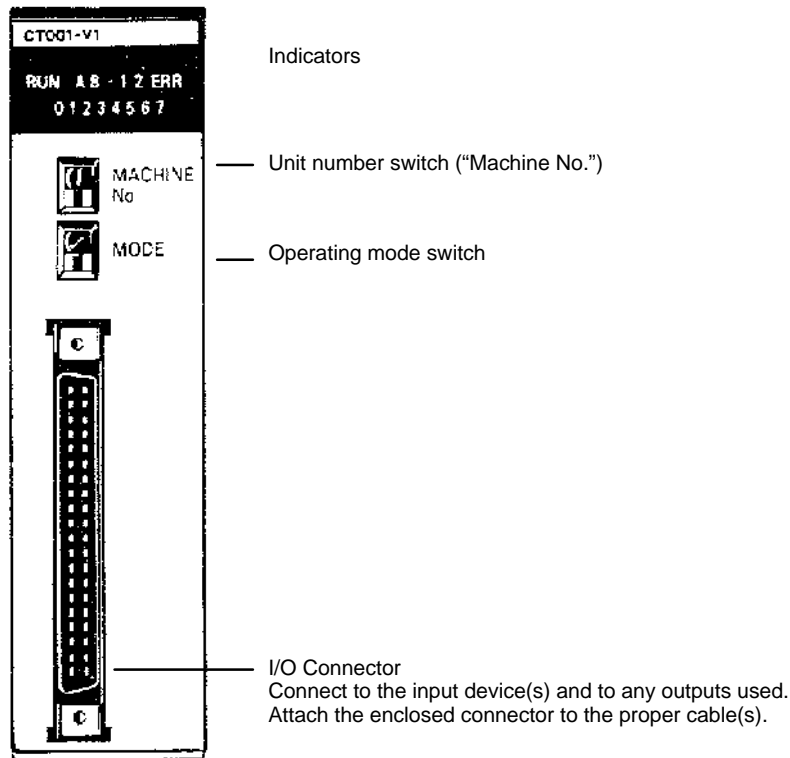


Indicator	Function
RUN	Lit during normal operation or when waiting for input. Goes out for errors.
A	Lit when input A is ON.
B	Lit when input B is ON.
1	Lit when control input IN1 is ON.
2	Lit when control input IN2 is ON.
ERR	Lit when an error has occurred.
0 to 7	Lit when corresponding output is ON.

1-3 System Configuration

Example Configuration

The following example system configuration uses the Counter Unit to determine whether or not product length is acceptable. The length of the products passing by on the conveyor is measured by using the output from a photoelectric switch to initiate and end counting of pulses output from an encoder. Product length is checked against standards and the product is ejected if it is out of the acceptable range.

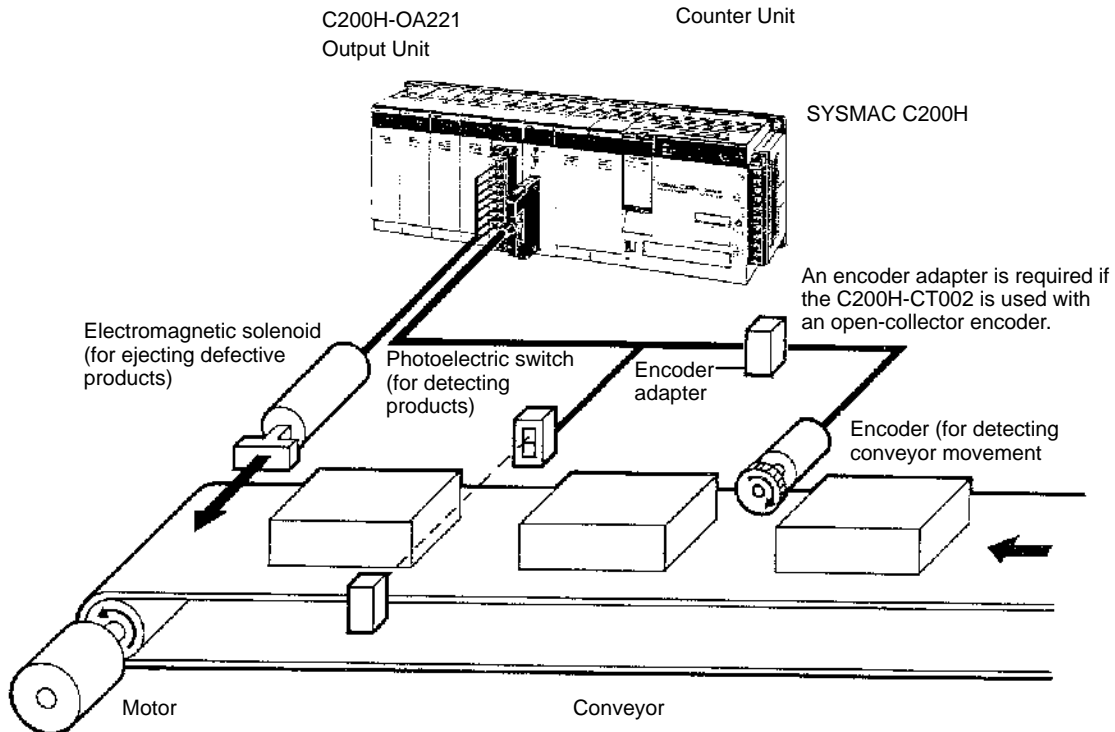

Many other applications are possible by combining other types of inputs and outputs. Refer to *Section 4 Data Allocation and Operating Modes* for other application examples.

Maximum number of Special I/O Units per PC

A maximum of 10 Special I/O Units, including Position Control Units, Counter Units, etc., can be mounted under the same PC, regardless of whether they are on the CPU Rack, the Expansion I/O Rack, or the rack containing a Remote I/O Slave Unit controlled by the PC. No more than four of these can be mounted onto any one rack containing a Remote I/O Slave Unit.

Mounting Location

The Counter Unit can be mounted to any but the 2 rightmost CPU Rack slots. Mounting the Counter Unit to either of these slots will prevent you from mounting devices directly to the PC's CPU. The back panel DIP switch must be set before the Counter Unit is mounted. (Refer to *2-1 Switch Settings*.)

1-4 Operating Modes

The Counter Unit can be operated in any one of the six operating modes described below. External outputs are available in only 3 modes: linear, circular, and preset. The function of these outputs depends on the mode. (The mode is selected using the mode selector on the front panel of the Counter Unit, as described in *2-1 Switch Settings*.) The following is merely an introduction to the operating modes, all of which are covered in detail in *Section 4 Data Allocation and Operating Modes*.

Linear Mode

In linear mode, the counter value is incremented and decremented between $-8,388,608$ and $8,388,607$ and is continually compared with preset ranges.

When the counter value is within a range (or ranges), specified outputs are turned ON. The same output may be specified for one or more overlapping ranges, in which case the output will be turned ON whenever the counter value is within one or more of the ranges.

A maximum of 16 ranges may be specified, each with upper and lower limits. These limits must be within the counter range, i.e., between $-8,388,608$ and $8,388,607$. Data can be transferred from the PC to change range limits or to set the present counter value as desired.

Circular Mode

In circular mode, the counter value restarts from zero after reaching a preset maximum value or returns to the preset maximum value when the counter value is decremented past zero. In all other respects, including data transfer, circular mode functions exactly as the linear mode. The preset maximum value must be between 0 and 65,535.

Preset Mode

In preset mode, the counter value is normally decremented from a preset value (between 1 and 8,388,607) to zero, although it can also be incremented. During this decrement phase, a total of 3 outputs may be switched ON and OFF according to ON/OFF counter values. When the counter value reaches zero, a total of 4 outputs may be turned ON, either indefinitely or for a preset time, T. Data can be transferred from the PC to change ON/OFF counter values as desired.

Gate Mode

Two types of gate mode operation are available on the C200H-CT002: normal and cumulative. Only the normal type is available on the C200H-CT001-V1. In normal gate mode, pulses are counted while control input IN1 (the count signal) is ON. The counter value is retained when input IN1 goes OFF until input IN1 goes ON again, at which point counting restarts from zero. In the cumulative type, control input IN1 serves as the reset signal and counting continues while control input IN2 (the count signal) is ON. Each time input IN2 is turned ON, counting continues from the current counter value until it is reset to zero by input IN1. In either type of gate mode, the counting range is between $-8,388,608$ and $8,388,607$ and counting may be in either direction. This mode does not support data transfer or external outputs from the Counter Unit.

Latch Mode

In latch mode, counting begins from zero when control input IN1 (count signal) is turned ON and ranges between $-8,388,608$ and $8,388,607$. Pulses are counted continuously (regardless of whether input IN1 is ON or OFF), but the current counter value is always the counter value latched the last time control input IN2 (the latch signal) was turned ON, i.e., the current counter value remains unchanged while the latch signal (control input IN2) is ON and is updated to the actual count while the latch signal is OFF. Counting may be restarted from zero at any time by activating control input IN1. Control inputs

IN1 and IN2 may originate either externally or internally. This mode does not support external outputs from the Counter Unit or data transfer.

Sampling Mode

In sampling mode, pulses are counted for a preset interval after control input IN1 (the count signal) is turned ON. Counting may be in either direction.

Counting always begins at zero and ranges between $-8,388,608$ and $8,388,607$. The time interval must be between 10 and 9,999 ms.

Control input IN1 may originate either externally or internally. This mode does not support external outputs from the Counter Unit or data transfer.

SECTION 2

Switch Settings and Wiring

This section provides the Unit settings and connector cable pin specifications. Instructions for the construction of input and output connectors are provided. Electrical schematics and examples are presented to further explain Unit operation.

2-1	Switch Settings	8
2-2	Wiring	10
2-3	Input Circuit Wiring Examples	18
2-3-1	C200H-CT001-V1	18
2-3-2	C200H-CT002	21
2-4	Dimensions	24

2-1 Switch Settings


Always turn off the Counter Unit before setting the unit number and mode selectors. Use a regular screwdriver, being careful not to damage the slot in the screw. Be sure not to leave a selector midway between settings.

Front Panel DIP Switch

Switch name	Function
Unit no.	Used to set the unit number. Unit numbers run from 0 through 9 and are the same for all Special I/O Units, i.e. unit number 0 may be assigned to a Position Control Unit; unit number 1, to a High-speed Counter Unit; etc. Do not set the same number for more than one Special I/O Unit.
Mode	Used to set the operating mode. Modes run from 1 through 6, as follows: 1: Linear 2: Circular 3: Preset 4: Gate 5: Latch 6: Sampling

Back Panel DIP Switch

This switch must be set before the Counter Unit is mounted. It is not necessary to set all the pins for all operating modes. Refer to *3-2 Input Selection* and *Section 4 Data Allocation and Operating Modes* for operational details.

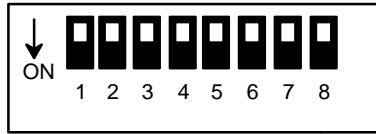

Input Selection

Pins 1 through 3 are used to select the type of inputs for inputs A and B.

1	2	3	Input type	
OFF	OFF	OFF	Offset phases	Normal
OFF	OFF	ON		x2
OFF	ON	*		x4
ON	OFF	*	Up and down pulses	
ON	ON	*	Pulse and direction	

Internal Reset Bit

8	Function
OFF	Reset bit inoperative
ON	Reset bit effective on rising edge.

This setting is effective only for operating modes 1,2, and 3.

For Operating Mode 1 or 2: Input Z

4	5	Function
OFF	*	Input Z inoperative
ON	OFF	Input Z effective on falling edge.
ON	ON	Input Z effective on rising edge.

Control Input IN1

6	7	Function
OFF	*	Control input IN1 inoperative
ON	OFF	Control input IN1 effective on falling edge.
ON	ON	Control input IN1 effective on rising edge.

This setting is effective only for operating modes 1,2, and 3.

In modes 4, 5, and 6, control inputs IN1 and IN2 are always effective on their rising edges

For Operating Mode 3: Start Input

4	5	Function
OFF	*	Start on START command (IR n, bit 00).
ON	*	Start on control input IN2.

*Pins marked with asterisks are not used.

2-2 Wiring

Connector Pin Arrangement Names of inputs and outputs and the pin arrangement of the connector are shown below (as viewed from the front). The connector is a Fujitsu FCN-361J040 (solder type), and is included with the Counter Unit.

C200H-CT001-V1

Row B	Pin no.	Row A
Input A: 24 VDC	20	Input A: 12 VDC
Input A: 0 V	19	Input A: 5 VDC
Input B: 24 VDC	18	Input B: 12 VDC
Input B: 0 V	17	Input B: 5 VDC
Input Z: 24 VDC	16	Input Z: 12 VDC
Input Z: 0 V	15	Input Z: 5 VDC
	14	
	13	Control input IN1: 12/24 VDC
Control input IN1: 0 V	12	Control input IN1: 5 VDC
	11	Control input IN2: 12/24 VDC
Control input IN2: 0 V	10	Control input IN2: 5 VDC
	9	
Outputs 0 through 3 Power supply: 5 to 24 VDC	8	Output 0
	7	Output 1
Outputs 0 through 3, COM: 0 V	6	Output 2
	5	Output 3
Outputs 4 through 7 Power supply: 5 to 24 VDC	4	Output 4
	3	Output 5
Outputs 4 through 7, COM: 0 V	2	Output 6
	1	Output 7


C200H-CT002

Row B	Pin no.	Row A
	20	
Input A: neg.	19	Input A: pos.
	18	
Input B: neg.	17	Input B: pos.
	16	
Input Z: neg.	15	Input Z: pos.
	14	
	13	Control input IN1: 12/24 VDC
Control input IN1: 0 V	12	Control input IN1: 5 VDC
	11	Control input IN2: 12/24 VDC
Control input IN2: 0 V	10	Control input IN2: 5 VDC
	9	
Outputs 0 through 3 Power supply: 5 to 24 VDC	8	Output 0
	7	Output 1
Outputs 0 through 3, COM: 0 V	6	Output 2
	5	Output 3
Outputs 4 through 7 Power supply: 5 to 24 VDC	4	Output 4
	3	Output 5
Outputs 4 through 7, COM: 0 V	2	Output 6
	1	Output 7

Wiring Connectors


Solder-type connectors are included with the Counter Unit.

Use wire with a cross-sectional area of 0.3 mm² or less. When soldering, do not short-circuit an adjacent terminal; cover the soldered section with an insulation tube. When using multicore cable, wire output and input cables separately.

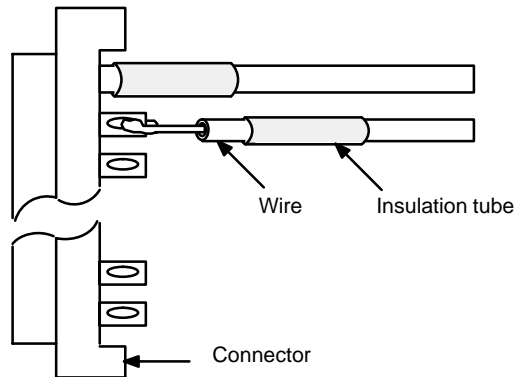


Differentiating Cables and Connector Pin Numbers

Input and output cables can be differentiated by position, as shown on the right below. Alignment with the connector pin numbers is also as shown on the left below. Please make sure you are wiring to the correct pins.

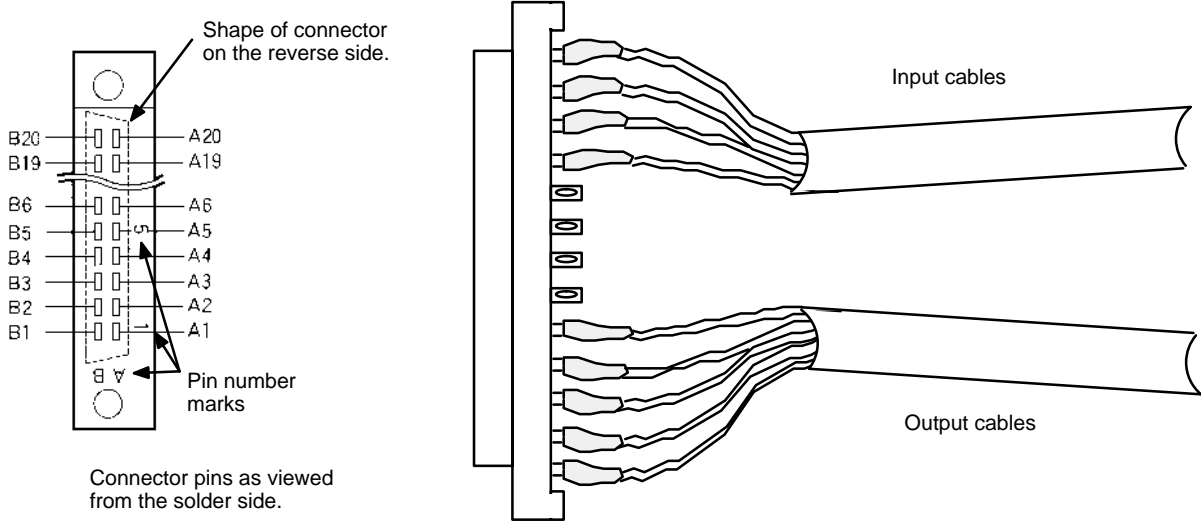

Assembling Connectors

Assemble connectors as shown below.

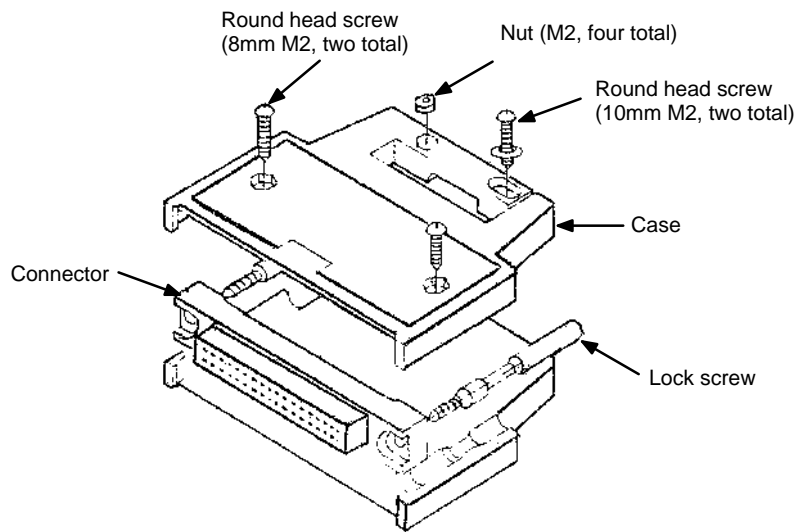

Note Any of the following connectors can be used as required by operating conditions. The jack is a Fujitsu model 360.

- 1, 2, 3... 1. FCN-361J040 (solder-type, included with Counter Unit)
FCN-360C040-B (connector cover)
- 2. FCN-363J040 (crimp type, housing)
FCN-363J-AU (connector)
FCN-360C040 (connector cover)
- 3. FCN-367J040-AV/F (crimp type)

Wiring Precautions


For the C200H-CT001-V1, the terminals that are used depend upon the power supply of inputs A, B, and Z.

For the C200H-CT002, inputs A, B, and Z must be line driver inputs (Am26LS31-compatible). Positive and negative terminals must be wired correctly. The terminals that are used depend upon the power supply of the control inputs. Be careful to connect to the correct terminals. Supply only one voltage for

each input. The terminals for output power supply, 5 to 24 VDC and COM (0 V), are separated into two: those for outputs 0 through 7. These are not interconnected internally. If the 5 to 24 VDC and COM (0 V) terminals for the output power supply are connected incorrectly, an internal fuse will burn out, preventing operation. This fuse is not user serviceable. This fuse will also burn out if the output current exceeds 0.5 A/common, again preventing operation. When wiring inputs A, B, and Z, the following measures must be taken to prevent interference from noise:

- 1, 2, 3... 1. Use shielded twisted pair cable and ground the shield.
2. Keep wiring as short as possible and do not place lines parallel to possible sources of noise, such as power lines.
3. Use a stabilized power supply that is independent from other input and output power supplies.






The external power supply must be greater than or equal to the load power supply. (An error may occur if the external power supply is less than the load power supply.) In the example on the following page, E1 must be greater than or equal to E2.

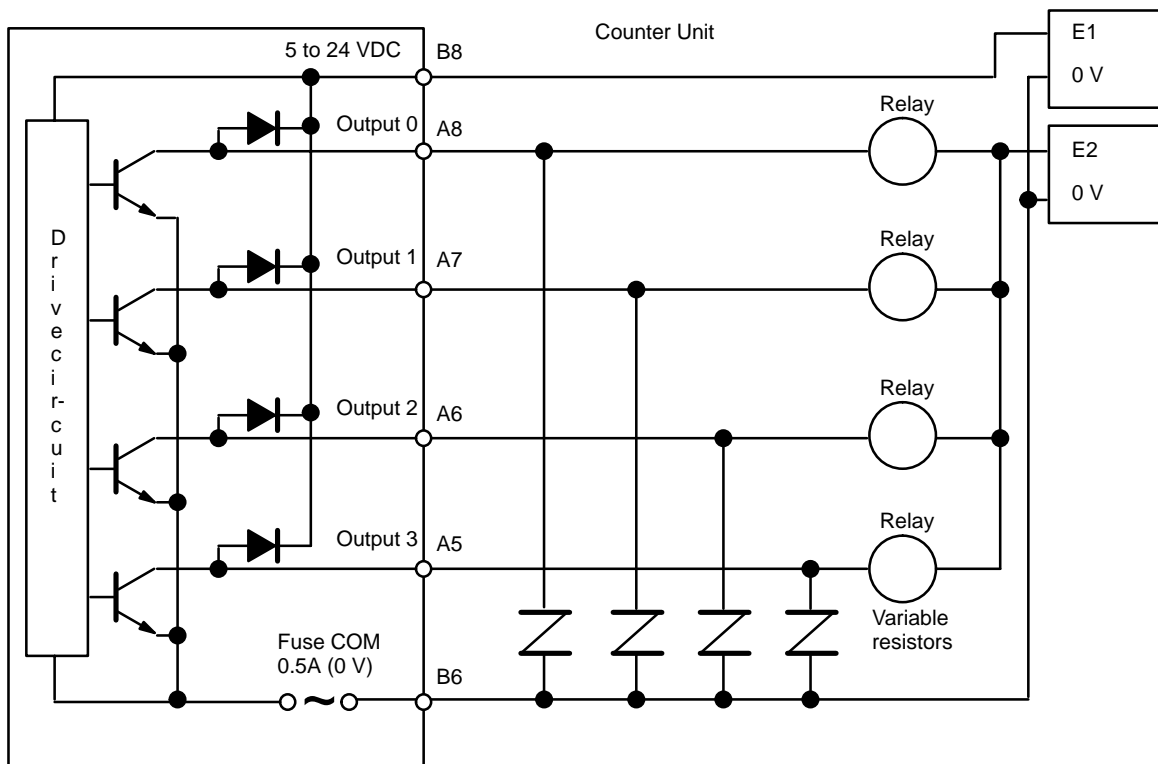



Input and Output Circuits

Actual pin numbers are arranged in order from the top of the connector starting with A20 and B20. For each input, connect the 0-V terminal and only one of the other terminals, i.e., do not supply more than one voltage for any input. The circuits are shown on the following pages.


C200H-CT001-V1 Input Circuits

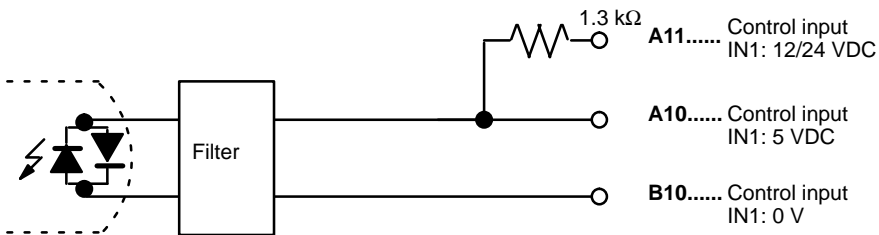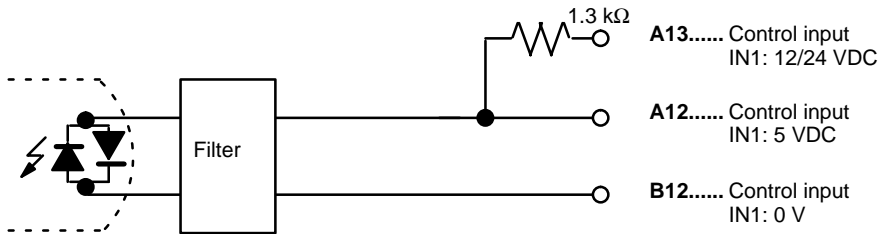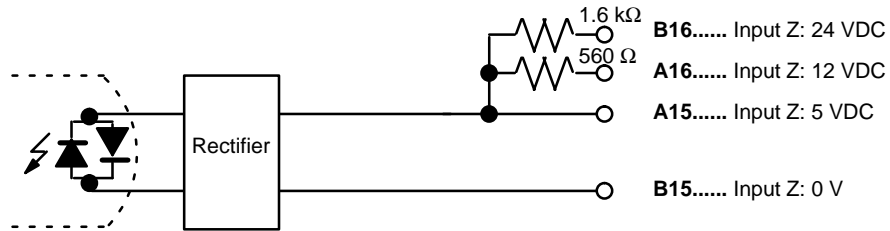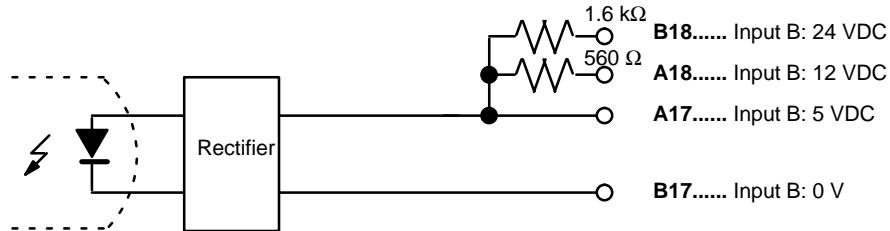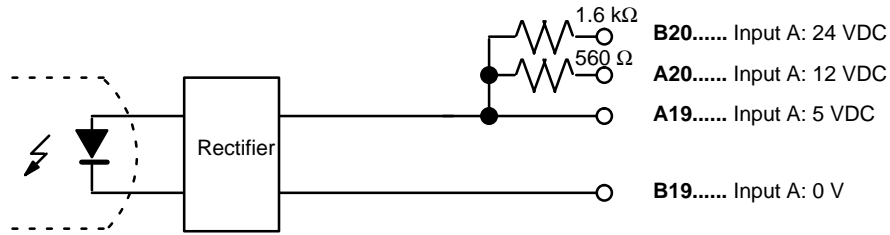



C200H-CT001-V1 Output Circuits

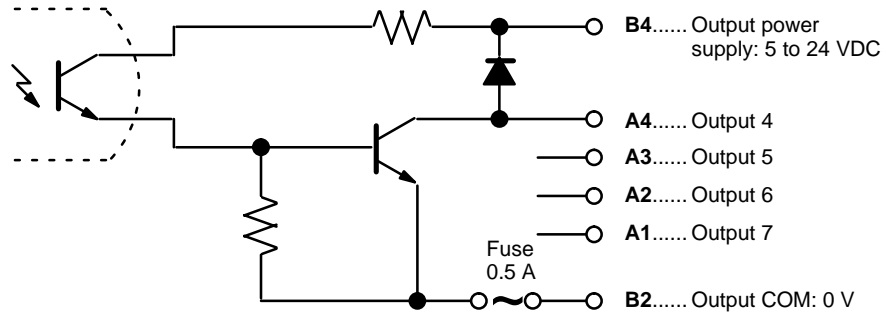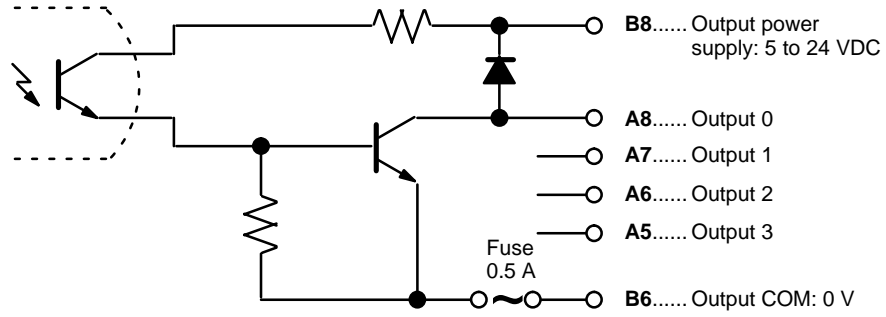

C200H-CT002 Input Circuits

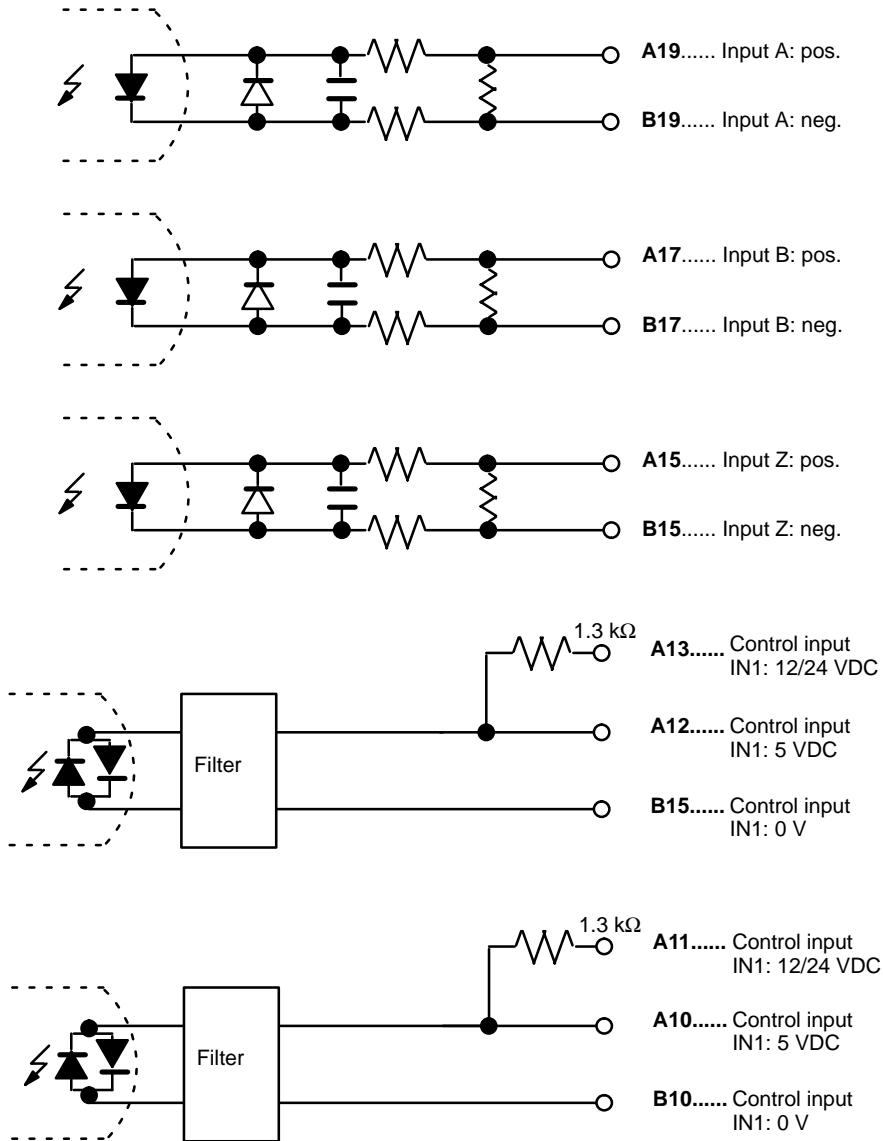

C200H-CT002 Output Circuits

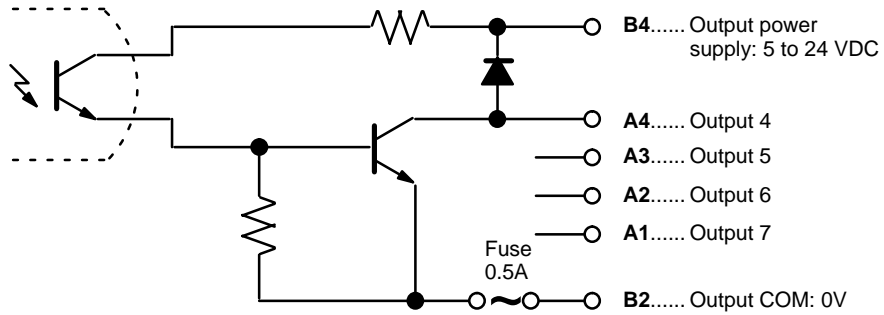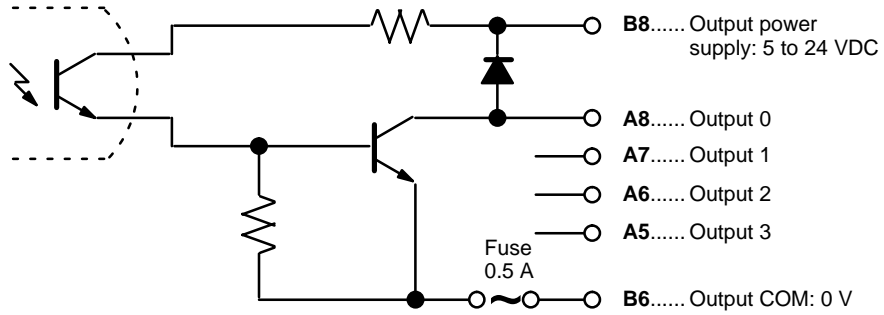

2-3 Input Circuit Wiring Examples


2-3-1 C200H-CT001-V1

Examples

The following wiring examples show connections between encoders and inputs A, B, and Z.


Example 1
12-VDC, Open-collector Encoder

This example shows the connections that would be used for a 12-VDC power supply and an incremental encoder with an open-collector output.

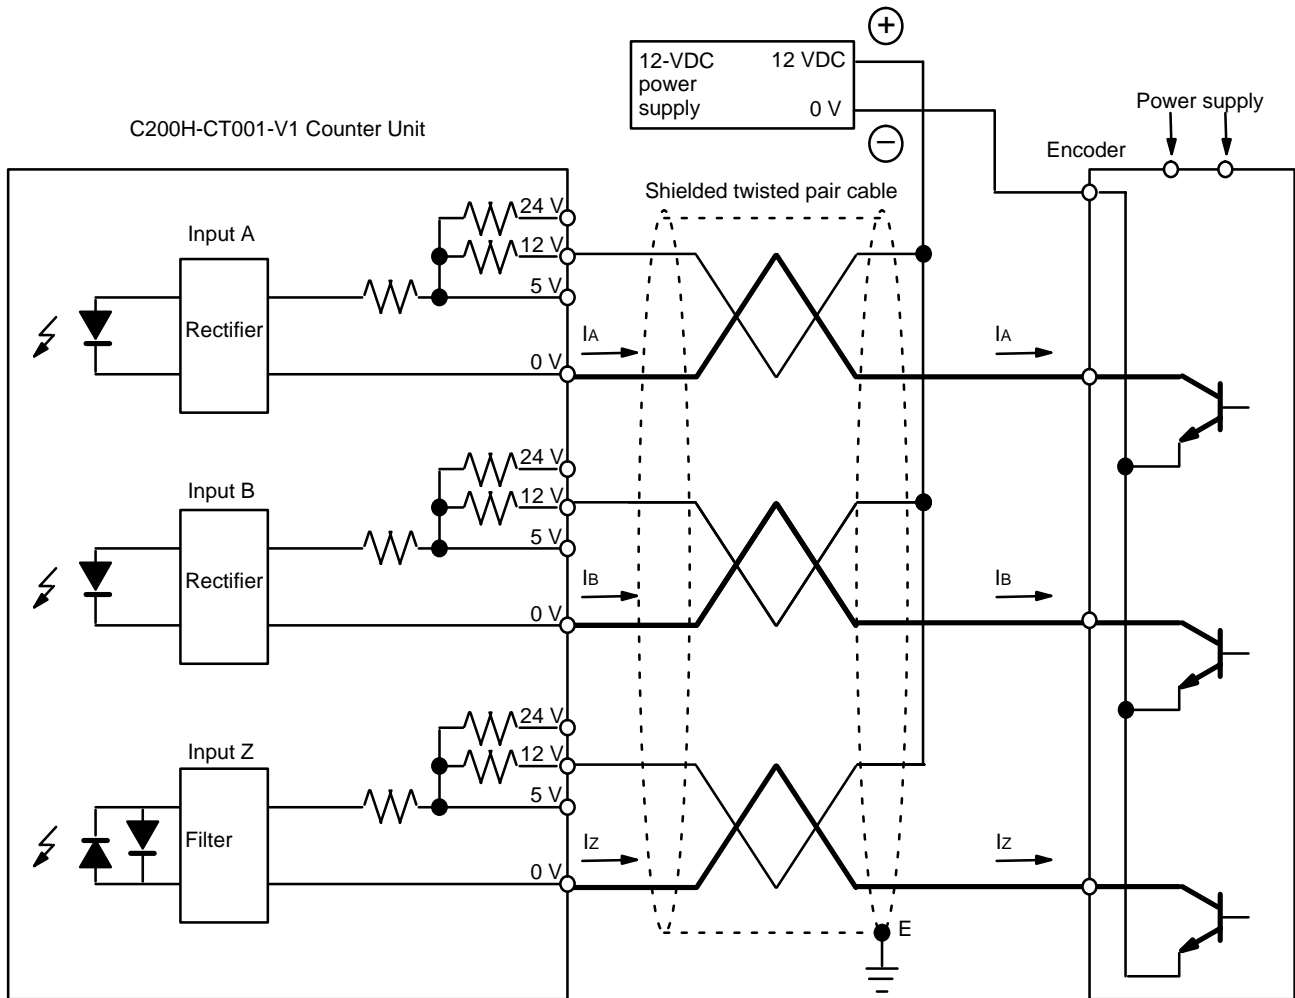


Example 2
12-VDC, Voltage-output,
Sync-load Encoder

This example shows the connections that would be used for a 12-VDC power supply and a sync-load encoder with a voltage output. When the encoder output is high, the input to the Counter Unit turns OFF. When the encoder output is low, the input to the Counter Unit turns ON.

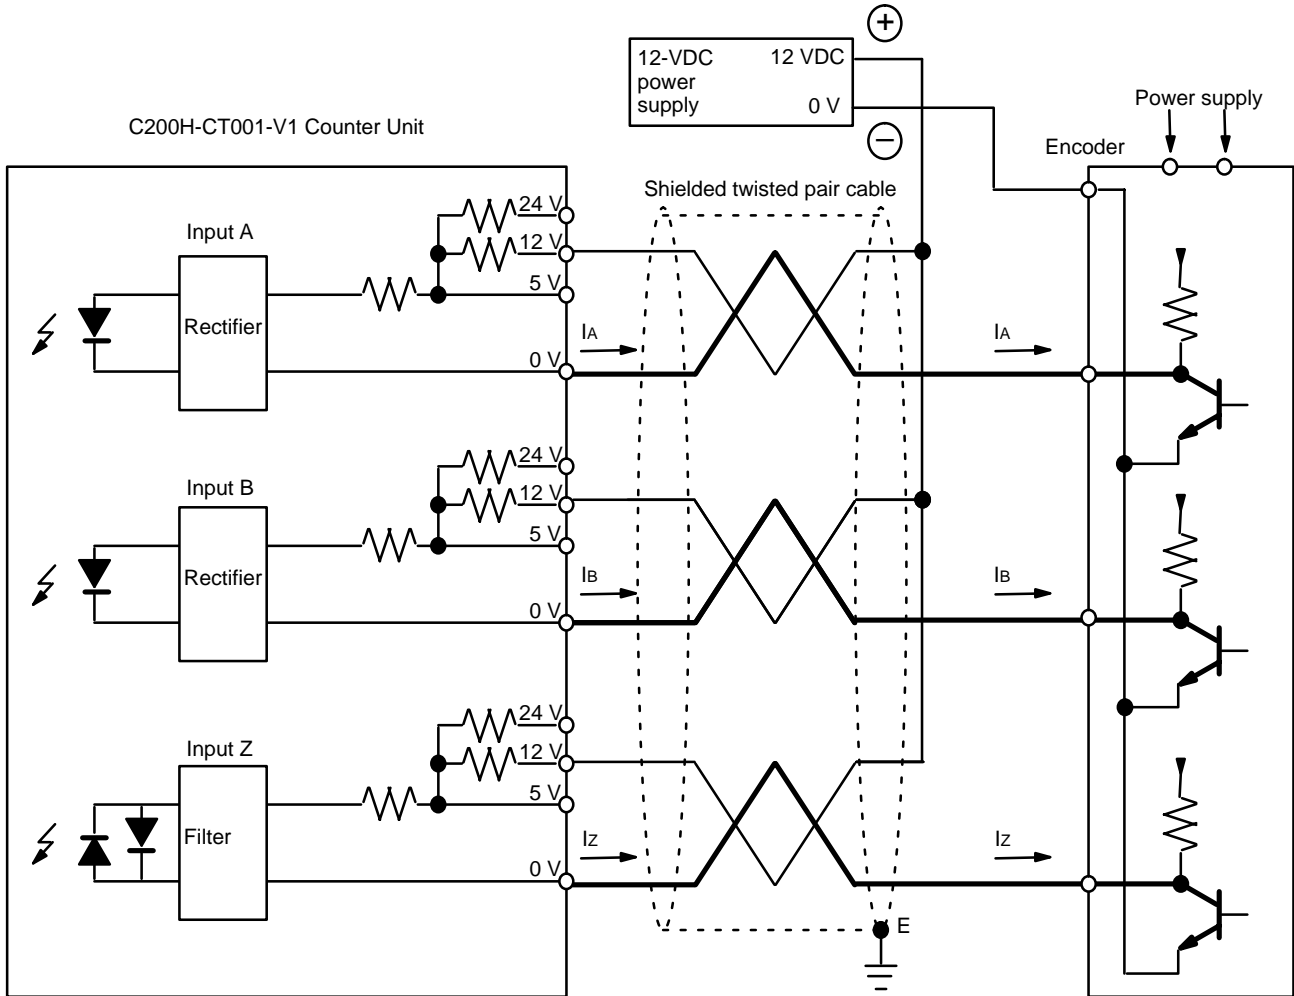

Example 3
5 VDC, Voltage-output,
Source-load Encoder


This example shows the connections that would be used for a 5-VDC power supply and a source-load encoder with a voltage output. Here, attention must be paid to the ON voltage.

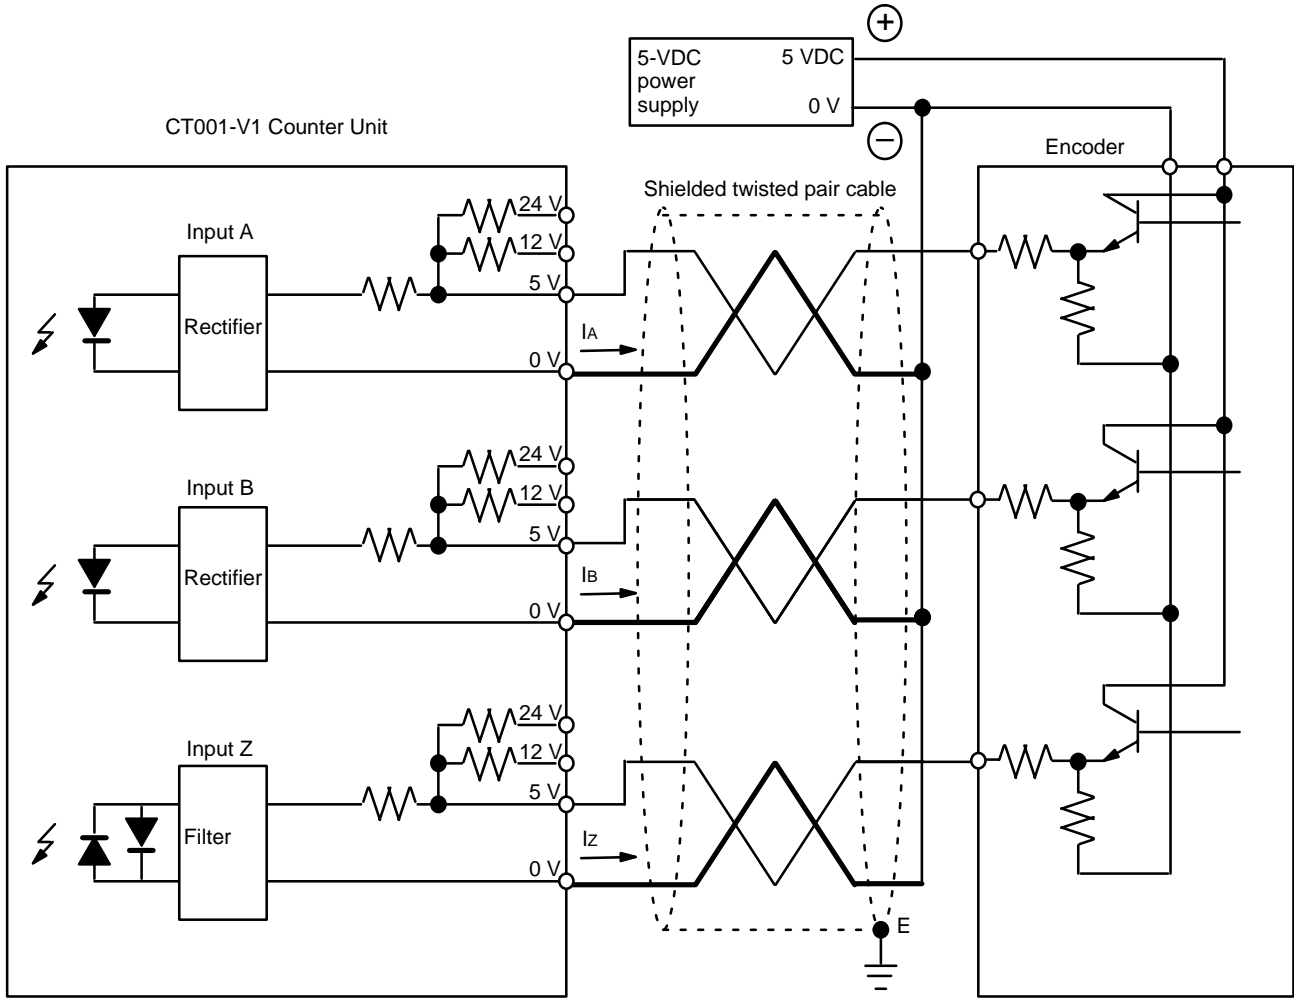

2-3-2 C200H-CT002


Example 1 Line-driver Encoder

The following wiring examples shows connections between a line-driver encoder (Am26LS31-compatible) with outputs A, B, Z and inputs A, B, and Z.

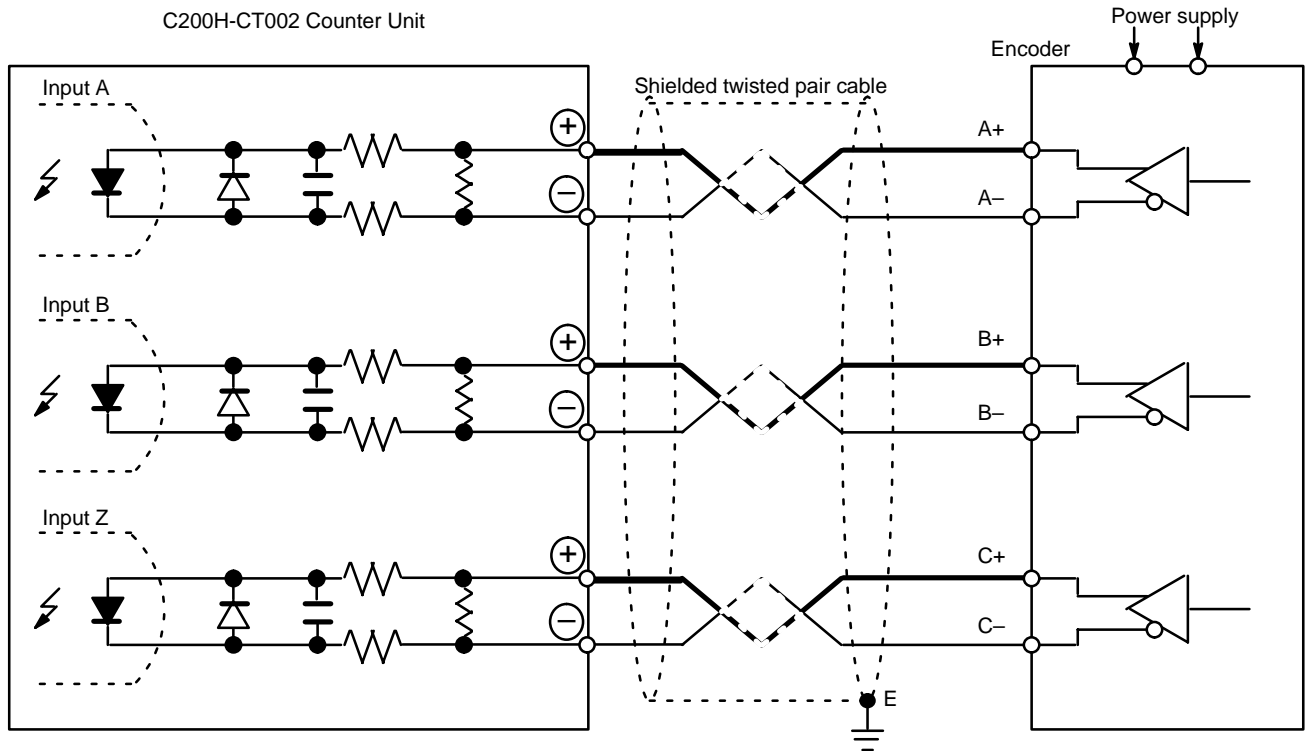


Example 2 Open-collector Encoder and Encoder Adapter

The following wiring example shows connections between an open-collector encoder and an Encoder Adapter (C500-AE001), and between the Encoder Adapter and inputs A, B, and Z. Connections should be wired so that Counter Unit inputs go ON when encoder outputs go ON. Because the C500-AE001 Encoder Adapter uses an Am26LS31-compatible line driver, high voltage is impressed on the positive terminal and low voltage is impressed on the negative terminal when the output is high.

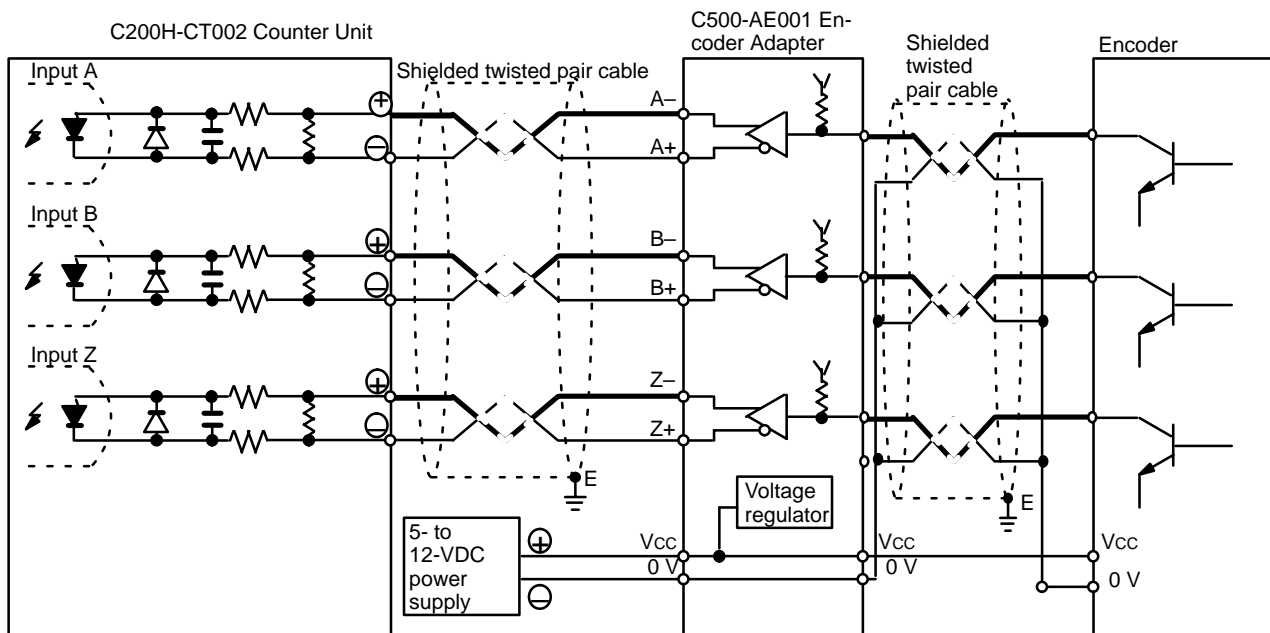


Control Input Wiring Examples

In order to prevent chattering, install the input wiring with as few contacts as possible.

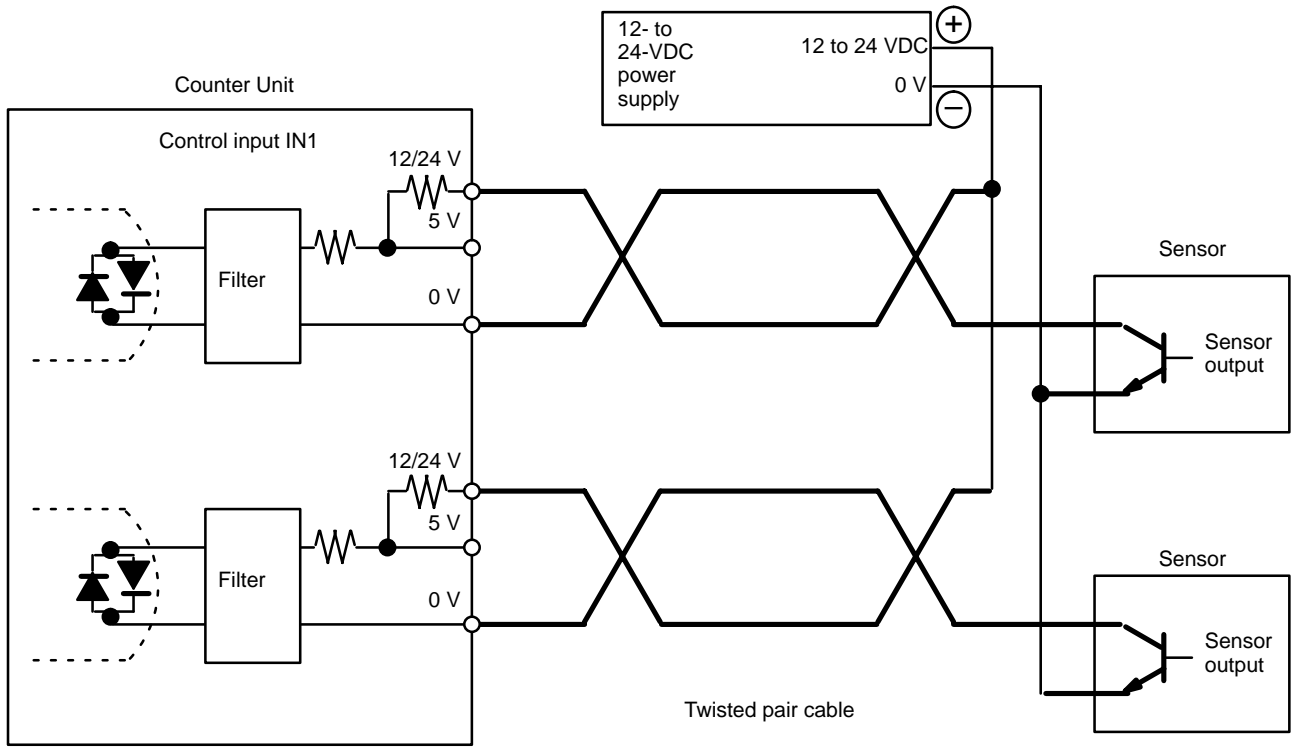


External Output Wiring Example

The following example shows output wiring with outputs 0 through 3 connected to relays and outputs 4 through 7 connected to TTL devices.

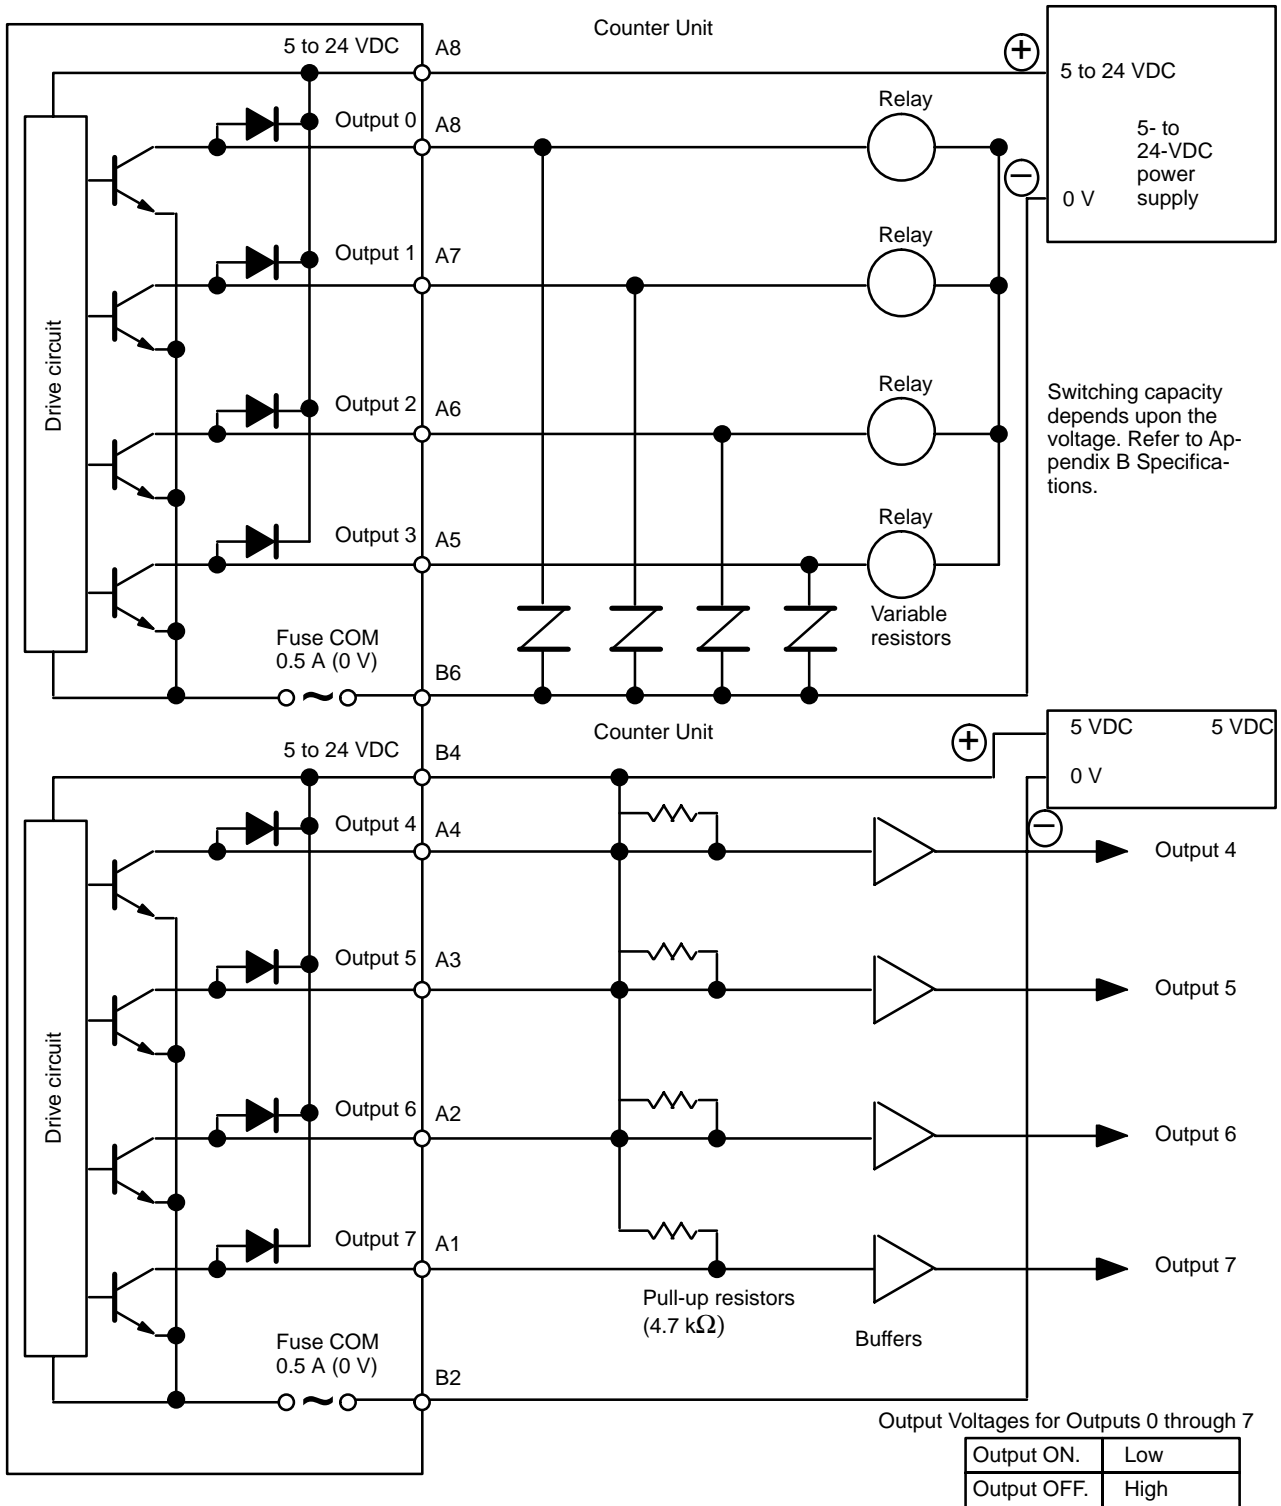


2-4 Dimensions

Unit Dimensions (Unit: mm)

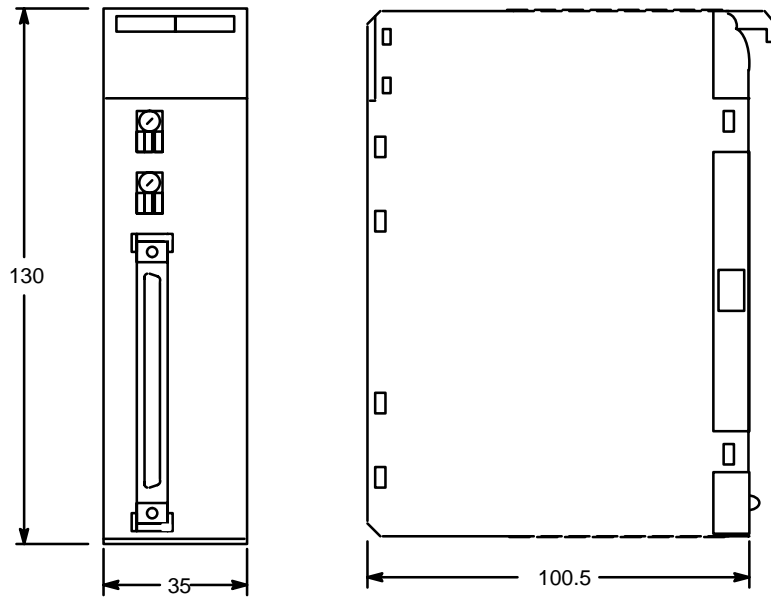

Mounted Dimensions (Unit: mm)

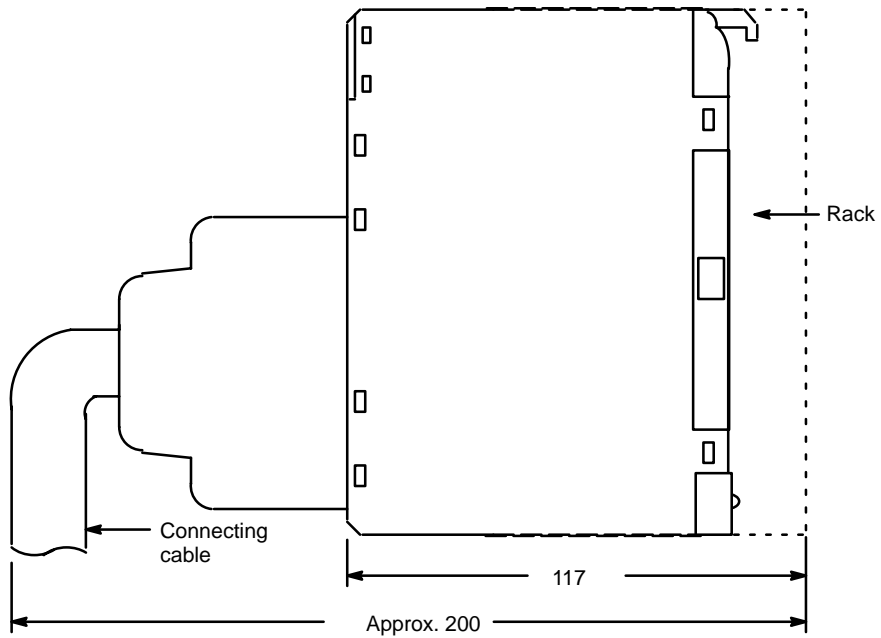

SECTION 3

Operation

This section describes the operational flow of the counting system. The input types are identified along with instructions for their use. Data transfer timing is described in relation to the PC cycle time.

3-1	Operational Flow	26
3-2	Input Selection	26
3-2-1	Offset Phases	26
3-2-2	Up and Down Pulses	28
3-2-3	Pulse and Direction	28
3-3	Counter Reset Conditions	29
3-4	Data Transfer Timing	30

3-1 Operational Flow

Each Special I/O Unit mounted under a C200H PC is assigned a unit number between 0 and 9. The unit number assigned to the Counter Unit determines the 100 DM words and 10 IR words that will be allocated to it. DM words are used for Counter Unit parameters; IR words, for command bits and flags. (Refer to 4-1 *Data Configuration and Allocation* for details.) The following procedure outlines the steps necessary to operate the Counter Unit.

- 1, 2, 3...
1. Set the mode selector on the front panel to the desired operating mode, and then set the DIP switch on the rear panel accordingly. (Refer to 2-1 *Switch Settings*.)
 2. Set the unit number with the selector on the front panel. (Refer to 2-1 *Switch Settings*.)
 3. Using the Programming Console, set data required in the DM area under the unit number.
 4. Prepare the user program to operate the Counter Unit using the allocated IR area words and bits.

It is also possible to set parameters and counter values in any data area using the user program or the Programming Console. This data can then be transferred to the Counter Unit by using the TRANSFER DATA command bit. (Refer to page 40 *TRANSFER DATA Command*.)


3-2 Input Selection

Any one of three types of inputs can be selected: offset phase inputs (i.e., two inputs with offset phases), individual up and down inputs, and pulse and direction inputs. All three types of inputs include a reset input. Any type of any input can be used with any of the operating modes, although not all operating modes support resetting. (Refer to *Section 4 Data allocation and Operating Modes* for details.) The type of inputs is selected with the back panel DIP switch.

3-2-1 Offset Phases

Offset phase inputs use the difference in phase between two inputs to determine whether the counter value will be incremented or decremented. An input multiplier, either x 2 or x 4, is available with offset phase inputs to increase accuracy. If the x 2 multiplier is selected, the counter value will be incremented or decremented twice for each input A pulse; if the x 4 multiplier is selected, the counter value will be incremented or decremented four times for each input A pulse. The multiplier is set with the back panel DIP switch. (Refer to 2-1 *Switch Settings*.)

The counter can be reset in the linear or circular operating modes by using the Z-phase output of the encoder. Refer to 3-3 *Reset Conditions* for details.

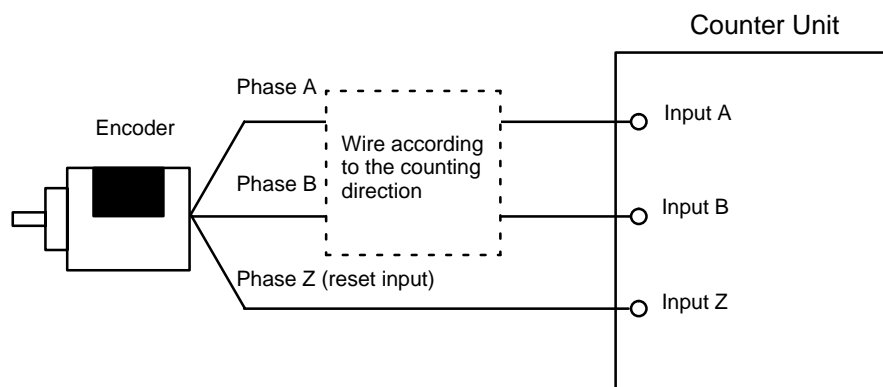

Counting Speed

The maximum pulse frequency possible for offset phase inputs is determined by the specifications of the incremental encoder connected to the Counter


Units. The following example shows calculations E6B-CWZ3C Incremental Encoder when used with the C200H-CT001-V1. Rotational directions are given as viewed from the end of the encoder shaft.

Encoder Specifications

Power supply	4.75 to 13.2 VDC, ripple (p-p): 5% max.
Current consumption	50 mA max.
Resolution	500 pulses/revolution
Outputs	Phase A, phase B, phase Z
Output type	Open collector
Output capacity	Applied voltage: 30 VDC max. Sync. current: 80 mA max. Residual voltage: 1 V max
Max. frequency	30 kHz
Output phase difference (between phase A and B)	$90^\circ \pm 45^\circ$ ($1/4T \pm 1/8T$)
Output fall/rise time	1.0 μ s max.


CW Rotation

Here, input A is advanced by $1/4T \pm 1/8T$ over input B.

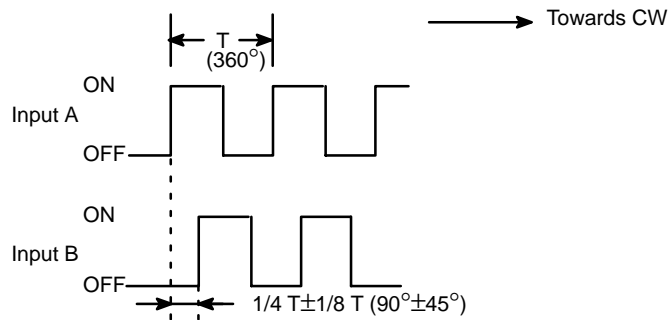

CCW Rotation

Here, input A is delayed by $1/4T \pm 1/8T$ over input B.

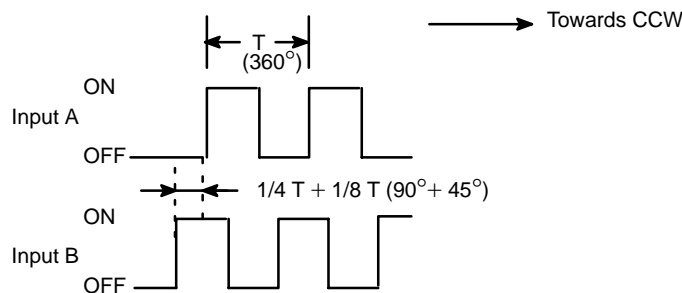

Since the output phase difference is $90^\circ \pm 45^\circ$, the minimum phase difference produced by this encoder is as follows:

$$90^\circ - 45^\circ = 45^\circ$$

Because the C200H-CT001-V1 requires a minimum phase difference of 4.5, 4.5 must be less than $45^\circ/360^\circ$. T must therefore be less than 36 meaning the maximum frequency, $1/T$, would be 27.7 kcps (54 rps for 500 pulses per revolution). This would be the maximum frequency at which this encoder could be used with the C200H-CT001-V1. With the C200H-CT002, a minimum phase difference of 3 is required. Computing as above shows a maximum frequency of 41.7 kcps when using the C200H-CT002 with this encoder.


Note The minimum pulse width must be considered when using input Z to reset the counter. With the C200H-CT001-V1, the pulse width of input Z must be 0.1 ms or greater, and the return frequency must be 5 kcps or less. With the

C200H-CT002, the pulse width of input Z must be 10 or greater, and the return frequency, allowing for software processing time, must be 10 kcps or less.

3-2-2 Up and Down Pulses

With separate up and down pulse inputs, the counter value is incremented or decremented on the rising edge of the appropriate input. Here, sensors could replace the encoders to provide inputs A and B.


In the linear or circular operating modes, the counter can be reset by connecting input Z to a sensor or switch.

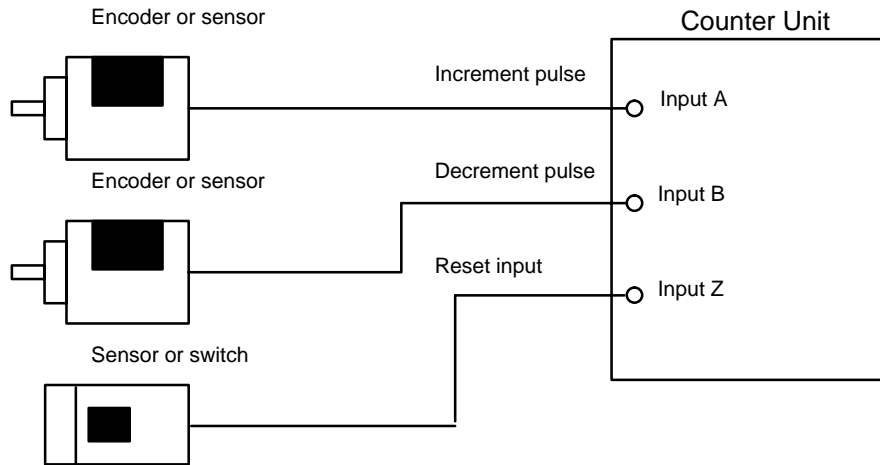

3-2-3 Pulse and Direction

With pulse and direction inputs, the counter value is incremented or decremented on the rising edge of the pulse input. If the direction input is OFF, the counter value is incremented; if the direction input is ON, the counter value is decremented. The direction input should be switched between ON and OFF only when the pulse input is OFF.


















In the linear or circular operating modes, the counter can be reset by connecting input Z to a sensor or switch.

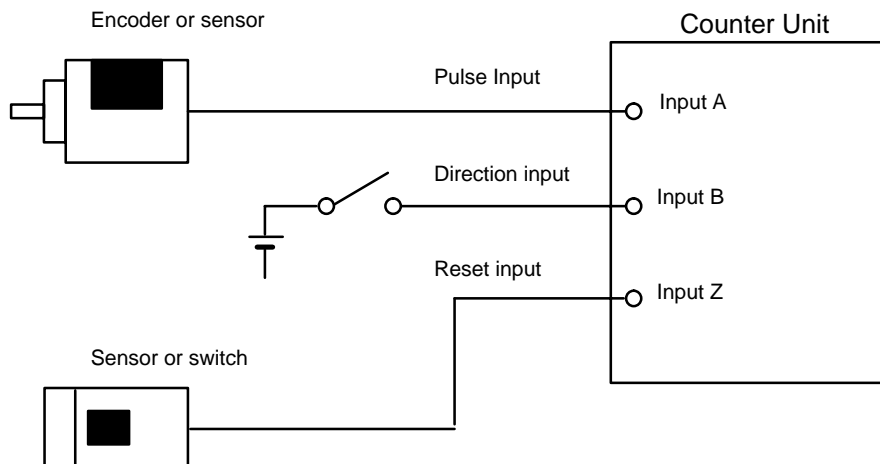

3-3 Counter Reset Conditions

Counter reset conditions vary according to the combination of inputs used and pin settings on the back panel DIP switch. The DIP switch settings required for the input combinations shown in the following table and the operating modes that can be used with each are shown on the next page. (The numbers 1 through 17 above the input patterns correspond to the settings.) Resetting is not possible in the gate, latch, and sampling operating modes. All inputs for each pattern must be in the status shown for setting to be effective. The minimum input pulse width for the input Z is 0.1 ms; that for the control input IN1, 1 ms.

In the following table, input Z is indicated by Z; control input IN1, by IN1, and the internal reset bit, by IRB. The point at which the reset actually takes place is indicated by the arrow at the bottom of each pattern. The DIP switch settings for each pattern are described on the following page.

Inputs used	Reset conditions and timings			
	1	2	3	4
Input Z Control input IN1 Internal reset bit				
Input Z Control input IN1				
Input Z Internal reset bit				
Control input IN1 Internal reset bit				
Input Z				
Control input IN1				
Internal reset bit				

DIP Switch Settings

Pins 1 through 3 do not affect resetting

Pattern number on previous page	Pin Settings					Possible operating modes		
	4	5	6	7	8	Linear	Circular	Preset
1	ON	ON	ON	ON	ON	OK	OK	OK
2	ON	ON	ON	OFF	ON	OK	OK	OK
3	ON	OFF	ON	ON	ON	OK	OK	OK
4	ON	OFF	ON	OFF	ON	OK	OK	OK
5	ON	ON	ON	ON	OFF	OK	OK	OK
6	ON	ON	ON	OFF	OFF	OK	OK	OK
7	ON	OFF	ON	ON	OFF	OK	OK	OK
8	ON	OFF	ON	OFF	OFF	OK	OK	OK
9	ON	ON	OFF	*	ON	OK	OK	OK
10	ON	OFF	OFF	*	ON	OK	OK	OK
11	OFF	*	ON	ON	ON	OK	OK	OK
12	OFF	*	ON	OFF	ON	OK	OK	OK
13	ON	ON	OFF	*	OFF	OK	OK	OK
14	ON	OFF	OFF	*	OFF	OK	OK	OK
15	OFF	*	ON	ON	OFF	OK	OK	OK
16	OFF	*	ON	OFF	OFF	OK	OK	OK
17	OFF	*	OFF	*	ON	OK	OK	OK


*These pins may be either ON or OFF.

3-4 Data Transfer Timing

Data transfer is available in linear and circular modes to change ranges limit settings or the current counter value and in preset mode to change range limit settings. The data to be transferred must be prepared in the appropriate form in a PC data area. Data transfer specifications and procedures are described under the relevant operating modes. This section describes only data transfer timing in relation to the PC cycle time.


C200H Cycle Time

The C200H PC cycle consists of the following operations.

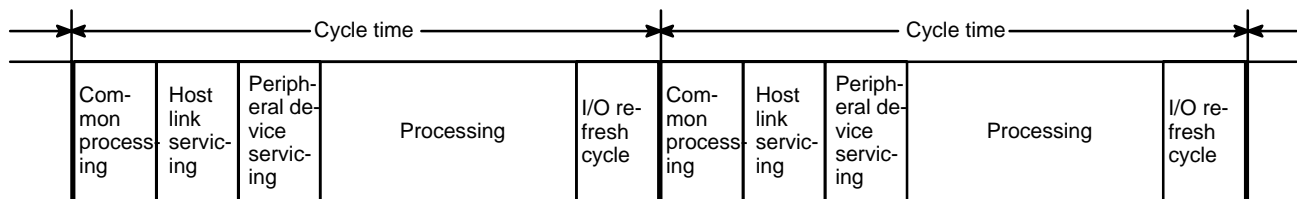


Data Transfer

Input and output data is transferred during the I/O refresh cycle. This means that PC acknowledgement of inputs from the Counter Unit (e.g., status) and Counter Unit acknowledgement of outputs from the PC (e.g., commands) are delayed until the next I/O refresh cycle, as shown below.

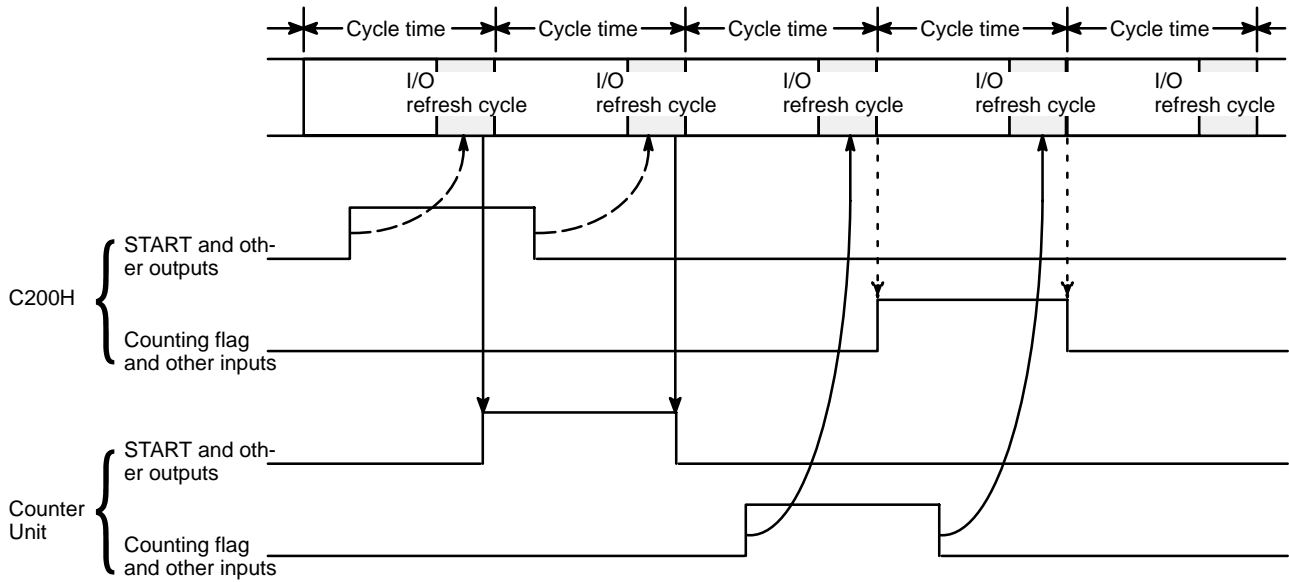

Data transfer would enter into the cycle time as shown below:

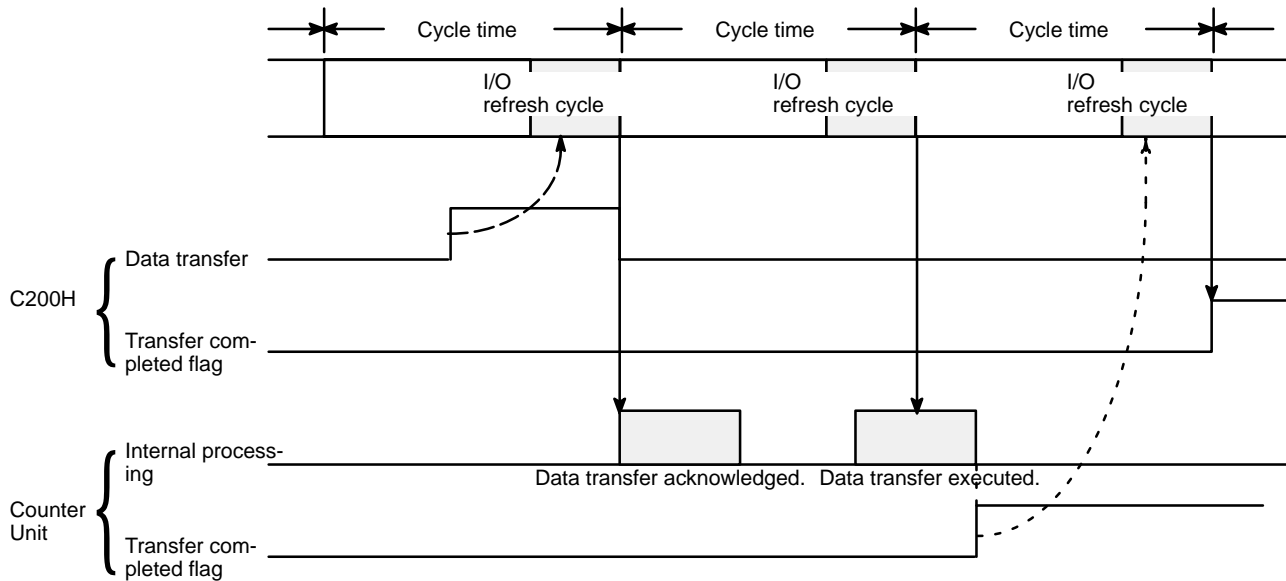

Note: The transfer completed flag reverses status (ON to OFF or OFF to ON) each time a transfer is completed.

Data Transfer in Remote I/O Systems

When the Counter Unit is mounted on a Rack containing a Remote I/O Slave Unit, a delay will occur due to data transfer between the Remote I/O Master Unit and the Remote I/O Slave Unit. See the C200H Programming Manual for details.

SECTION 4

Data Allocation and Operating Modes

This section describes the various operating modes in detail. Each mode is described by data allocation, timing charts, commands, flags, and examples. Data formats are explained.

4-1	Data Configuration and Allocation	34
4-2	Linear and Circular Modes	36
4-2-1	Data Allocation	36
4-2-2	DM Area Settings	39
4-2-3	IR Area Settings	40
4-2-4	Timing Chart	46
4-2-5	Application Examples	47
4-3	Preset Mode	52
4-3-1	Data Allocation	52
4-3-2	DM Area Settings	55
4-3-3	IR Area Settings	56
4-3-4	Timing Chart	60
4-3-5	Application Example	61
4-4	Gate, Latch, and Sampling Modes	63
4-4-1	Data Allocation	64
4-4-2	DM Area Settings	65
4-4-3	IR Area Settings	65
4-4-4	Timing Charts	66
4-4-5	Application Examples	70

4-1 Data Configuration and Allocation

IR words 100 through 199 are allocated as I/O refresh areas. Each Counter Unit is allocated 10 consecutive words (although not all modes use all 10 words). The first IR word for each Counter Unit, designated in this manual as n , can be computed from the unit numbers as follows:

$$n = 100 + 10 \times \text{unit number.}$$


IR words are refreshed during the PC's I/O refresh cycle. Note that input and output designations are in reference to the PC, e.g., command bits are outputs, status bits are inputs.

Each Counter Unit is also allocated 100 consecutive words as a parameter area (although not all modes use all 100 words). These words are in the DM area and run from DM 1000 through DM 1999. The first DM word for each Counter Unit, m , can also be computed from the unit number:

$$m = 1000 + 100 \times \text{unit number.}$$


All DM area data for the Counter Unit is transferred to it whenever power is turned ON or the Counter Unit is reset.

These allocations are shown below for all unit numbers. Details of allocations within these words are given under the operating modes to which they apply. A quick overview of word and bit allocations is available in *Appendix C IR Area Allocations* and *Appendix D DM Area Coding Sheets*.

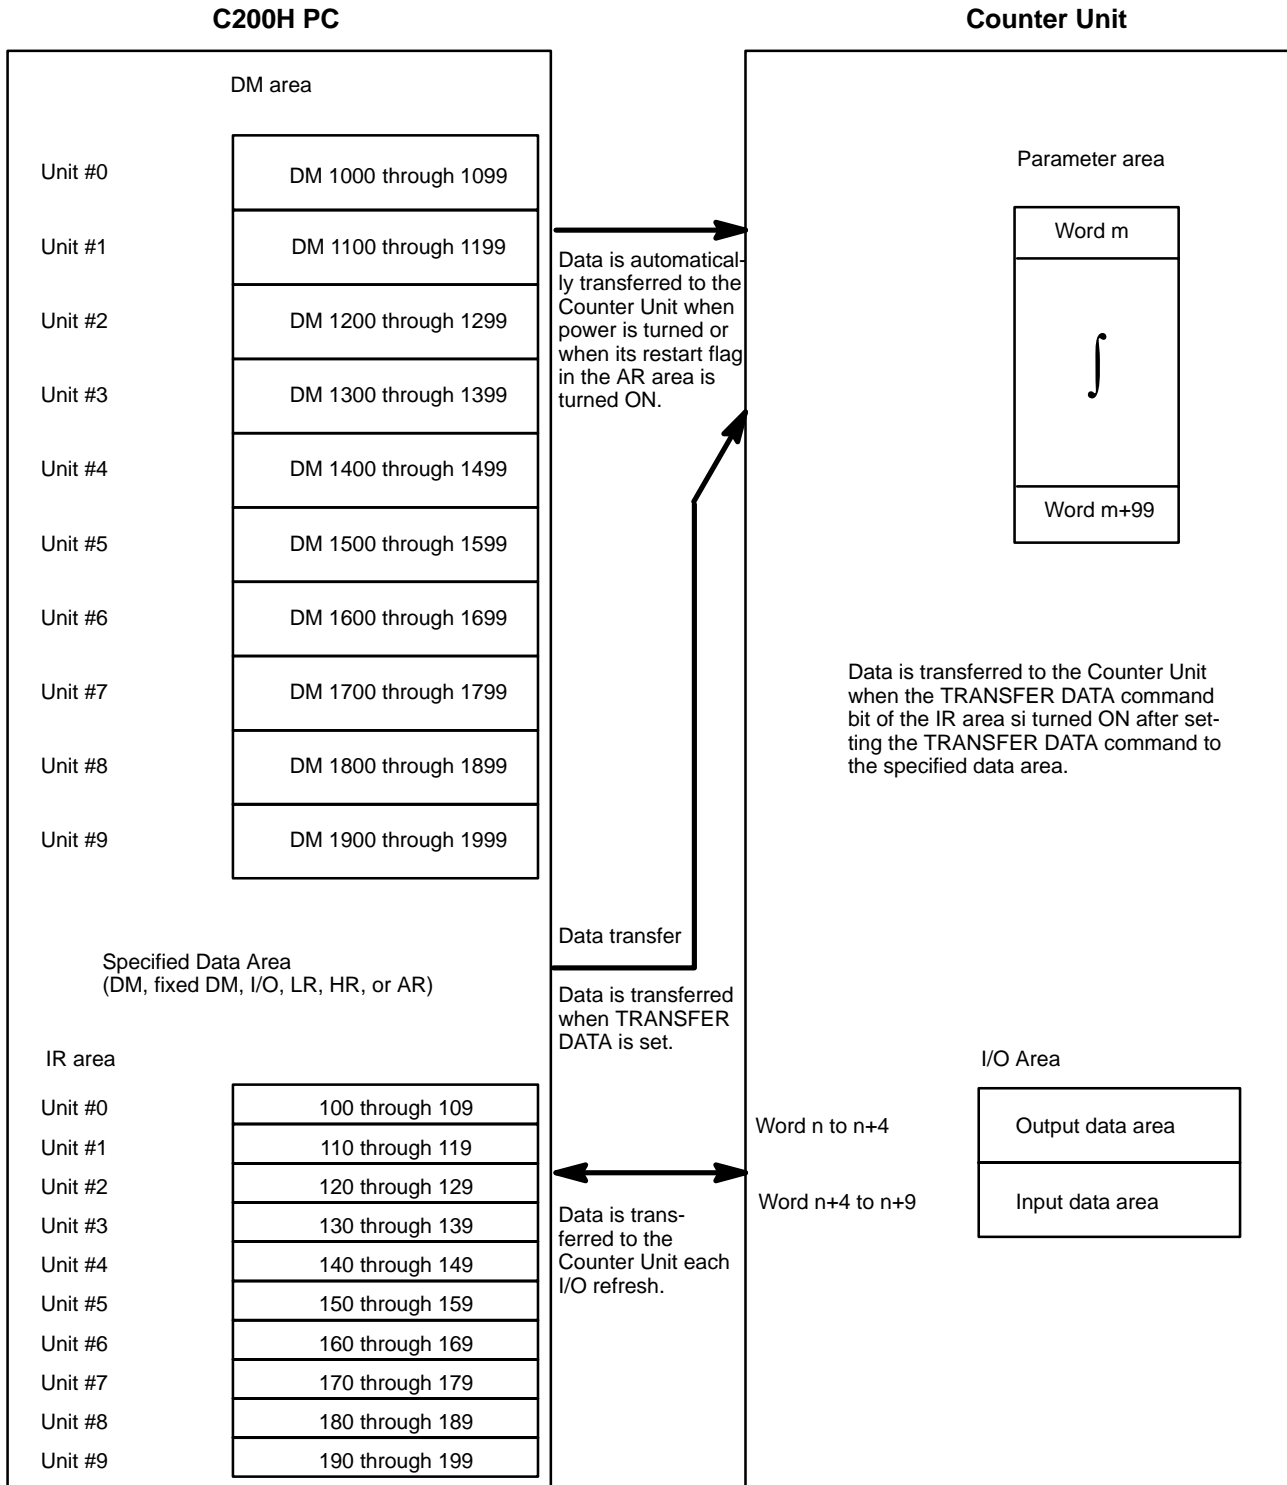

Data Format

Data is allocated by either bit or by word, though it is often input and output by decimal digit, i.e., four bits (BCD), or by hexadecimal digit. Counter values, upper and lower limits of ranges, and some other data are held in two adjacent words, sometimes with a sign digit, in the following format.

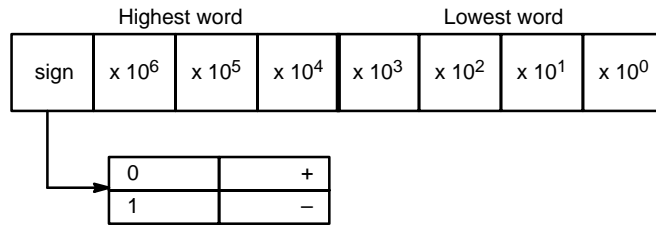

Note that the rightmost word is always the lowest word, i.e., if the two words were m+10 and m+11, the rightmost word would be m+10; the leftmost, m+11. Furthermore, the rightmost digit in each word begins in the lowest bits, i.e., the digits x 10⁴ and x 10⁰ above would be held in, bits 00 through 03 of their respective words. Even when only one word or part of a word is required to hold data, e.g., the error code or error location, the rightmost digit is also always held in the lower bits. Although decimal notation is generally used for data in this manual, data is handled in the system as binary-coded decimal (BCD) unless otherwise noted. Note that this data is generally input as decimal, whereas hexadecimal data is input as hexadecimal. The number of digits given for certain data refers to the decimal digits, e.g., “7 digits with sign” indicates that the lowest word and rightmost 12 bits of the highest word are allocated to the 7-digit decimal value; the leftmost four bits are allocated to the sign digit.

4-2 Linear and Circular Modes

In both linear and circular modes counter values are incremented and decremented according to any of the three types of input pulses. All functional aspect and data allocations for these two modes are the same, except that in linear mode, counter values range linearly between -8,388,608 and 8,388,607, while in circular mode, counter values range from 0 to a preset maximum value (used only in circular mode), with the maximum value and 0 being adjacent to each other in sequence. That is, decrementing below 0 results in the current counter value going to the maximum value; incrementing past the maximum value results in the current counter value going to zero.

Both modes provide 16 outputs, all of which can be output internally (i.e., to the PC) and eight of which can be output externally (i.e., without passing through the PC) as well as internally. These outputs are sometimes referred to by number and sometimes as either internal inputs and external inputs. The term internal outputs refers to all outputs sent to the PC; external outputs, to all outputs set to the external connector.

Both modes provide 16 ranges for counter values during which the outputs can be set to turn ON. These ranges can be enabled or disabled during operations. Data transfer from the PC data area is also available in both modes to change either range settings or the current counter value.

Although control input IN1 is supposed by both modes, control input IN2 is not used.

Note Stop counter operation before changing the present value to 0 or resetting the Counter Unit in the ring mode. If either of these is performed without stopping counter operation, the maximum value preset operation will not be performed correctly.

4-2-1 Data Allocation

The commands, parameters, flags, and other information in the following tables are described in detail in 4-2-2 DM Area Settings and 4-2-3 IR Area Settings.

DM Area

The DM area contains user parameters that are to be set into the Counter Unit, including the operating mode and output range limits. The first DM word for each Counter Unit is indicated by m and equals 1,000 plus 100 times the unit number.

Word	Bit	Function
m	07 through 00	Set to 0.
	11 through 08	Operating mode (Here, either 1: linear or 2: circular)
	15 through 12	Set to 0.
m + 1	15 through 00	Effective range bits (bit numbers correspond to range numbers)
m + 2	15 through 00	Maximum counter value (for circular mode only)
m + 3	15 through 00	6 digits (Bits 15 to 04 not used.)
m + 4 m + 9		Not used.
m + 10	15 through 00	Lower limit for range #0, 7 digits with sign digit Upper limit for range #0, 7 digits with sign digit
m + 11	15 through 00	
m + 12	15 through 00	
m + 13	15 through 00	
m + 14	15 through 00	Output pattern for range #0 (bit numbers correspond to output numbers)
m + 15 m + 19		Lower limit, upper limit, and output pattern for range #1 (Format same as that for range #0.)
m + 20 m + 24		Lower limit, upper limit, and output pattern for range #2 (Format same as that for range #0.)
m + 25 m + 29		Lower limit, upper limit, and output pattern for range #3 (Format same as that for range #0.)
m + 30 m + 34		Lower limit, upper limit, and output pattern for range #4 (Format same as that for range #0.)
m + 35 m + 39		Lower limit, upper limit, and output pattern for range #5 (Format same as that for range #0.)
m + 40 m + 44		Lower limit, upper limit, and output pattern for range #6 (Format same as that for range #0.)
m + 45 m + 49		Lower limit, upper limit, and output pattern for range #7 (Format same as that for range #0.)
m + 50 m + 54		Lower limit, upper limit, and output pattern for range #8 (Format same as that for range #0.)
m + 55 m + 59		Lower limit, upper limit, and output pattern for range #9 (Format same as that for range #0.)
m + 60 m + 64		Lower limit, upper limit, and output pattern for range #10 (Format same as that for range #0.)
m + 65 m + 69		Lower limit, upper limit, and output pattern for range #11 (Format same as that for range #0.)
m + 70 m + 74		Lower limit, upper limit, and output pattern for range #12 (Format same as that for range #0.)
m + 75 m + 79		Lower limit, upper limit, and output pattern for range #13 (Format same as that for range #0.)
m + 80 m + 84		Lower limit, upper limit, and output pattern for range #14 (Format same as that for range #0.)
m + 85 m + 89		Lower limit, upper limit, and output pattern for range #15 (Format same as that for range #0.)
m + 89 m + 99		Not used.

IR Area

The IR area contains commands and status information. Inputs and outputs are given in reference to the PC, i.e., output data is sent from the PC to the Counter Unit; input data, from the Counter Unit to the PC. The first IR word for each Counter Unit is indicated by n and equals 100 plus 10 times the unit number.

Outputs

Word	Bit	Function
n	00	START command
	01	TRANSFER DATA command
	02	ENABLE OUTPUT command
	03	Not used.
	04	CHANGE RANGES command
	05	READ ERROR command
	06	RESET COUNTER command
	07	ENABLE FORCED OUTPUT command
	08	Output #0 force bit
	09	Output #1 force bit
	10	Output #2 force bit
	11	Output #3 force bit
	12	Output #4 force bit
	13	Output #5 force bit
	14	Output #6 force bit
15	Output #7 force bit	
n+1	00	Range #0 enable bit
	01	Range #1 enable bit
	02	Range #2 enable bit
	03	Range #3 enable bit
	04	Range #4 enable bit
	05	Range #5 enable bit
	06	Range #6 enable bit
	07	Range #7 enable bit
	08	Range #8 enable bit
	09	Range #9 enable bit
	10	Range #10 enable bit
	11	Range #11 enable bit
	12	Range #12 enable bit
	13	Range #13 enable bit
	14	Range #14 enable bit
15	Range #15 enable bit	
n+2	15-00	TRANSFER DATA beginning word number, 4 digits
n+3	03-00	TRANSFER DATA data area, 0 to 4
	07-04	Not used. (Set to 0.)
	15-08	Number of transfers, 1 to 3

Inputs

Word	Bit	Function
n+4	00	Counting flag
	01	Z flag
	02	IN1 flag
	03	IN2 flag
	04	Transfer completed flag
	05	Error flag
	06	Count overflow flag
	07	Reset flag
n+5	07-00	Error location
	15-08	Error code
n+6	15-00	Current counter value, 7 digits with sign (-8,388,608 to +8,388,607)
n+7	15-00	
n+8	00	Range #0 flag
	01	Range #1 flag
	02	Range #2 flag
	03	Range #3 flag
	04	Range #4 flag
	05	Range #5 flag
	06	Range #6 flag
	07	Range #7 flag
	08	Range #8 flag
	09	Range #9 flag
	10	Range #10 flag
	11	Range #11 flag
	12	Range #12 flag
	13	Range #13 flag
	14	Range #14 flag
	15	Range #15 flag
n+9	00	Output #0 flag (external output possible)
	01	Output #1 flag (external output possible)
	02	Output #2 flag (external output possible)
	03	Output #3 flag (external output possible)
	04	Output #4 flag (external output possible)
	05	Output #5 flag (external output possible)
	06	Output #6 flag (external output possible)
	07	Output #7 flag (external output possible)
	08	Output #8 flag (internal output only)
	09	Output #9 flag (internal output only)
	10	Output #10 flag (internal output only)
	11	Output #11 flag (internal output only)
	12	Output #12 flag (internal output only)
	13	Output #13 flag (internal output only)
	14	Output #14 flag (internal output only)
	15	Output #15 flag (internal output only)

4-2-2 DM Area Settings

Operating Mode	DM word m, bits 11 through 08 The operating mode is set with the mode selector on the front panel. Refer to <i>1-4 Operating Modes</i> for an overview of available modes.
Effective Range Bits	DM word m+1 Bit numbers correspond to range numbers, i.e., but 0 corresponds to range #0; bit 1, to range #1, etc. Range data is allocated to words m+10 through m+89. Turn ON (set to 1) the bits for all ranges that are to be effective. These bits are effective immediately after the power supply is turned ON or the Counter Unit is restarted. The effective ranges can also be changed using CHANGE RANGES. Refer to <i>4-3-3 IR Area Settings</i> for details.
Maximum Counter Value (Circular Mode Only)	DM word m+2 and m+3 Set to between 0 and 65,535. The counter value will return to zero when incremented past this value and return to this value when decremented below zero.
Range Settings	Words m+10 through m+89 Each of the 16 ranges is allocated 5 consecutive words for its lower limit, upper limit, and output pattern. Refer to <i>4-3-1 Data Allocation</i> for the specific words for each range; the following allocations are for range #0. In circular mode, a range will span zero if the lower limit is greater than the upper limit. Ranges may overlap, in which case all outputs specified for each are set. Set all data for unused ranges to zeros.
Lower Limit	Words m+10 and m+11 (Range #0) The lower limit must be within the limits of the counter value, i.e., between 0 and the maximum counter value in circular mode and between -8,388,608 and 8,388,607 in linear mode. Bits 15 through 12 of DM word m+11 (leftmost digit in higher word) is the sign digit (not used in circular mode).
Upper Limit	Words m+12 and m+13 (Range #0) The upper limit must also be within the limits of the counter value, i.e., between 0 and the maximum counter value in circular mode and between -8,388,608 and 8,388,607 in linear mode. Bits 15 through 12 of DM word m+13 (leftmost digit in higher word) is the sign digit (not used in circular mode).
Output Pattern	DM word m+14 (Range #0) Each bit corresponds to the output of the same number. Each output whose bit is ON will be turned ON (set to 1) when the counter value is within range. An output may not be activated, however, if the range is too narrow in comparison to the frequency of the pulse input. All outputs are sent to the IR area word n+9. Outputs #0 through #7 are also sent to outputs 0 through 7 of the external connector when bit 02 of word n is ON.

4-2-3 IR Area Settings

The IR area contains commands used to operate the Counter Unit and flags used to monitor its operation. Both of these are used in programming the desired counter operations.

START Command

Word n, bit 00

Counting starts on rising edge of the START command bit and stops on the falling edge. The current counter value and output pattern immediately before stopping are retained. An exception to this, however, is when the output force bits are used (see below).

ENABLE OUTPUT Command

Word n, bit 02

Set this bit to enable external output of outputs #0 through #7. The status of the outputs are indicated by LEDs 0 through 7 when the outputs are enabled. Word n+9 status is output regardless of the status of ENABLE OUTPUT.

ENABLE FORCED OUTPUT Command

Word n, bit 07

Setting this command bit enables usage of the output force bits in word n, bits 08 through 15.

Output Force Bits

Word n, bits 15 through 08

Output force bits can be set to turn ON outputs #0 through #7, thereby permitting wiring checks. Both ENABLE OUTPUT and ENABLE FORCED OUTPUT must be ON to use the output force bits. The following procedure is used.

- 1, 2, 3...
1. Make sure START is OFF.
 2. Set ENABLE OUTPUT.
 3. Make sure all output force bits are OFF.
 4. Set ENABLE FORCED OUTPUT.
 5. Set the required output force bits.

Refer to 4-2-1 *Data Allocation* for the specific bit allocations.

Range Enable Bits

Word n+1

Range enable bits are turned ON to enable and turned OFF to disable outputs within the specified range. The number of the bit in word n+1 is the same as the number of the range it enables. The ranges that are currently effective are indicated in DM word m+1. The settings of the currently effective bits will be changed to those specified by the range enable bits when CHANGE RANGES is set.

CHANGE RANGES Command

Word n, bit 04

Set this command bit to change the effective ranges designated in DM word m+1 to correspond to the settings of the range enable bits.

CHANGE RANGES is effective during counter operation.

RESET COUNTER Command

Word n, bit 06

RESET COUNTER is effective when the internal reset bit is designated with back panel DIP switch settings (refer to 2-1 *Switch Settings*). RESET COUNTER can be combined with input Z and control input IN1 or resetting is possible using only input Z and/or control input IN1. Refer to 3-3 *Counter Reset Conditions* for details. Resetting returns the counter value to 0 and turns OFF all outputs.

TRANSFER DATA Command

Word n, bit 01

TRANSFER DATA can be set to change output ranges or, if the first word being transferred contains FF, it can be set to preset or change the current counter value. Data in the proper format must be prepared in consecutive words in the PC through the PC program or the Programming Console. The parameters described below are required to transfer data. These are followed by explanations of the data format used to prepare data in the PC data area and application examples of TRANSFER DATA for transferring range parameters and counter value. Data transfer is initiated on the rising edge of TRANSFER DATA and is completed at the next I/O refresh. Completion can be confirmed with the transfer completed flag, bit 04 of word n+4. Transfer should be executed only when the Counter Unit is not counting. Execution during counting may cause incorrect outputs.

**TRANSFER DATA
Beginning Word Number**

Word n+2
Indicates the first PC word from which data is to be transferred.

TRANSFER DATA Area

Word n+3, bits 03 through 00
Set to between 0 and 4.
Specifies the PC data area from which data is to be transferred.
Specifications are as follows:

Setting	Data area
0	DM
1	IR
2	LR
3	HR
4	AR

Note Use only the following words in the DM and IR areas: DM 0000 to DM 1999 and IR 000 to IR 235. Although the C200HS provides larger areas, if any words not within the specified ranges are used, an error will occur and an error code of 34 will be output.

Number of Transfers

Word n+3, bits 15 through 08
Set to between 1 and 3.
When changing range parameters, data for up to three ranges can be transferred at the same time. When transferring the counter value, only one value can be transferred at a time.

PC Data Format

Six consecutive words are used as the source of a data transfer. These words must all be in the same data area. If data is transferred for more than one range, the six words for each following transfer must continue consecutively on from the last word for the first transfer. Bits 07 through 00 of the first PC word actually designate either the range number for which data is to be transferred or, if the bits contain FF, they specify that a counter value is to be transferred.

If range parameters are being transferred, the remaining five words contain the lower limit, upper limit, and output pattern for the specified range in the same format that this data is contained in the DM area. If, for example, range #0 parameters were being transferred, the second and third PC words would replace parameters in DM words m+10 and m+11, i.e., the lower limit for range #0.

If a counter value is being transferred, the second and third PC words contain the counter value in the same format that it is held in words n+6 and n+7, and the last three words are ignored. More efficient use of PC words is possible, however, when preparing more than one counter value for transfer. To do this, input FF into

the first and then every third word and input the counter values into the two words after each word containing FF. The last counter value must be followed by three unused words to satisfy the requirement for six words for the last counter value. This setup is shown on the next page for three counter values, with the first PC word indicated by k. Words k, k+3, and k+6 can then be designated individually to set the counter value as required.

PC Word	Contents
k	FF
k+1 and k+2	Counter value 1
k+3	FF
k+4 and k+5	Counter value 2
k+6	FF
k+7 and k+8	Counter value 3
k+9 through k+11	Ignored


**Application Example 1:
Transferring Range
Parameters**

The following example shows use of TRANSFER DATA to transfer the upper limit, lower limit, and output pattern for three ranges. The system configuration consists of a Counter Unit (unit #0) on a C200H PC and an Input Unit allocated word 00. The Input Unit is connected to two switches: SW1, which is programmed to START (00000), and SW2, which is programmed to TRANSFER DATA (00001).

Procedure

- 1, 2, 3... 1. The range parameters are input into the DM area in a section not normally used by Special I/O Units, starting at DM word 1900 and running through DM word 1905. Parameters for a second range are input starting at DM word 1906 and run through DM word 1911. A third range is input into DM words 1912 through 1917.
2. The beginning word for transfer, the data area, and the number of transfers is set through the program, which is written to move the beginning word, 1900, into IR word 102 and the number of words and data area, 03 for bits 15 through 08 and 00 for bits 07 through 00, into IR word 103.

Program

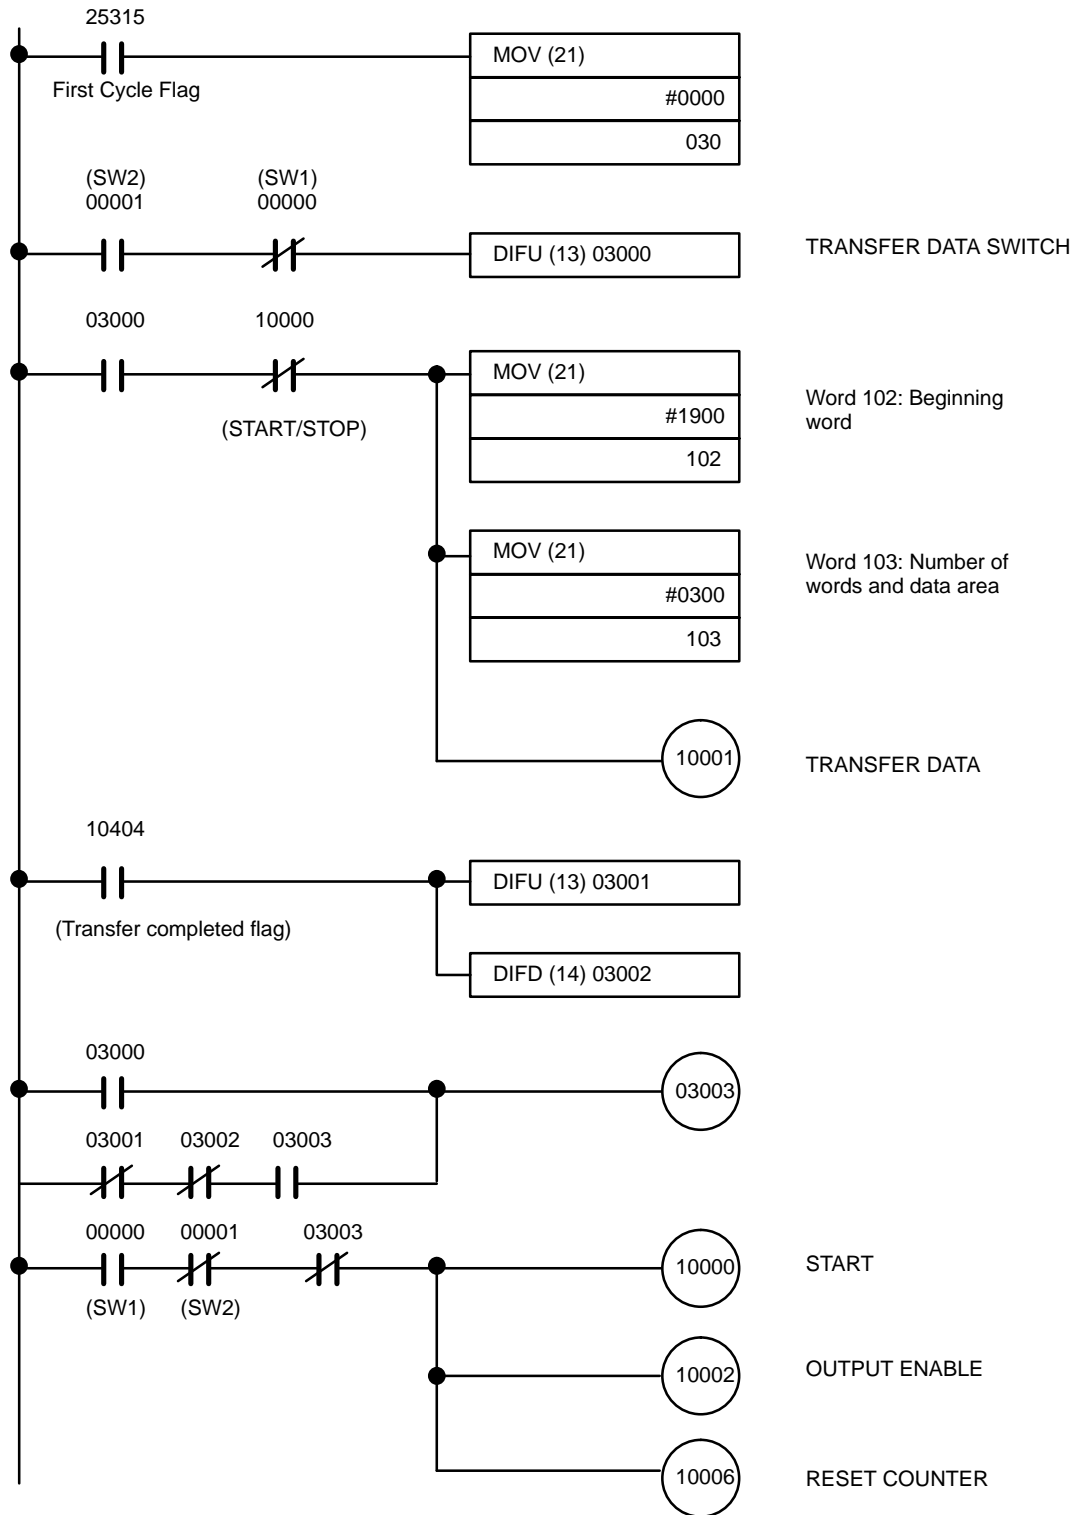

**Application Example 2:
Transferring the Counter
Value**


The following example shows use of TRANSFER DATA to transfer the counter value. The system configuration consists of a Counter Unit (unit #1) on a C200H PC and three Input Units allocated words 00, 03, and 04. One Input Unit is connected to two switches: SW1, which is programmed to START (00000), and SW2, which is programmed to TRANSFER DATA (00001). Each of the other Input Units is connected to a rotary switch: the switch connected to the Input Unit allocated word 03 is used to input the rightmost four

digits of the counter value, the switch connected to the Input Unit allocated word 04 is used to input the sign digit and the leftmost four digits of the counter value.

Procedure

- 1, 2, 3... 1. The desired counter value is input with the rotary switches as I/O words 3 and 4.
2. The beginning word for transfer, the data area, and the number of transfers is set through the program, which is written to move the beginning word, 0002, into IR word 112 and the number of transfers and data area, 01 for bits 15 through 08 and 01 for bits 07 through 00, into IR word 113. The program is also used to input "FF" into the first word to indicate transfer of a counter value.

Program

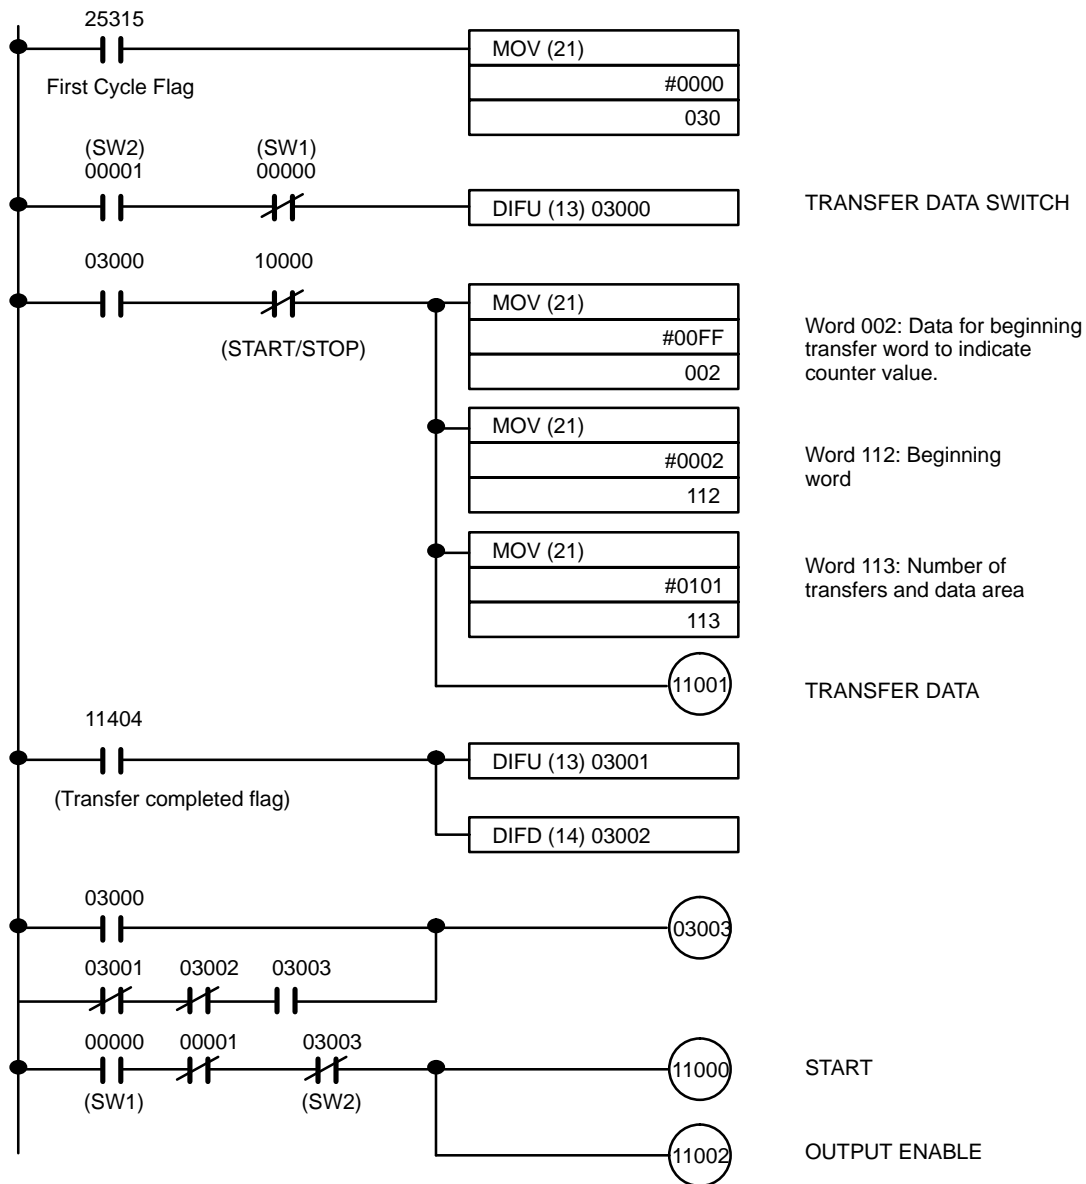

Counting Flag

Word n+4, bit 00

The counting flag is ON whenever the Counter Unit is counting. The RUN indicator will also be lit.

Z Flag	<p>Word n+4, bit 01</p> <p>The Z flag indicates the status of input Z. When the flag is ON, the input is high; when the flag is OFF, the input is low. This flag can be accessed during counting.</p> <p>Note The Z flag may not turn ON if the Z phase pulse width is less than or equal to the C200H/C200HS cycle time +3 ms.</p>
IN1 Flag	<p>Word n+4, bit 02</p> <p>The IN1 flag indicates the status of control input IN1. When the flag is ON, the input is high; when the flag is OFF, the input is low. This flag can be accessed during counting.</p>
IN2 Flag	<p>Word n+4, bit 03</p> <p>The IN2 flag indicates the status of control input IN2. When the flag is ON, the input is high; when the flag is OFF, the input is low. This flag can be accessed during counting.</p>
Transfer Completed Flag	<p>Word n+4, bit 04</p> <p>The transfer completed flag is inverted following completion of TRANSFER DATA.</p>
Error Flag	<p>Word n+4, bit 05</p> <p>The error flag is turned ON whenever an error has occurred. Information on the type and location of the error is available in IR word n+5 upon execution of READ ERROR.</p>
READ ERROR Command	<p>Word n, bit 05</p> <p>READ ERROR can be set to access information on the error whenever the error flag is ON. Error information is output to IR word n+5. If more than one error has occurred, information on other errors can be output to IR word n+5 by again setting READ ERROR. The next error will be output each time this bit is turned ON.</p>
Error Location	<p>Word n+5, bit 07 through 00</p> <p>The error location gives the rightmost two digits of the DM address, i.e., the word number, where the data causing the error is stored.</p>
Error Code	<p>Word n+5, bit 15 through 08</p> <p>Error codes indicate the nature of the error and are given in <i>Appendix A Error Code List</i>.</p>
Count Overflow Flag	<p>Word n+4, bit 06</p> <p>The count overflow flag is turned ON when the counter value is greater than 8,388,607 or less than -8,388,608. This flag turns OFF when the next operation is started.</p>
Reset Flag	<p>Word n+4, bit 07</p> <p>The reset flag turns ON for one PC cycle time after the Counter Unit is reset.</p>
Current Counter Value	<p>Word n+6 and n+7</p> <p>The current counter value is accessible in words n+6 and n+7 as 6 BCD digits with a sign digit.</p>
Range Flags	<p>Word n+8</p> <p>The number of each bit in IR word n+8 corresponds to a range number. A range flag is ON whenever the current counter value is within the specified range.</p>


Output Flags

Word n+9

The number of each bit in IR word n+9 corresponds to an output number. An output flag is ON whenever the specified output is ON. Output flags are turned ON regardless of the status of ENABLE OUTPUT.

4-2-4 Timing Chart


The following chart shows timing relationships between the command bits (input bits) and output bits in linear and circular mode.

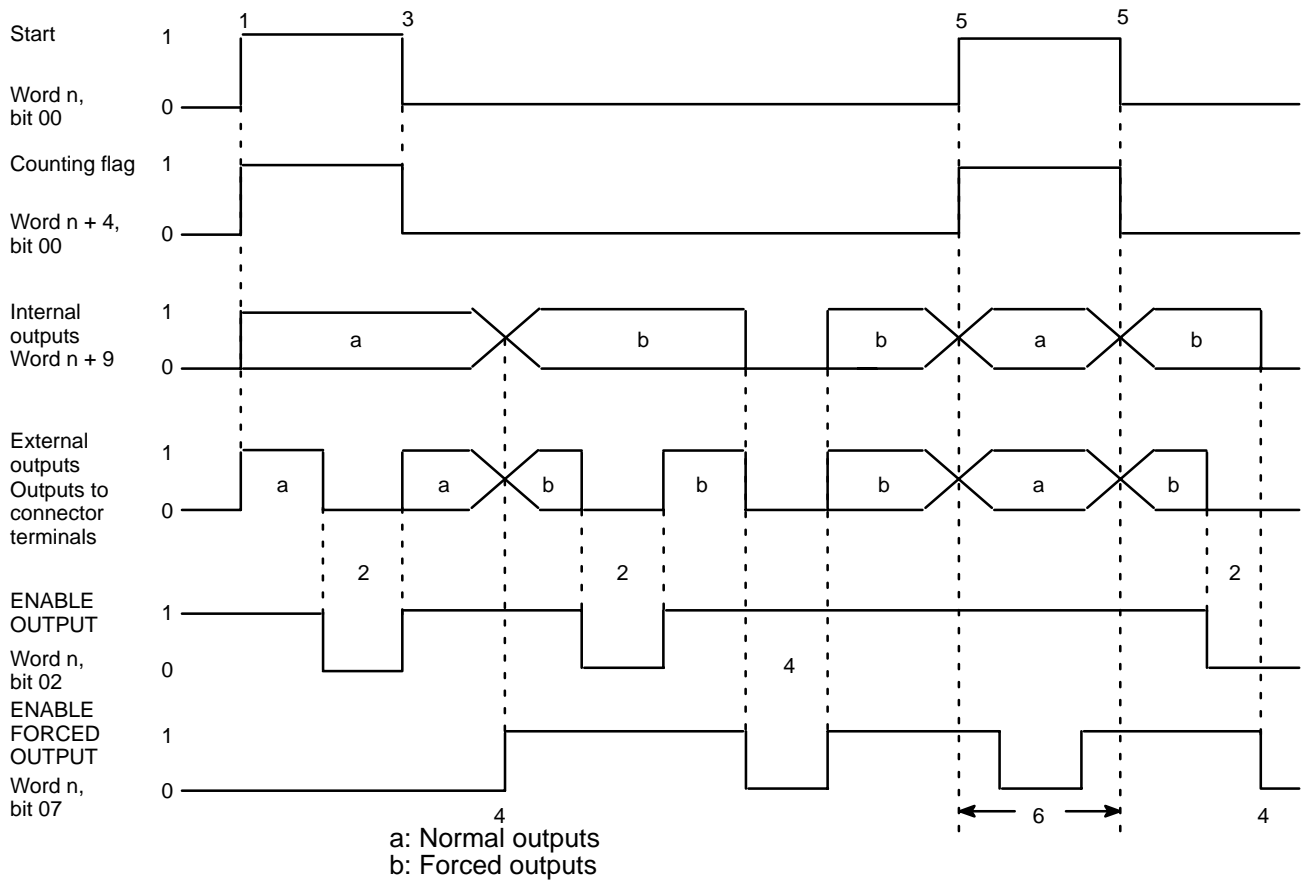

- 1, 2, 3...
1. START is effective on the rising edge.
 2. External outputs are prohibited when ENABLE OUTPUT is OFF.
 3. The Counter Units stops counting on the falling edge of START. Status of internal and external outputs are retained.
 4. The status of the output force bits is output when ENABLE FORCED OUTPUT is ON. All outputs are reset when ENABLE FORCED OUTPUT goes OFF.
 5. Setting START during counting returns all outputs to normal status, i.e., makes ENABLE FORCED OUTPUT ineffective. The status of output force bits is then restored when STOP goes OFF.
 6. ENABLE FORCED OUTPUT is ineffective while START is ON.

4-2-5 Application Examples

Linear Operating Mode: Controlling Conveyor Processing System Configuration

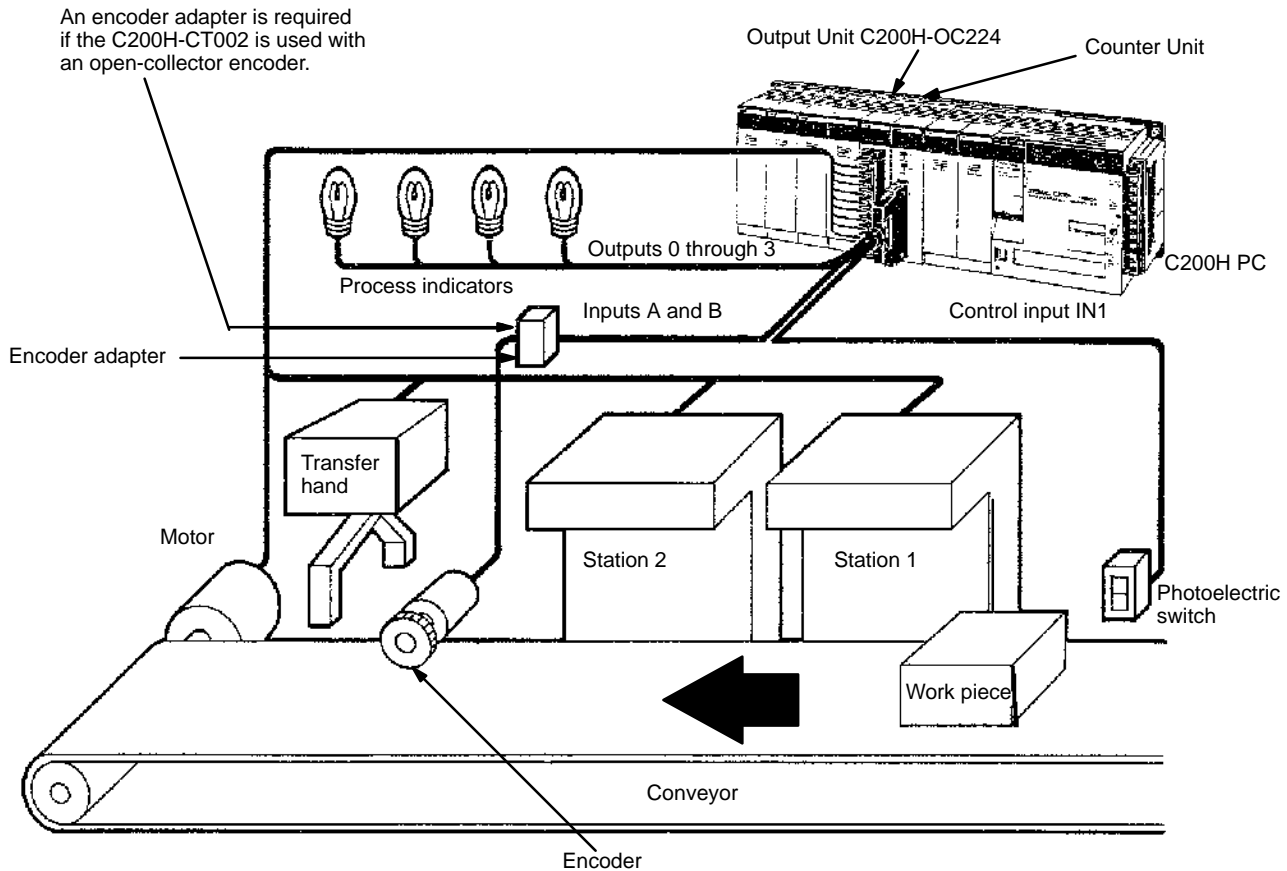

Operation

This example system detects the position of the work piece on the conveyor by means of the pulse input from the encoder and processes the work piece at the required positions.

- 1, 2, 3...**
1. The photoelectric switch detects that the work piece is loaded on the conveyor belt from a transfer conveyor, and the counter value is reset.
 2. The counter value is used to control processing at each station.
 3. The PC controls the motor operation and drives the transfer hand.

Switch Settings

In this example, the unit number selector and the mode selector are both set to 1. Pins 6 and 7 are turned ON on the back panel DIP switch to designate offset phase inputs with no input multiplier and to make control input IN1 effective on its rising edge. All other pins on the DIP switch are turned OFF.

Wiring

- 1, 2, 3...**
1. Connect the output from the photoelectric switch to control input IN1.
 2. Connect encoder outputs to the inputs A and B.
 3. Connect outputs 0 through 3 to the process indicators.
 4. Connect the Output Unit to the motor and the transfer hand.

DM Area Settings

DM 1100	0	1	0	0
DM 1101	0	0	0	F

Sets the mode to 1 (linear).
Enables ranges #0, #1, #2, and #3.

DM 1110	1	0	0	0
DM 1111	0	0	0	0
DM 1112	1	2	0	0
DM 1113	0	0	0	0
DM 1114	0	0	0	1
DM 1115	2	5	0	0
DM 1116	0	0	0	0
DM 1117	2	9	0	0
DM 1118	0	0	0	0
DM 1119	0	1	0	2
DM 1120	5	0	0	0
DM 1121	0	0	0	0
DM 1122	9	5	0	0
DM 1123	0	0	0	0
DM 1124	0	2	0	4
DM 1125	9	5	0	1
DM 1126	0	0	0	0
DM 1127	8	6	0	7
DM 1128	0	8	3	8
DM 1129	0	3	0	8


Range #0 (work piece at station 1)
Lower limit: 1000; upper limit: 1200
Output pattern specifies that output #0 be turned ON when the counter value is within range #0

Range #1 (work piece at station 2)
Lower limit: 2500; upper limit: 2900
Output pattern specifies that outputs #1 and #8 be turned ON when the counter value is within range #1

Range #2 (work piece at transfer point)
Lower limit: 5000; upper limit: 9500
Output pattern specifies that outputs #2 and #9 be turned ON when the counter value is within range #2.


Range #3 (work piece passed through transfer point)
Lower limit: 9501; upper limit: 8,388,607
Output pattern specifies that outputs #3 and #10 be turned ON when the counter value is within range #3.

Program

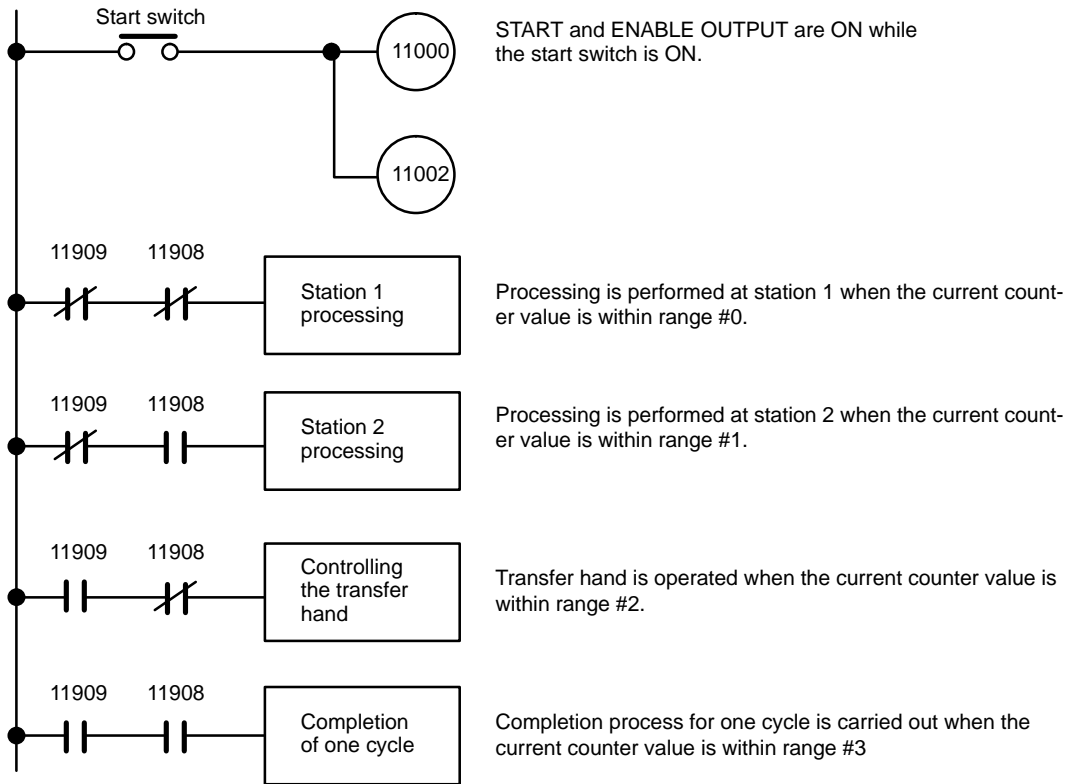


Internal outputs 11908 and 11909 are used to control position-dependent processing. Process indicators are turned ON and OFF directly through outputs #0 through #3. Internal outputs are turned ON/OFF through ranges #0 through #3. These outputs indicate the position of the work piece, and required processing is carried out accordingly.

Range flags can also be used for programming, as shown below.

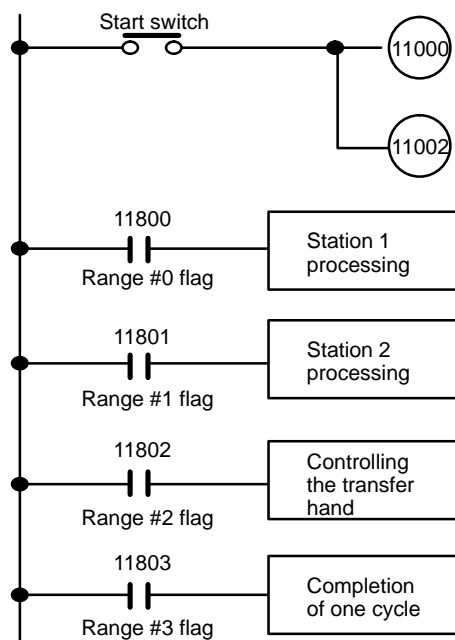

Circular Operating Mode: Functioning as Mechanical Cam Switches System Configuration

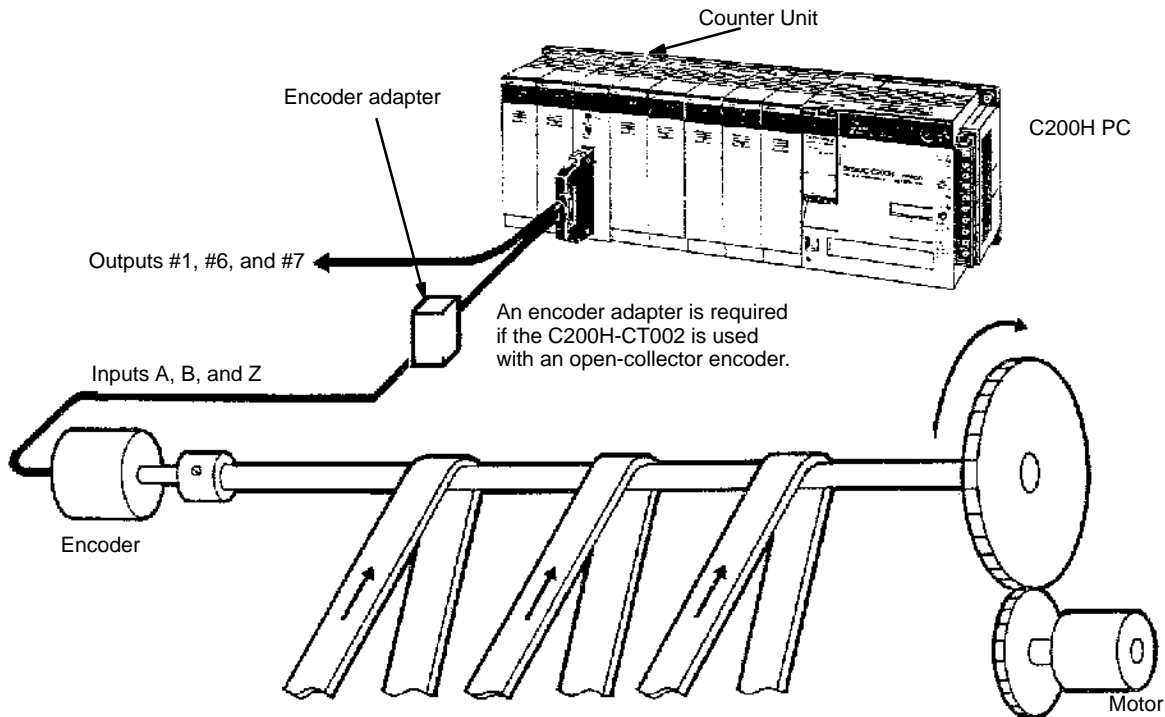

Operation

This example system uses the encoder to detect control timing for devices linked to a shaft driven by a motor. The system controls outputs according to shaft rotation.

Switch Settings

In this example, the unit number selector is set to 1 and the mode selector is set to 2. Pins 2, 4, 6, and 8 are turned ON on the back panel DIP switch to designate offset phase inputs with a x 4 input multiplier and to enable resetting on the rising edge of input Z or RESET COUNTER, whichever is set last (both must be ON to reset the Counter Unit). All other pins are turned OFF.


Wiring

- 1, 2, 3... 1. Connect encoder outputs to inputs A, B, and Z.
2. Connect outputs #1, #6, and #7 to controllers for devices linked to the shaft.

DM Area Settings

DM 1100	0	2	0	0	Sets the mode to 1 (linear). Enables ranges #0, #1, #2, and #3.
DM 1101	0	0	0	7	
DM 1102	4	9	9	9	
DM 1103	0	0	0	0	
⋮					
DM 1110	1	0	0	0	Range #0 (work piece at station 1) Lower limit: 1000; upper limit: 1010 Output pattern specifies that output #7 be turned ON when the counter value is within range #0
DM 1111	0	0	0	0	
DM 1112	1	0	1	0	
DM 1113	0	0	0	0	
DM 1114	0	0	8	0	Range #1 (work piece at station 2) Lower limit: 4300; upper limit: 200 (0 is spanned) Output pattern specifies that outputs #1 and #6 be turned ON when the counter value is within range #1
DM 1115	4	3	0	0	
DM 1116	0	0	0	0	
DM 1117	0	2	0	0	
DM 1118	0	0	0	0	Range #2 (work piece at transfer point) Lower limit: 600; upper limit: 3100 Output pattern specifies that outputs #6 and #7 be turned ON when the counter value is within range #2.
DM 1119	0	0	4	2	
DM 1120	0	6	0	0	
DM 1121	0	0	0	0	
DM 1122	3	1	0	0	
DM 1123	0	0	0	0	
DM 1124	0	0	C	0	

Program

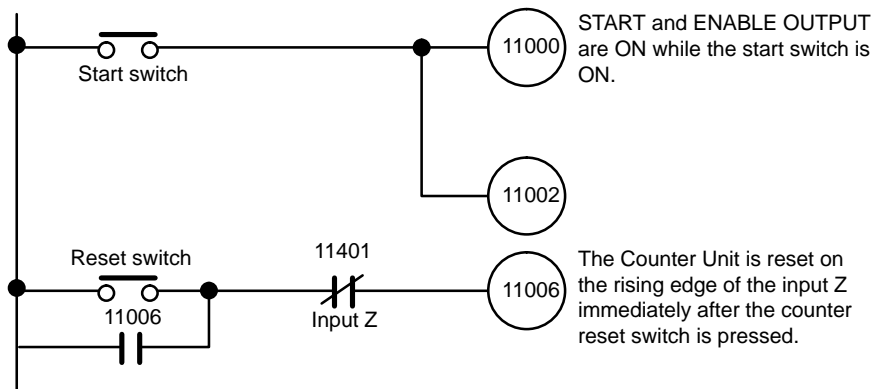

Outputs #1, #6, and #7 are directly output from the Counter Unit.

4-3 Preset Mode

In preset mode counter values are decremented (or incremented) according to any of the three types of input pulses. When the start signal is set, the counter value begins from a specified, preset value (maximum: 8,388,607). Up to 20 counter values can be preset. These presets can be updated from the PC six at a time by using TRANSFER DATA.

Eight outputs are available that can be output to the PC and/or externally, i.e., directly to an external device. The first output (#0) turns ON when counting is started and turns OFF at a specified counter value. The next two outputs (#1 and #2) turn ON and OFF at specified counter values. The last four outputs (#4 through #7, output #3 is not used in preset mode) turn ON for either a specified length of time or indefinitely following the countdown. The counter values at which outputs turn ON and/or OFF cannot be changed during operation.

Although control input IN1 is supported as a reset input, control input IN2 and input Z are not used.

Note that, because the counter is designed to count down in preset mode, the encoder input should be set accordingly.

The START command (word n, bit 00) is used to start and stop (i.e., as the start signal) the Counter Unit when pin 4 on the back-panel DIP switch is turned OFF. Control input IN2 is used to start and stop the Counter Unit when pin 4 is ON.

4-3-1 Data Allocation

DM Area

The DM area contains the user-input parameters that are to be set into the Counter Unit, including the operating mode and ON/OFF counter value. The first DM word for each Counter Unit is indicated by m and equals 1,000 plus 100 times the unit number.

Word	Bit	Function
m	07 through 00	Set to 0.
	11 through 08	Operating mode (Here, 3: preset)
	15 through 12	Set to 0.
m+1	15 through 00	OFF counter value for output #0, 7 digits
m+2	11 through 00	
	15 through 12	Set to 0.
m+3	15 through 00	ON counter value for output #1, 7 digits
m+4	11 through 00	
	15 through 12	Set to 0.
m+5	15 through 00	OFF counter value for output #1, 7 digits
m+6	11 through 00	
	15 through 12	Set to 0.
m+7	15 through 00	ON counter value for output #2, 7 digits
m+8	11 through 00	
	15 through 12	Set to 0.
m+9	15 through 00	OFF counter value for output #2, 7 digits
m+10	11 through 00	
	15 through 12	Set to 0.
m+11	15 through 00	ON time for outputs #4 through #7, 4 digits (unit: 0.01 s) Output will remain on until next the start signal if FFFF is input.
m+12 m+13		Not used.
m+14	15 through 00	Preset #0, 6 digits

Word	Bit	Function
m+15	11 through 00	
	15 through 12	Output pattern #0 (for preset #0); Bit 12: output #4 Bit 13: output #5 Bit 14: output #6 Bit 15: output #7

Word	Function
m+16 m+17	Preset #1 and output pattern #1
m+18 m+19	Preset #2 and output pattern #2
m+20 m+21	Preset #3 and output pattern #3
m+22 m+23	Preset #4 and output pattern #4
m+24 m+25	Preset #5 and output pattern #5
m+26 m+27	Preset #6 and output pattern #6
m+28 m+29	Preset #7 and output pattern #7
m+30 m+31	Preset #8 and output pattern #8
m+32 m+33	Preset #9 and output pattern #9
m+34 m+35	Preset #10 and output pattern #10

Word	Function
m+36 m+37	Preset #11 and output pattern #11
m+38 m+39	Preset #12 and output pattern #12
m+40 m+41	Preset #13 and output pattern #13
m+42 m+43	Preset #14 and output pattern #14
m+44 m+45	Preset #15 and output pattern #15
m+46 m+47	Preset #16 and output pattern #16
m+48 m+49	Preset #17 and output pattern #17
m+50 m+51	Preset #18 and output pattern #18
m+52 m+53	Preset #19 and output pattern #19
m+54 to m+99	Not used.

IR Area

The IR area contains commands and status information. Inputs and outputs are given in reference to the PC, i.e., output data is sent from the PC to the Counter Unit; input data, from the Counter Unit to the PC. The first IR word for each Counter Unit is indicated by n and equals 100 plus 10 times the unit number.

Outputs

Word	Bit	Function
n	00	START command (The START command is effective only when pin 4 on the back-panel DIP switch is turned OFF. If pin 4 is ON, control input IN2 is used to start and stop the Counter Unit.)
	01	TRANSFER DATA command
	02	ENABLE OUTPUT command
	03	Not used.
	04	CHANGE PRESET command
	05	READ ERROR command
	06	RESET COUNTER command
	07	ENABLE FORCED OUTPUT command
	08	Output #0 force bit
	09	Output #1 force bit
	10	Output #2 force bit
	11	Output #3 force bit
	12	Output #4 force bit
	13	Output #5 force bit
	14	Output #6 force bit
15	Output #7 force bit	
n+1	07–04	Not used.
	15–08	Preset number, 2 digits, between 00 and 19
n+2	15–00	TRANSFER DATA beginning word number, 4 digits
n+3	03–00	TRANSFER DATA data area, 0 through 4
	07–04	Not used. (Set to 0.)
	15–08	Number of transfers, 1 through 3

Inputs

Word	Bit	Function
n+4	00	Counting flag
	01	Not used.
	02	IN1 flag
	03	Not used.
	04	Transfer completed flag.
	05	Error flag
	06	Count overflow flag
	07	Reset flag
	08	Output #0 flag (external output possible)
	09	Output #1 flag (external output possible)
	10	Output #2 flag (external output possible)
	11	Output #3 flag (external output possible)
	12	Output #4 flag (external output possible)
	13	Output #5 flag (external output possible)
	14	Output #6 flag (external output possible)
15	Output #7 flag (external output possible)	
n+5	07–00	Error location
	15–08	Error code
n+6	15–00	Current counter value, 6 digits with sign (sign digit always 0, i.e., "+")(0 to 8,388,6077)
n+7	15–00	
n+8	07–00	Not used.
	15–08	Current present counter number.
n+9		Not used.

4-3-2 DM Area Settings

Operating Mode

DM word m, bits 11 through 08

The operating mode is set with the mode selector on the front panel. Refer to *1-4 Operating Modes* for an overview of available modes.

Presets

DM words m+14 through m+53

Two words are used to hold each preset counter value from #0 though #19. A counter value between 1 and 8,388,607 must be input for each preset used. The number of the currently effective preset is set in the IR area. Clear all unused presets to 0 to avoid error messages. Words m+54 through m+99 do not need to be cleared.

Output Patterns

Each preset contains an output pattern that designates which outputs are to be turned ON after countdown. All outputs whose bits are ON are output upon completion of the countdown when the relevant preset counter value is used. The output pattern is held in bits 12 through 15 of the higher of the two words used for each preset. Bits correspond to outputs as follows:


- Bit 12: output 4
- Bit 13: output 5
- Bit 14: output 6
- Bit 15: output 7

**ON/OFF Counter Values
ON Time**

DM words m+1 through m+11

Outputs #0 through #2 turn ON and OFF according to the counter values set in DM words m+1 through m+10. The only exception is that output #0 turns ON at the beginning of the countdown. The diagram below illustrates this situation. Each of the counter values must be set between 0 and 8,388,607.

The ON time sets the length of time that outputs #4 through #7 remain ON after completion of the countdown when they are designated in the relevant output pattern. The setting value must either be between 0 and 99.99 (decimal not input) or it must be "FFFF", in which case the designated outputs will remain ON until the start signal is turned ON again.

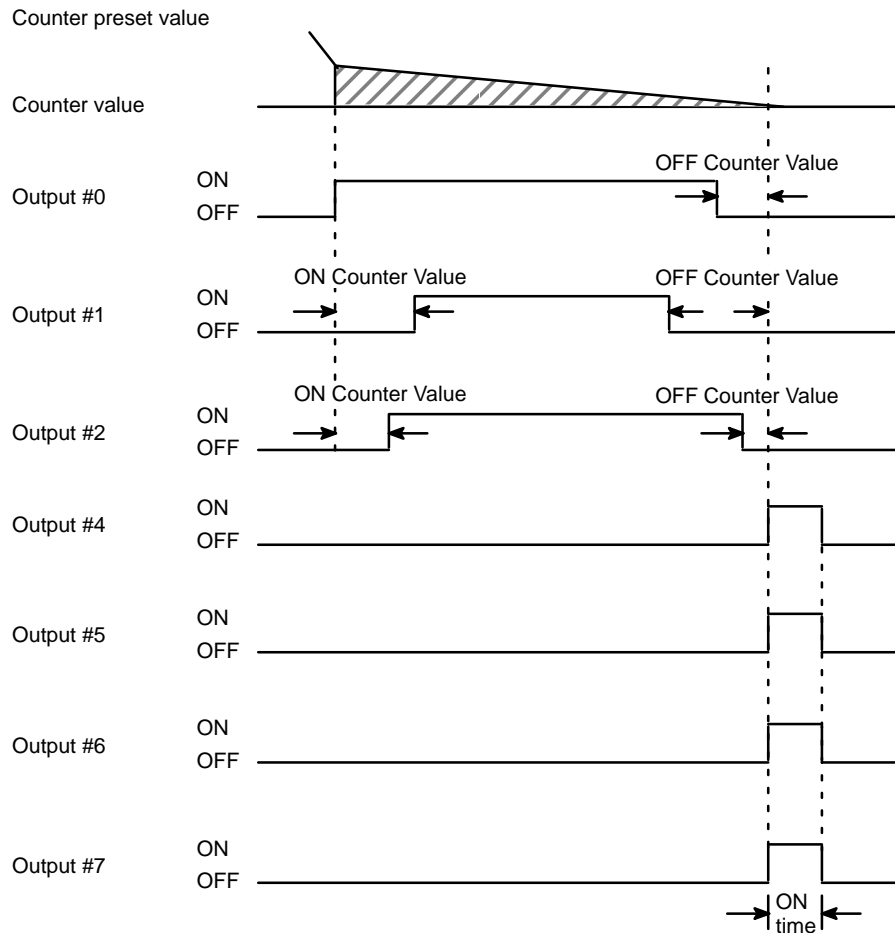

4-3-3 IR Area Settings

The IR area contains commands used to operate the Counter Unit and flags used to monitor its operation. Both of those are used in programming the desired counter operations.

START Command

Word n, bit 00

The countdown begins on the rising edge of the START command bit according to parameters from DM area. Note that the countdown will begin with preset #0 unless CHANGE PRESET is ON to designate the number of another preset.

The START command is effective only when pin 4 on the back-panel DIP switch is turned OFF. If pin 4 is ON, control input IN2 is used to start and stop the Counter Unit.

**ENABLE OUTPUT
Command**

Word n, bit 02

Set this bit to enable external output of outputs #0 through #7. The status of the outputs is shown on indicators 0 through 7 when outputs are enabled. Word n+9 status is output regardless of the condition of ENABLE OUTPUT.

ENABLE FORCED OUTPUT Command	Word n, bit 07 Setting this command bit enables usage of the output force bits in word n (bits 08 through 15).
Output Force Bits	Word n, bits 15 through 08 Output force bits can be set to turn ON outputs #0 through #7, thereby permitting wiring checks. Both the ENABLE OUTPUT command bit and the ENABLE FORCED OUTPUT command bit must be ON to use the output force bits. The following procedure is used. 1, 2, 3... <ol style="list-style-type: none"> 1. Make sure the start signal is OFF. 2. Set ENABLE OUTPUT. 3. Make sure all output force bits are OFF. 4. Set ENABLE FORCED OUTPUT. 5. Set the required output force bits. Refer to 4-3-1 <i>Data Allocation</i> for the specific bit allocations.
CHANGE PRESET	Word n, bit 04 CHANGE PRESET is set to designate any preset other than #0. If CHANGE PRESET is OFF when the start signal is set, the countdown will begin from the value designated by preset #0, regardless of the contents of the preset designated by the preset number.
Preset Number	Word n+1, bits 15 through 08 The preset number is set to designate a preset counter value other than preset #0. The number set in bits 15 through 08 is effective only when CHANGE PRESET is turned ON before the start signal is turned ON.
PRESET COUNTER Command	Word n, bit 06 RESET COUNTER is effective when the internal reset bit is designated with back panel DIP switch settings (Refer to 2-1 <i>Switch Settings</i>). RESET COUNTER can be combined with control input IN1 or resetting is possible using only control input IN1. Refer to 3-3 <i>Counter Reset Conditions</i> for details. Resetting returns the counter value to 0 and turns OFF all outputs.
TRANSFER DATA Command	Word n, bit 01 TRANSFER DATA can be set to transfer up to 6 preset counter values to replace any of presets #0 through #19. The new presets can then be used for countdown. Data in the proper format must be prepared in consecutive words in the PC through the PC program or the Programming Console. The parameters described below are required to transfer data. These are followed by explanations of the data format used to prepare data in the PC data area. Data transfer is initiated on the rising edge of TRANSFER DATA and is completed at the next I/O refresh. Completion can be confirmed with the transfer completed flag, bit 04 of word n+4. Transfer should be executed only when the Counter Unit is not counting. Execution during counting may cause incorrect outputs.
TRANSFER DATA Beginning Word Number	Word n+2 Indicates the first PC word from which data is to be transferred.
TRANSFER DATA Area	Word n+3, bits 03 through 00

Set to between 0 and 4.

Indicates the PC data area from which data is to be transferred. Indications are as follows:

Setting	Data area
0	DM
1	I/O
2	LR
3	HR
4	AR

Note Use only the following words in the DM and IR areas: DM 0000 to DM 1999 and IR 000 to IR 235. Although the C200HS provides larger areas, if any words not within the specified ranges are used, an error will occur and an error code of 34 will be output.

Number of Transfers

Word n+3, bits 15–08

Set to between 1 and 6.

Counter values can be transferred for up to 6 presets at the same time. To transfer more than 6, TRANSFER DATA must be executed a second time with different parameters.

PC Data Format

Three consecutive words are used as the source of data transfer for each preset that is being transferred. These words must all be in the same data area. If data is transferred for more than one preset, the three words for each following transfer must continue consecutively on from the last word for the first transfer. The first word designates the number of the preset whose value is contained in the following two words. The last two words contain the preset counter value and output pattern in the same format as that used in DM for the normal presets. The numbers of the presets being transferred need not be consecutive.

Counting Flag

Word n+4, bit 00

The counting flag is ON whenever the Counter Unit is counting. This flag will remain ON from when the start signal resets the counter to the preset value until the current counter value reaches 0. Even if external outputs #4 to #7 remain ON after the current counter value reaches 0, the counting flag will be OFF. The RUN indicator will be lit when the counting flag is ON.

IN1 Flag

Word n+4, bit 02

The IN1 flag indicates the status of control input IN1. When the flag is ON, the input is high; when the flag is OFF, the input is low. This flag can be accessed during counting.

Transfer Completed Flag

Word n+4, bit 04

The transfer completed flag is inverted following completion of TRANSFER DATA.

Error Flag

Word n+4, bit 05

The error flag is turned ON whenever an error has occurred. Information on the type and location of the error is available in IR word n+5 upon execution of READ ERROR.

READ ERROR Command

Word n, bit 05

READ ERROR can be set to access information on the error whenever the error flag is ON. Error information is output to IR word n+5. If more than one error has

occurred, information on other errors can be output to IR word n+5 by again setting READ ERROR.

Error Location

Word n+5, bit 07 through 00

The error location gives the rightmost two digits of the DM address, i.e., the bit number, where the data causing the error is stored.

Error Code

Word n+5, bit 15 through 08

Error codes indicate the nature of the error and are given in *Appendix A Error Code List*.

Count Overflow Flag

Word n+4, bit 06

The count overflow flag is turned ON when the counter value is incremented passed 8,388,607. This flag turns OFF when the next counting operation is started.

Reset Flag

Word n+4, bit 07

The reset flag turns ON for one PC cycle time after the Counter Unit is reset.

Current Counter Value

Word n+6 and n+7

The current counter value is accessible in words n+6 and n+7 as 6 BCD digits with a sign digit. In preset mode, the sign digit is always 0 (+).


Output Flags

Word n+4 bits, 15 through 08

Output flag bits are ON whenever the corresponding output is ON. Output flags turn ON regardless of the status of ENABLE OUTPUT (word n, bit 02). Refer to *4-3-1 Data Allocation* for specific flag bits.

4-3-4 Timing Chart

The following chart shows timing relationships between the command bits (input bits) and output bits in preset mode when the counter is reset during the count-down.

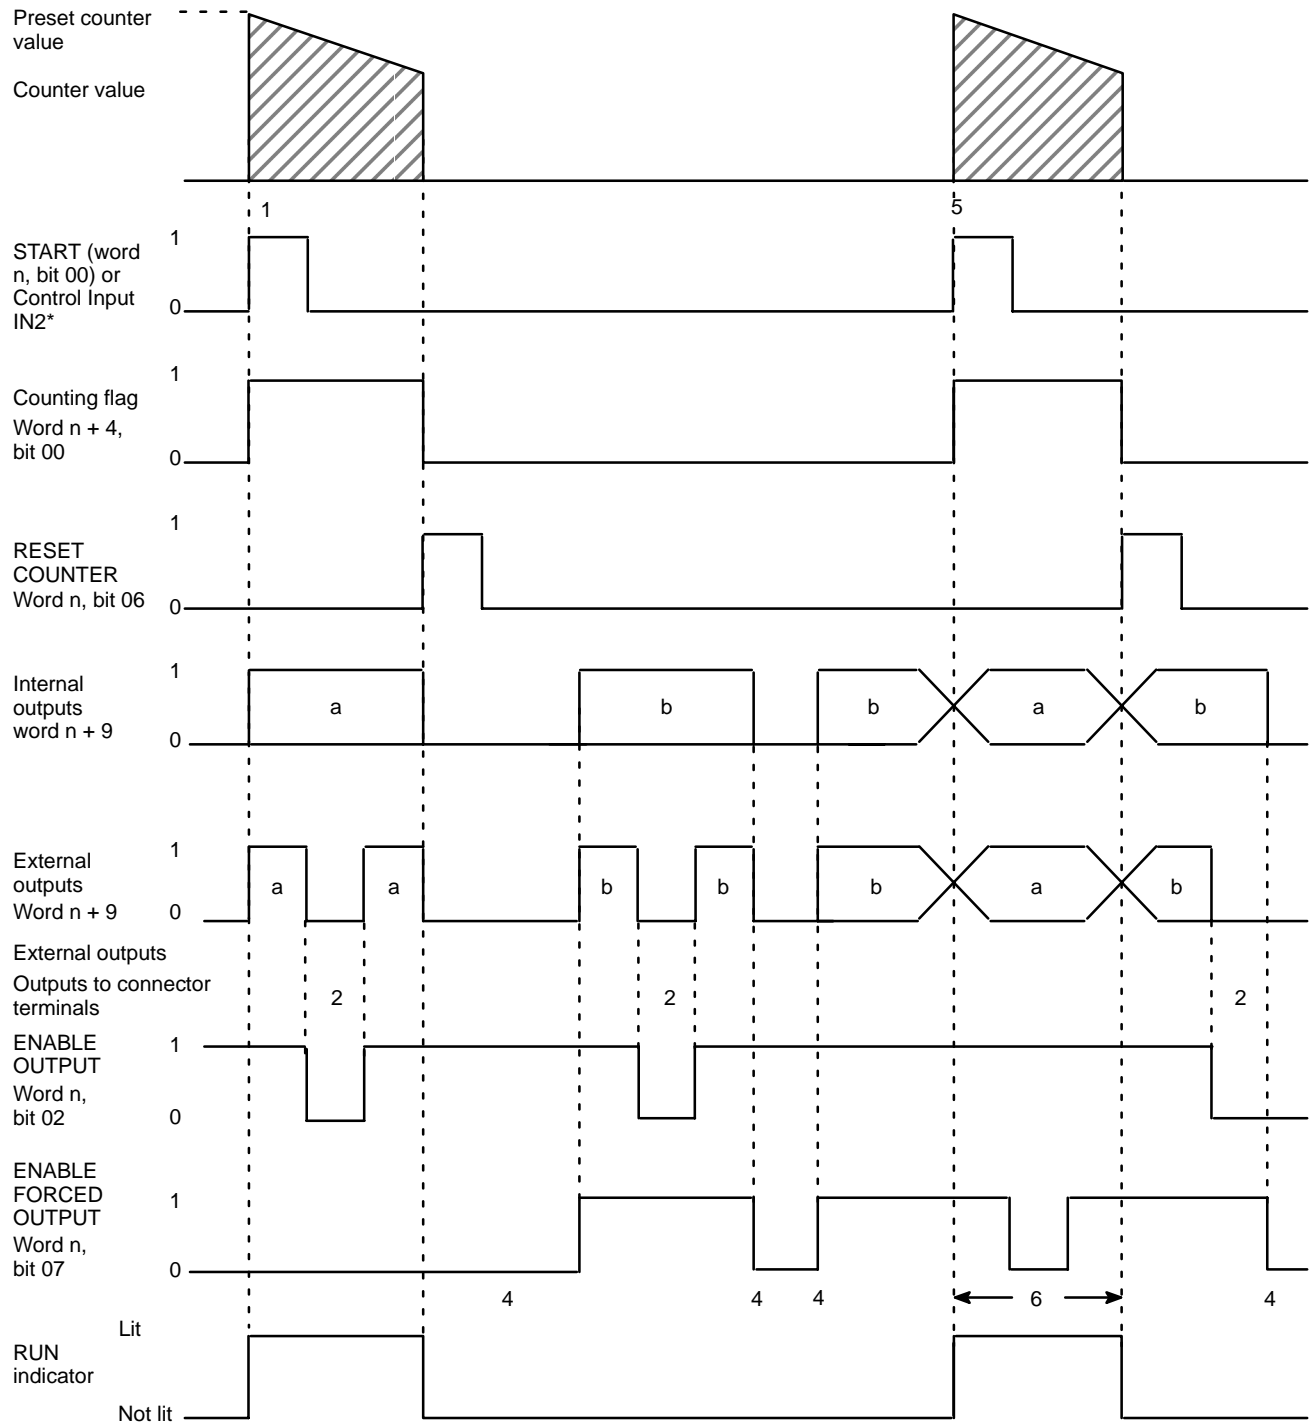

a: Normal outputs
b: Forced outputs


*Pin 4 on the back-panel DIP switch determines which start signal is used. ON: IN2; OFF: START,

- 1, 2, 3...**
1. The start signal is effective on its rising edge.
 2. External outputs are not possible while ENABLE OUTPUT is OFF. The bit does not affect internal outputs.
 3. The counter value and outputs are reset when RESET COUNTER is set.

4. Forced outputs are possible only when the counting flag is OFF.
5. Normal operation is returned to when the start signal is set during forced output.
6. Forced outputs becomes inoperative during normal operation.
7. When RESET COUNTER is set during a forced output, the external output is momentarily turned OFF, then restored to the status designated by the relevant force bit.

4-3-5 Application Example


Measuring and Cutting Rod System Configuration

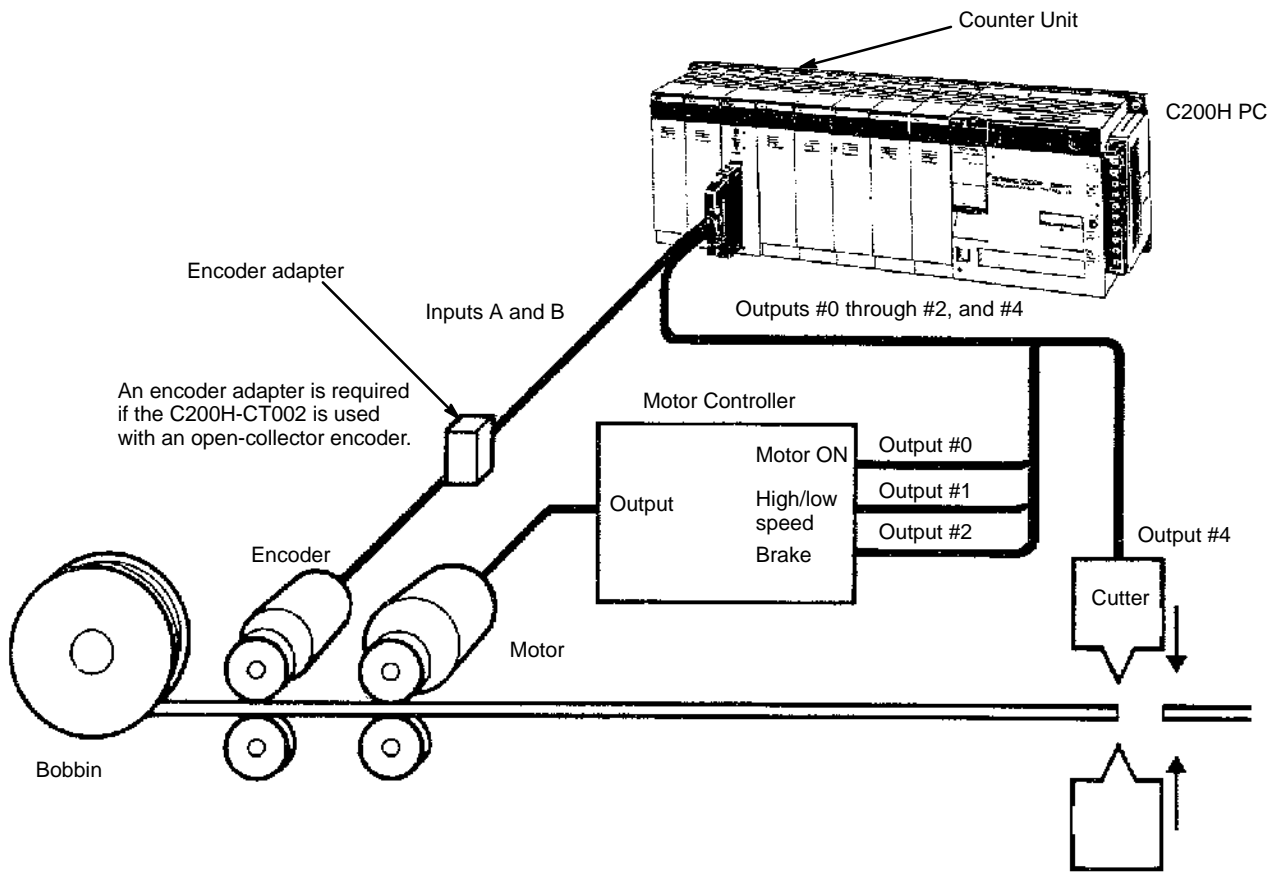

Operation

A specific length wire rod is fed in and cut using the following controlling procedure.

- 1, 2, 3... 1. The motor is started at a low speed and the brake is turned OFF.
2. The motor speed is increased.
3. The motor speed is decreased just before the designated position.
4. The motor is stopped, taking the distance the motor moves by inertia into consideration.
5. The brake is turned ON immediately before the designated position.
6. The cutter is activated at the designated position.

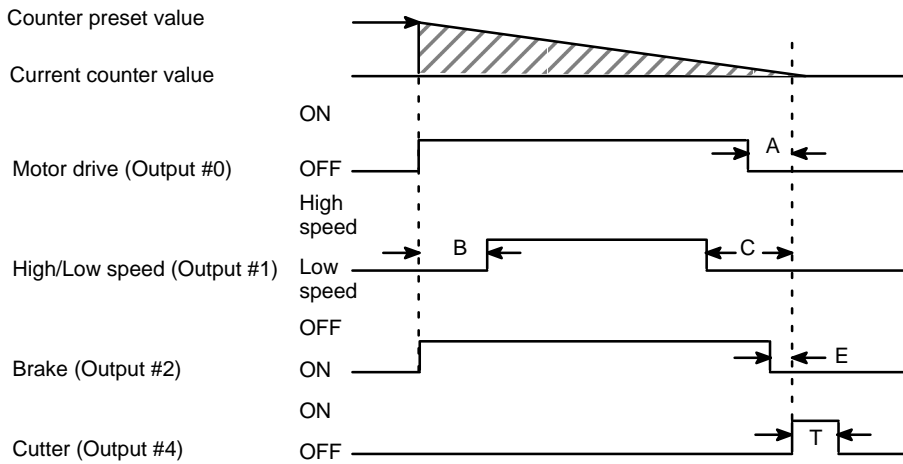

Setting example

Parameter	Setting (ms)
Present counter value	10,000
A	100
B	150
C	200
D	0
E	50
T	500

Switch Settings

In this example, the unit number switch is set to 1 and the mode switch is set to 3. Pins 3 and 8 are turned ON on the back-panel DIP switch to designate offset phase inputs with a x2 input multiplier and to enable RESET COUNTER. All other pins on the DIP switch are turned OFF.


Wiring

- 1, 2, 3... 1. Connect encoder outputs to inputs A and B.
2. Connect outputs #0, #1, and #2 to the motor controller inputs as follows:
#0: motor start switch; #1: high/low speed switch; #2: brake signal.
3. Connect output #4 to the input terminal of the cutter driver.

DM Area Settings

DM 1100	0	3	0	0	Sets mode no. 3.
DM 1101	0	1	0	0	A = 100
DM 1102	0	0	0	0	
DM 1103	0	1	5	0	B = 150
DM 1104	0	0	0	0	
DM 1105	0	2	0	0	C = 200
DM 1106	0	0	0	0	
DM 1107	0	0	0	0	D = 0
DM 1108	0	0	0	0	
DM 1109	0	0	5	0	E = 50
DM 1110	0	0	0	0	
DM 1111	0	0	5	0	T = 500 ms
DM 1112	-	-	-	-	
DM 1113	-	-	-	-	
DM 1114	0	0	0	0	Preset = 10000
DM 1115	1	0	0	1	Output #4 only

Program

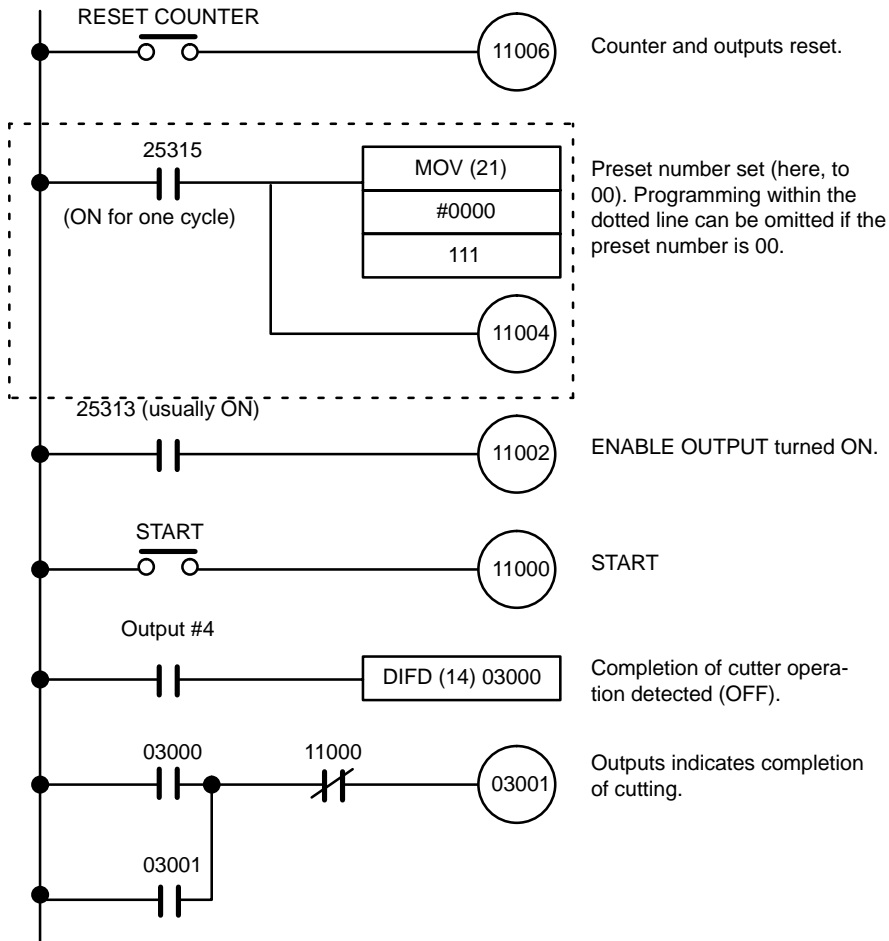

4-4 Gate, Latch, and Sampling Modes

In gate, latch, and sampling modes counter values are incremented and decremented while the count signal is ON and according to any of the three types of input pulses. All three modes permit counting between -8,388,608 and 8,388,607. All modes but cumulative gate mode use control input IN1 as the count (start) signal. The cumulative gate mode uses control input IN1 as the reset signal and control input IN2 as the count (start) signal; latch mode uses control input IN2 as the latch signal. None of these modes support external outputs. Control inputs can be designated to originate in IR bits.

4-4-1 Data Allocation

DM Area

The DM area contains the user-input parameters that are to be set into the Counter Unit. The first DM word for each Counter Unit is indicated by m and equals 1,000 plus 100 times the unit number.

Word	Bit	Function
m	07–00	Set to 0.
	11–08	Operating mode (Here, 4: gate; 5: latch; or 6: sampling)
	15–12	Set to 0.
$m+1$	03–00	Control origin 0000: External (connector input) 0001: Internal (IR area)
	07–04	Set to 0.
	11–08	Gate mode type (gate mode only) 0000: Normal 0001: Cumulative
	15–12	Set to 0.
$m+2$ through $m+99$		Not used.

IR Area

The IR area contains commands and status information. Inputs and outputs are given in reference to the PC, i.e., output data is sent from the PC to the Counter Unit; input data, from the Counter Unit to the PC. The first IR word for each Counter Unit is indicated by n and equals 100 plus 10 times the unit number.

Outputs

Word	Bit	Function
n	00	Not used.
	01	SET TIME command (sampling mode only)
	02	Not used.
	03	Internal IN1
	04	Internal IN2.
	05	READ ERROR command
	15–06	Not used.
$n+1$	15–00	Sampling time, 4 digits in ms (sampling mode only)
$n+2$ $n+9$		Not used.

Inputs

Word	Bit	Function
$n+4$	00	Counting flag.
	01	Not used.
	02	IN1 flag
	03	IN2 flag
	04	Not used.
	05	Error flag
	06	Count overflow flag.
	15–07	Not used.
$n+5$	07–00	Error location
	15–08	Error code

Word	Bit	Function
n+6	15–00	Current counter value, 6 digits with sign (–8,388,608 to 8,388,607)
n+7	15–00	
n+8 n+9		Not used

- Note**
1. The RUN indicator will be lit whenever the counting flag (word n+4, bit 00) is ON.
 2. The external control inputs IN1 and IN2 must be ON for at least as long as the PC's cycle time to ensure that they can be accurately read from the PC.

4-4-2 DM Area Settings

Operating Mode

DM word m, bits 11 through 08

The operating mode is set with the mode switch on the front panel. Refer to *1-4 Operating Modes* for an overview of available modes.

Control Origin

DM word m+1, bits 03 through 10

Control inputs (start, reset, and latch) can be designated as originating from the connector (control inputs IN1 and IN2) or from the IR area (internal IN1 and IN2). Designations are as follows:

0: External (connector input)

1: Internal (IR area)

Gate Mode Type (Gate Mode Only)

DM word m+1, bits 11 through 08

The gate mode type determines the use of control inputs IN1 and IN2. Refer to *1-4 Operating Modes* for details. Designations are as follows:

0000: Normal

0001: Cumulative

4-4-3 IR Area Settings

SET TIME Command (Sampling Mode Only)

Word n, bit 01

SET TIME is turned ON to use the sampling time held in word n+1. The new sampling time is effective on the rising edge of SET TIME, unless the counting flag is ON, in which case the new sampling time is effective after completion of the current counting operation.

Sampling Time (Sampling Mode Only)

Word n+1

Set to between 0010 and 9999 in ms.

The sampling time designates the time that pulses will be counted following control input IN1.

Control Inputs Internal IN1 or Control Input IN1

Word n, bit 03 or external connector

Internal IN2 or Control Input IN2

Word n, bit 04 or external connector

The setting of the control origin, DM word m+1 bits 03 through 00, determines whether external signals or IR bits are used as the start, latch, and gate signals. In cumulative gate mode (CT002 only), IN1 is the reset signal and IN2 the count signal. Pulses are counted while IN2 is ON. In normal gate mode, IN1 is the count signal and pulses are counted while it is ON.

In sampling mode, IN1 is the count signal.

In latch mode, IN1 is the count signal and IN2 the latch signal.

Error Flag

Word n+4, bit 05

The error flag is turned ON whenever an error has occurred. Information on the type and location of the error is available in IR word n+5 upon execution of READ ERROR.

READ ERROR Command

Word n, bit 05

READ ERROR can be set to access information on the error whenever the error flag is ON. Error information is output to IR word n+5. If more than one error has occurred, information on other errors can be output to IR word n+5 by again setting READ ERROR.

Error Location

Word n+5, bit 07 through 00

The error location gives the rightmost two digits of the DM address, i.e., the bit number, where the data causing the error is stored.

Error Code

Word n+5, bit 15 through 08

Error codes indicate the nature of the error and are given in *Appendix A Error Code List*.

Counting Flag

Word n+4, bit 00

The counting flag is ON whenever the Counter Unit is counting.

IN1 Flag

Word n+4, bit 02

The IN1 flag indicates the status of control input IN1. When the flag is ON, the input is high; when the flag is OFF, the input is low. This flag can be accessed during counting.

IN2 Flag

Word n+4, bit 03

The IN2 flag indicates the status of control input IN2. When the flag is ON, the input is high; when the flag is OFF, the input is low. This flag can be accessed during counting.

Count Overflow Flag

Word n+4, bit 06

The count overflow flag is turned ON when the counter value is incremented passed 8,388,607. This flag turns OFF when the next operation is started.

Current Counter Value

Word n+6 and n+7


Between -8,388,608 and 8,388,607

The current counter value is accessible in words n+6 and n+7 as 6 BCD digits with a sign digit.

4-4-4 Timing Charts


The following four charts show the relationship between the input and output bits in the two types of gate mode, the latch mode, and the sampling mode.

Normal Gate Mode

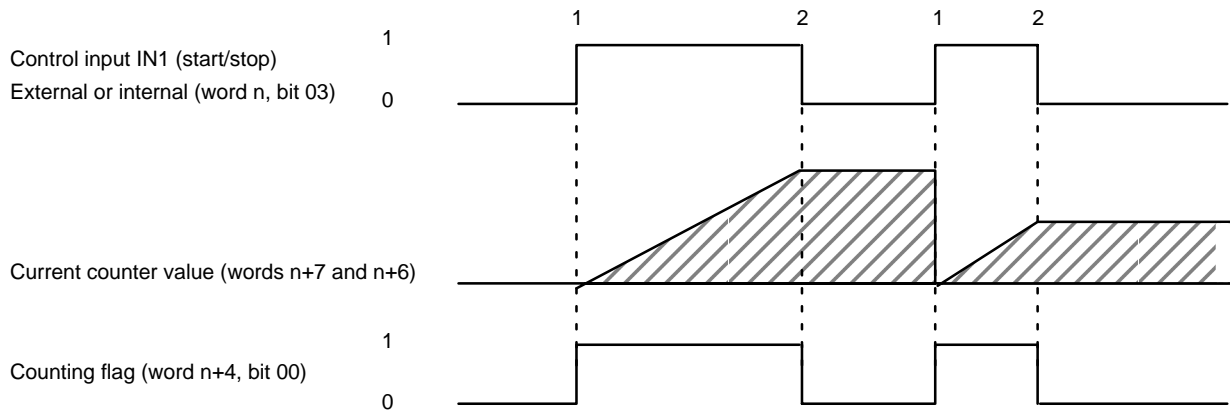


- 1, 2, 3...**
1. Counting starts from 0 on rising edge of IN1.
 2. Counting stops on falling edge of IN1. The counter value at that time is retained until the next IN1 signal. No external outputs are supported by the gate mode.

Cumulative Gate Mode (C200H-CT002 Only)

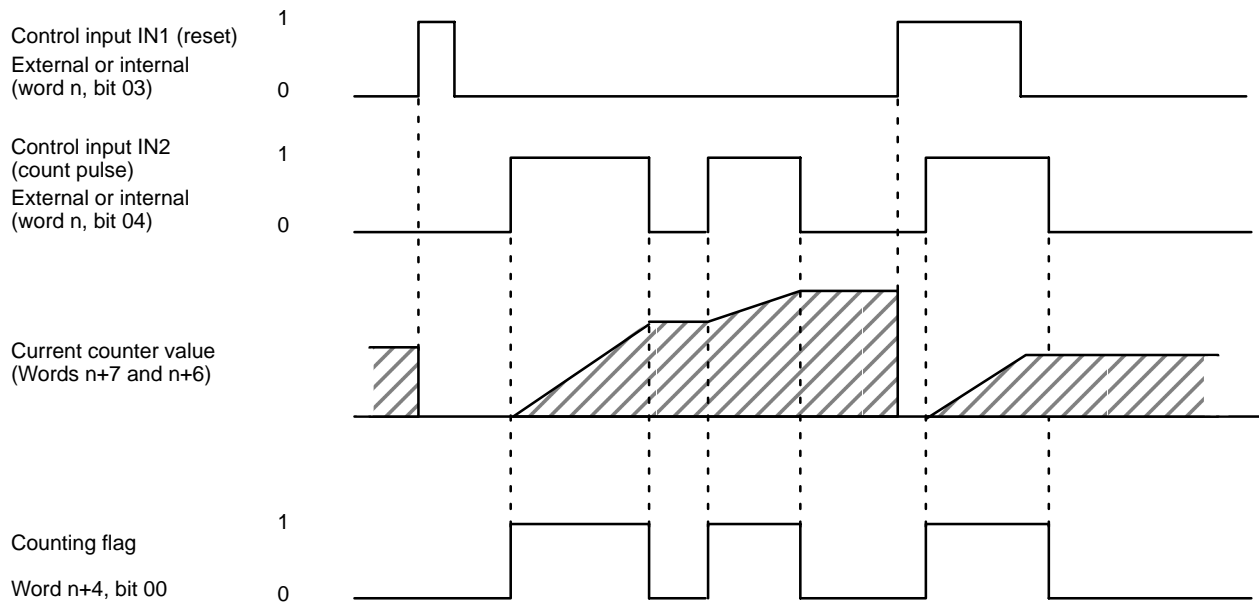


- 1, 2, 3...**
1. The current counter value is reset to zero on the leading edge of IN1.
 2. Counting continues from the last current counter value on rising edge of IN2.
 3. Counting stops on falling edge of IN2. The counter value at that time is retained until the next IN1 signal. No outputs are supported by the gate mode.

Latch Mode

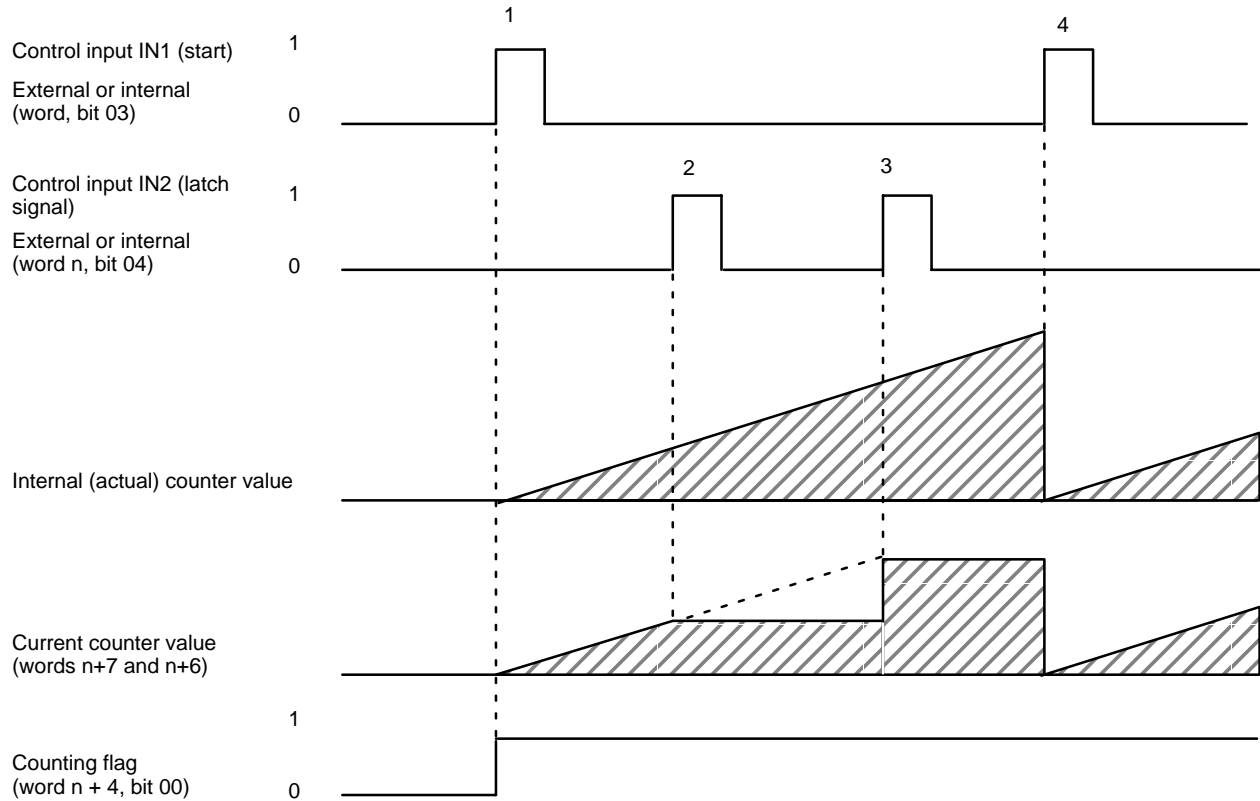


- 1, 2, 3...**
1. Counting starts from 0 on the rising edge of IN1.
 2. The current counter value is latched (frozen) on the rising edge of IN2 (latch signal) and latched value is maintained until the next IN2 or IN1 signal.
 3. The internal counter value continues to be incremented and decremented without being affected by the latch signal.
 4. Both the internal current counter values are reset to 0 on the next IN1 signal. No outputs are supported by the latch mode.

Sampling Mode

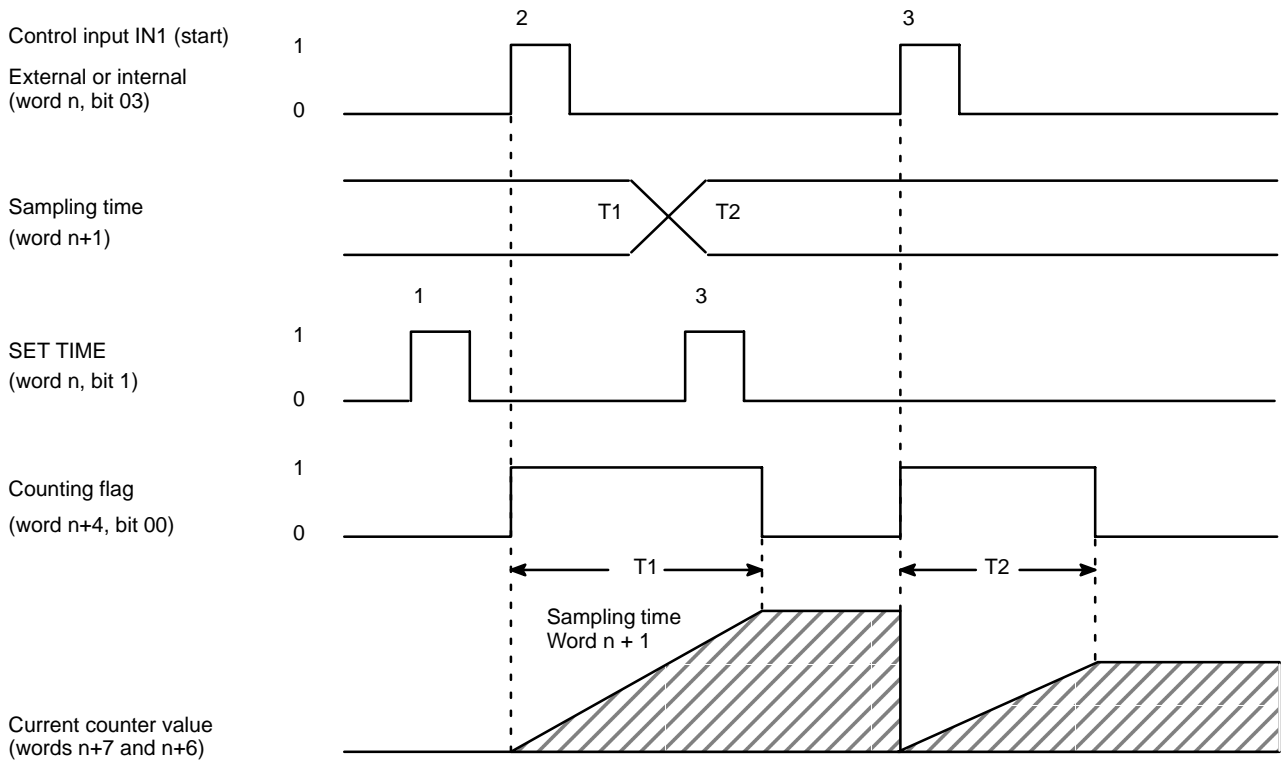


- 1, 2, 3...**
1. The sampling time is set from word n+1 before starting.
 2. Counting starts from 0 on the rising edge of IN1. After expiration of the sampling time, the count stops and the counter value is retained until the next IN1 signal.
 3. When SET DATA is turned ON while the counting flag is ON, the new sampling time is set after completion of the counting operation and used for the next counting operation. No external outputs are supported by the sampling mode.

Note Set up the system so that control input IN1 turns ON after setting the sampling time has been completed. The following is an example for internal control input 1.

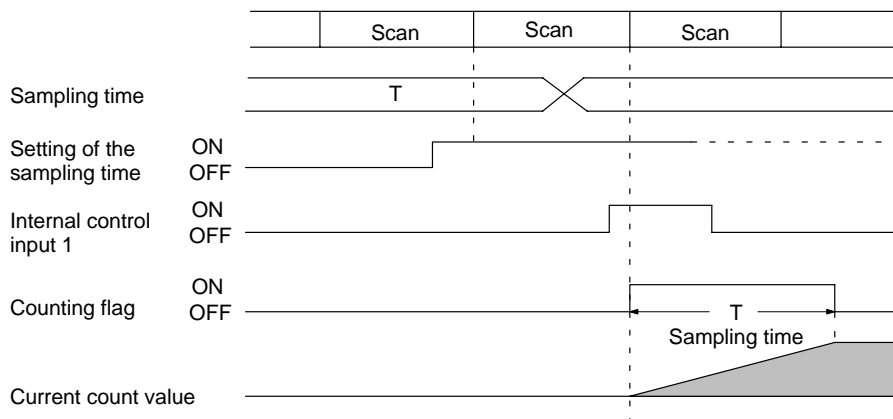

4-4-5 Application Examples

Gate Mode: Measuring Product Length System Configuration

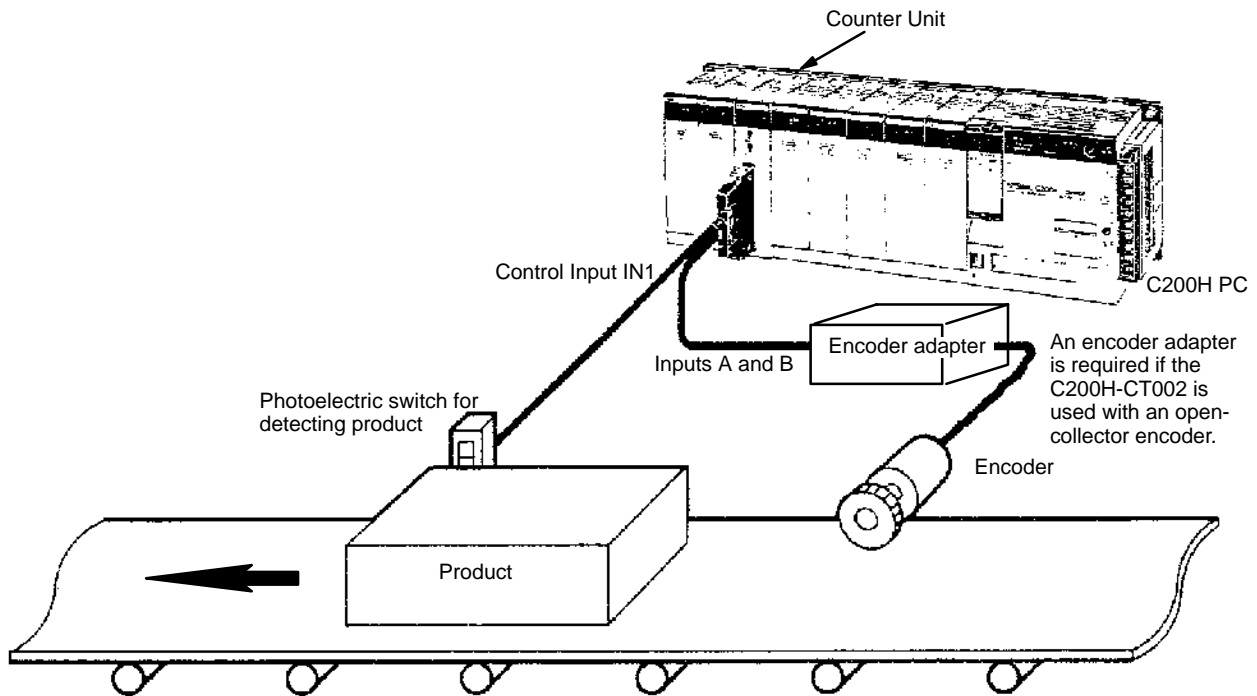

Operation

This example system counts encoder inputs while the photoelectric switch is ON to measure the lengths of products on a conveyor. The PC uses the resulting length measurements to determine if product lengths are within standards.

Switch Settings

In this example, the unit number selector is set to and 1 and the mode selector is set to 4.

All pins are turned OFF on the back panel DIP switch to designate offset phase inputs with no input multiplier.

Wiring


- 1, 2, 3... 1. Connect encoder outputs to inputs A and B.
2. Connect the photoelectric switch output to control input IN1.

DM Area Settings

DM 1100	0	4	0	0
DM 1101	0	0	0	0

Sets the mode to 4 (gate). Designates use of control IN1 from the connector (not the internal IN1) and normal gate mode (not cumulative).

Program

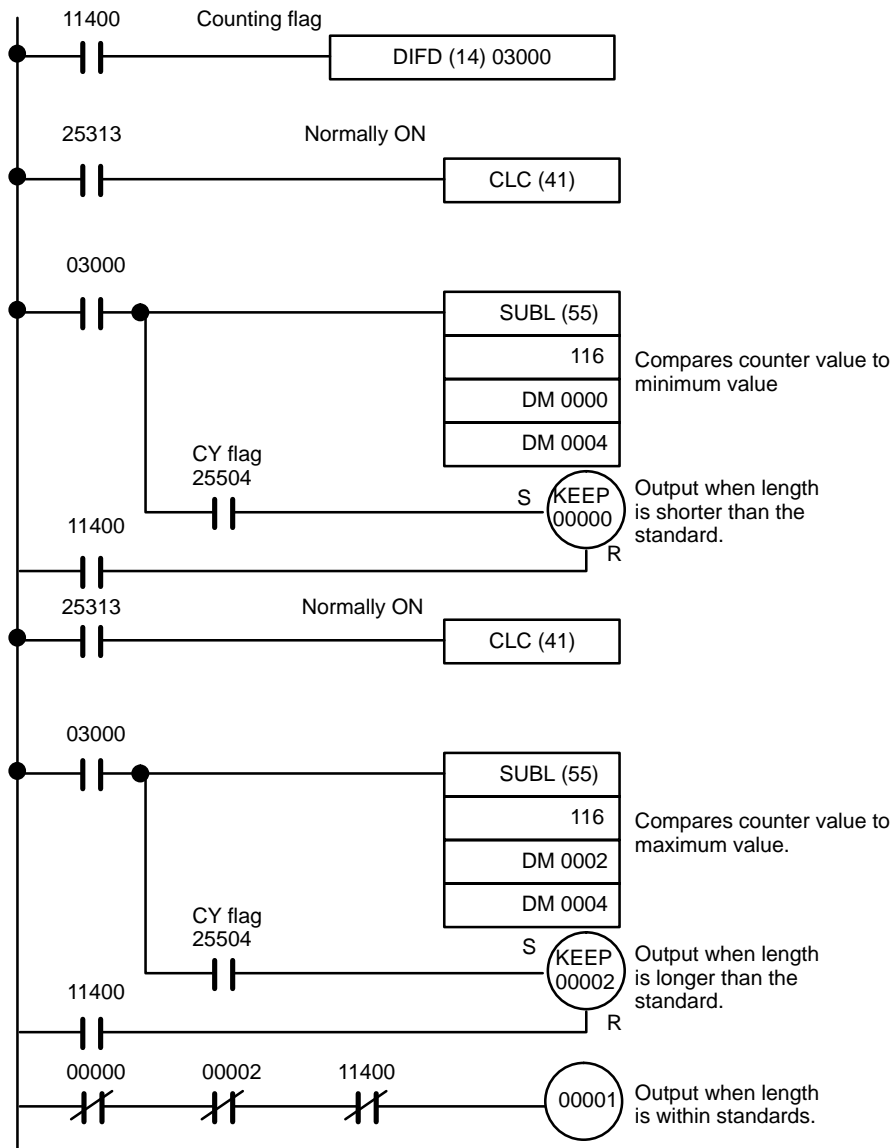


Comparison Data

DM 0000	Min.
DM 0001	
DM 0002	Max.
DM 0003	
DM 0004	Results
DM 0005	

Resulting Outputs


00000 ON	Too short
00001 ON	Length acceptable
00002 ON	Too long

Latch Mode: Monitoring Quantity at a Processing Station System Configuration

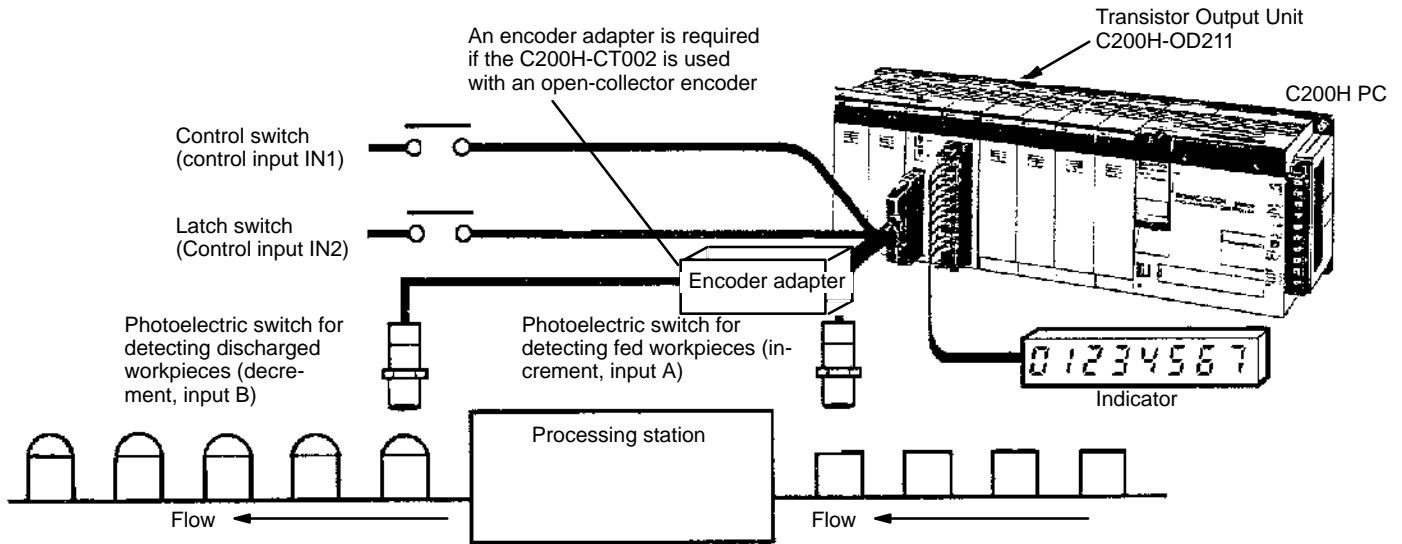

Operation

This example system monitors the number of work pieces in the processing station and displays the currently latched number on a seven-segment indicator.

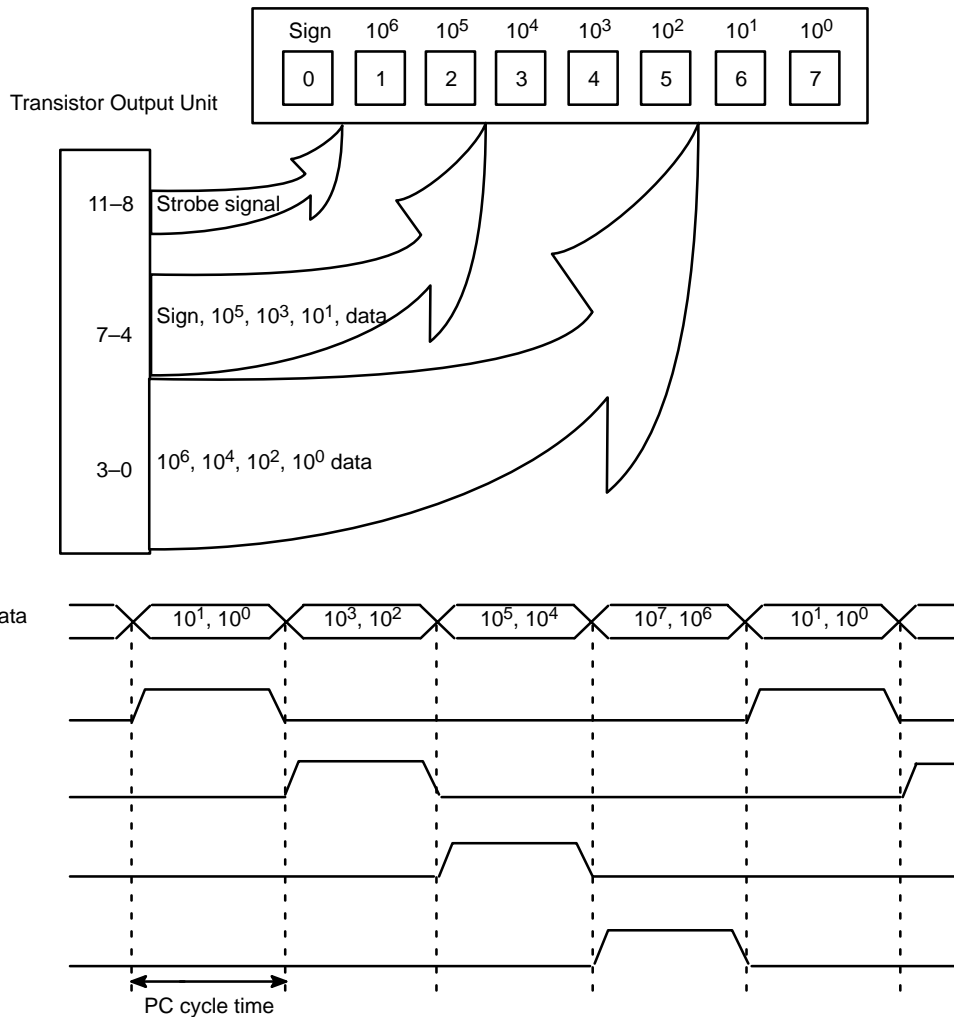

Switch Settings

In this example, the unit number selector is set to 1 and the mode selector is set to 5. All pins except number 1 are turned OFF on the back panel DIP switch to designate increment/decrement inputs.


Wiring

- 1, 2, 3... 1. Connect the photoelectric switch outputs to input A (increment) and the input B (decrement).
- 2. Connect the count switch to control input IN1.
- 3. Connect the latch switch to control input IN2.


DM Area Settings

DM 1100	0	5	0	0	Sets the mode to 5 (latch).
DM 1101	0	0	0	0	Designates use of control input IN1 from the connector (not the internal IN1).

Program

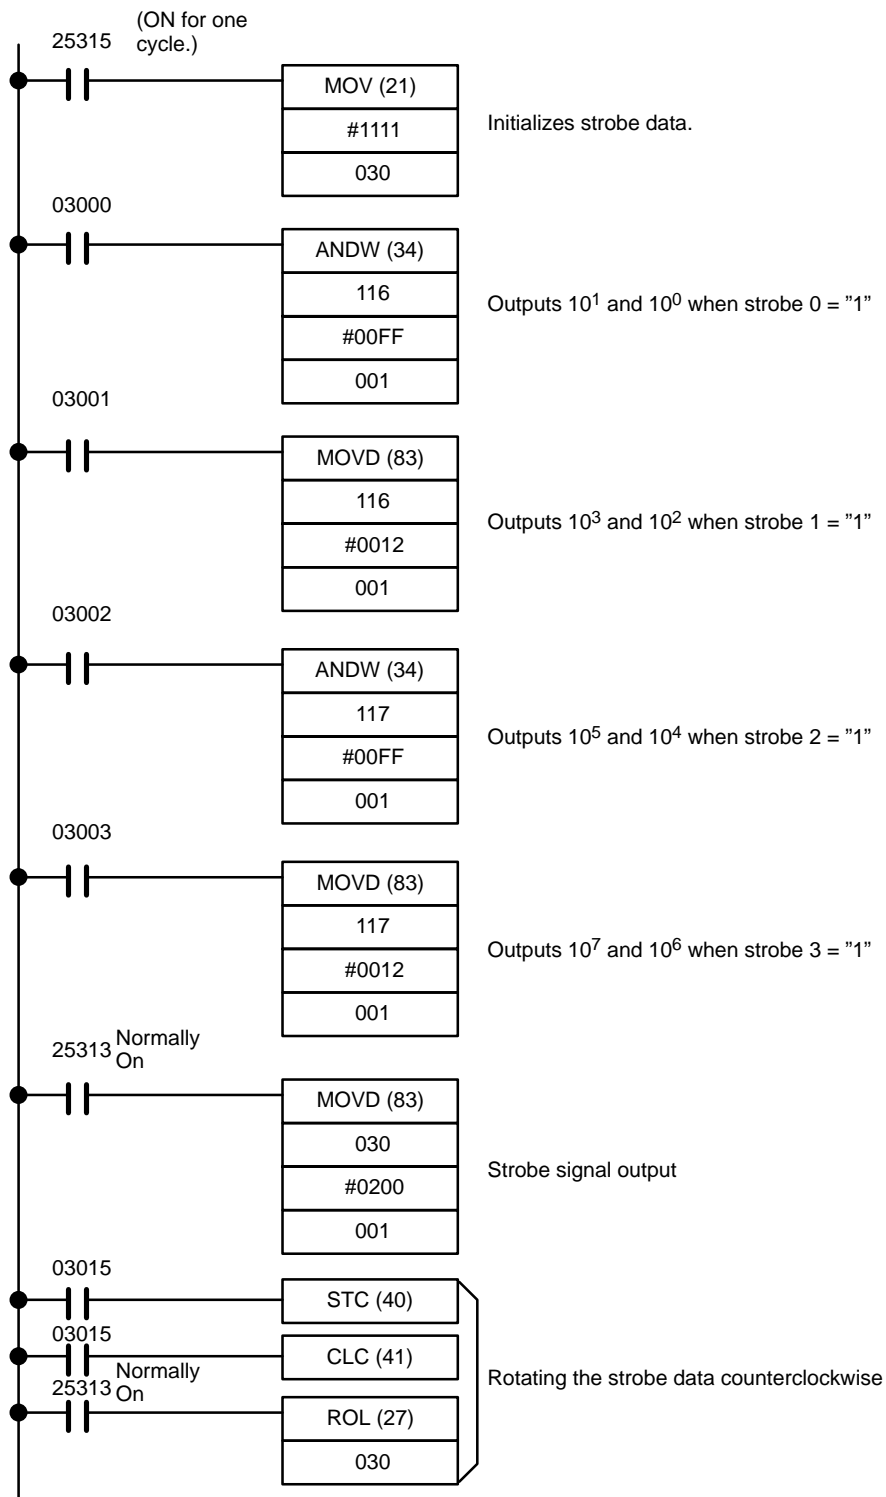

Sampling Mode Example 1: Weighing Objects System Configuration

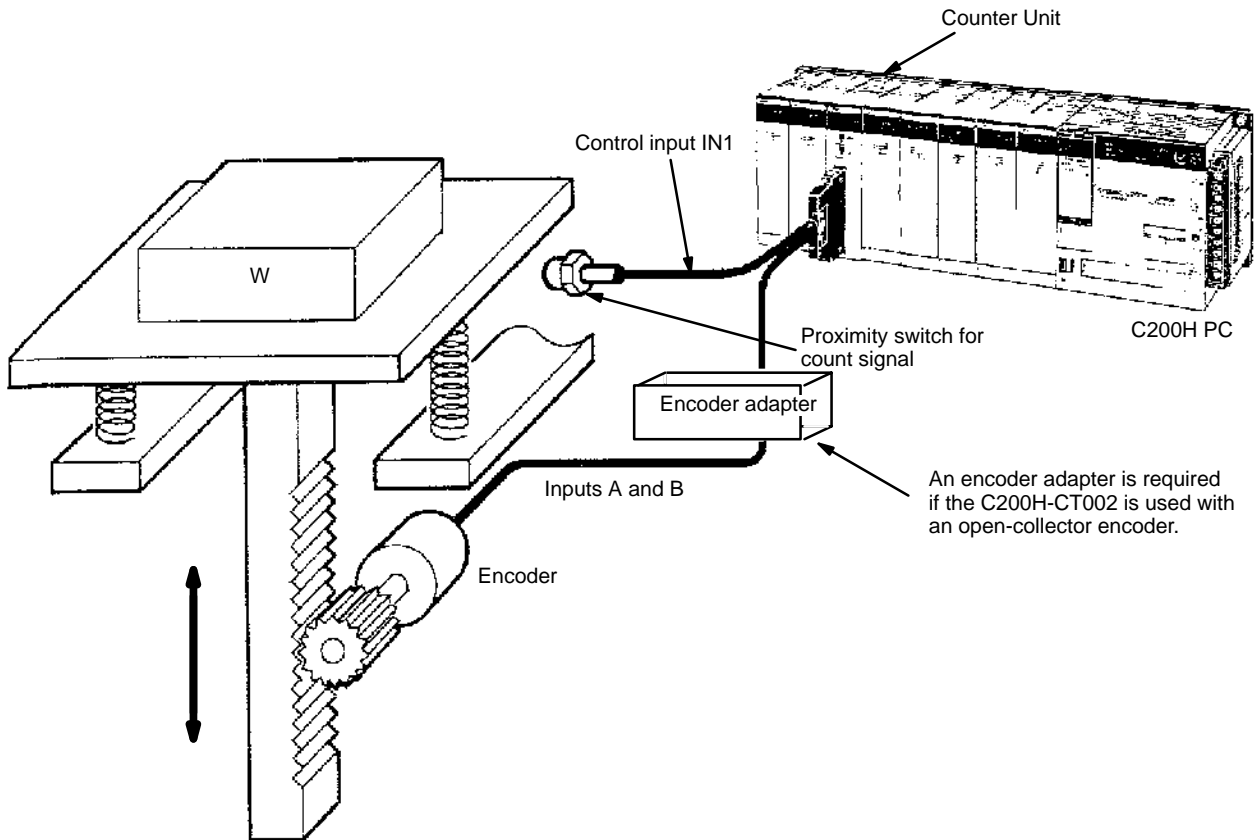

Operation

In this example system, encoder pulses are counted for a fixed period after placing an object onto a scale. The weight of the object is measured only after all vibration has stopped.

Switch Settings

In this example, the unit number selector is set to 1 and the mode selector is set to 6. All pins except pins number 2 and 3 are turned OFF on the back panel DIP switch to designate offset phase inputs with a x4 input multiplier.


Wiring

- 1, 2, 3... 1. Connect the incremental encoder outputs to the inputs A and B.
2. Connect the proximity switch output to control input IN1.


DM Area Settings

DM 1100	0	6	0	0	Sets the mode to 6 (sampling).
DM 1101	0	0	0	0	Designates use of control input IN1 from the connector (not the internal IN1).

Program

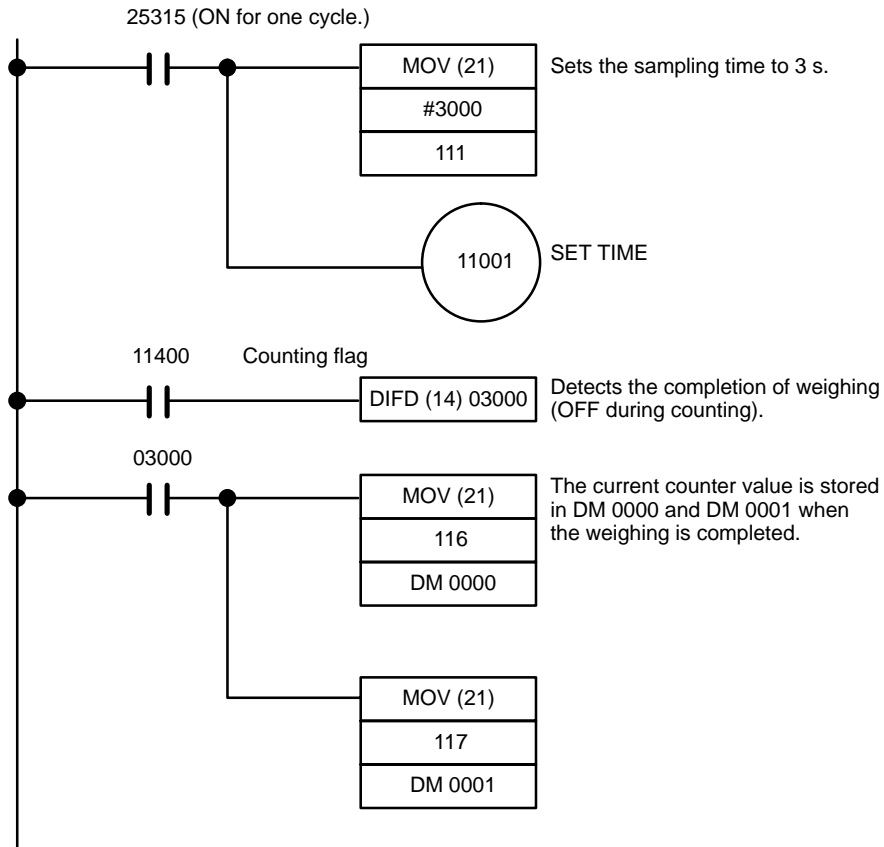

Sampling Mode Example 2: Measuring Speed System Configuration

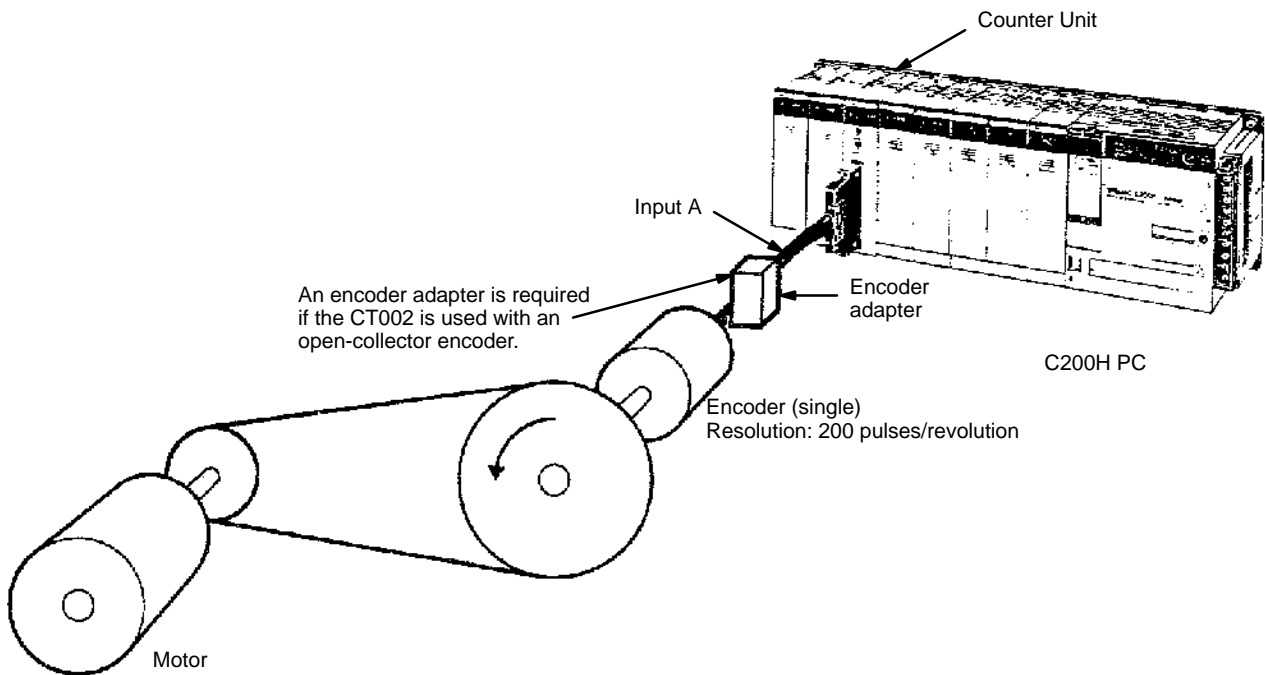

Operation

This example system counts, for a specific interval, pulses from an incremental encoder that is directly connected to a rotating shaft. The PC then converts the pulse count into a shaft speed (rpm). Here, the speed in rpm would

be the number of pulses per second times 60 divided by the number of pulses per shaft rotation (i.e., 200), or 0.3 times the pulse count per second.

Switch Settings

In this examples, the unit number selector is set to 1 and the mode selector is set to 6. All pins except pins 1 and 2 are turned OFF on the back panel DIP switch to designate pulse and direction inputs.


Wiring

- 1, 2, 3...**
1. Connect the incremental encoder output to the inputs A.
 2. Do not connect any output to input B, and set the counter to increment.

DM Area Settings

DM 1100	0	6	0	0	Sets the mode to 6 (sampling).
DM 1101	0	0	0	1	Designates use of internal IN1 from the PC (not control input IN1).

Program

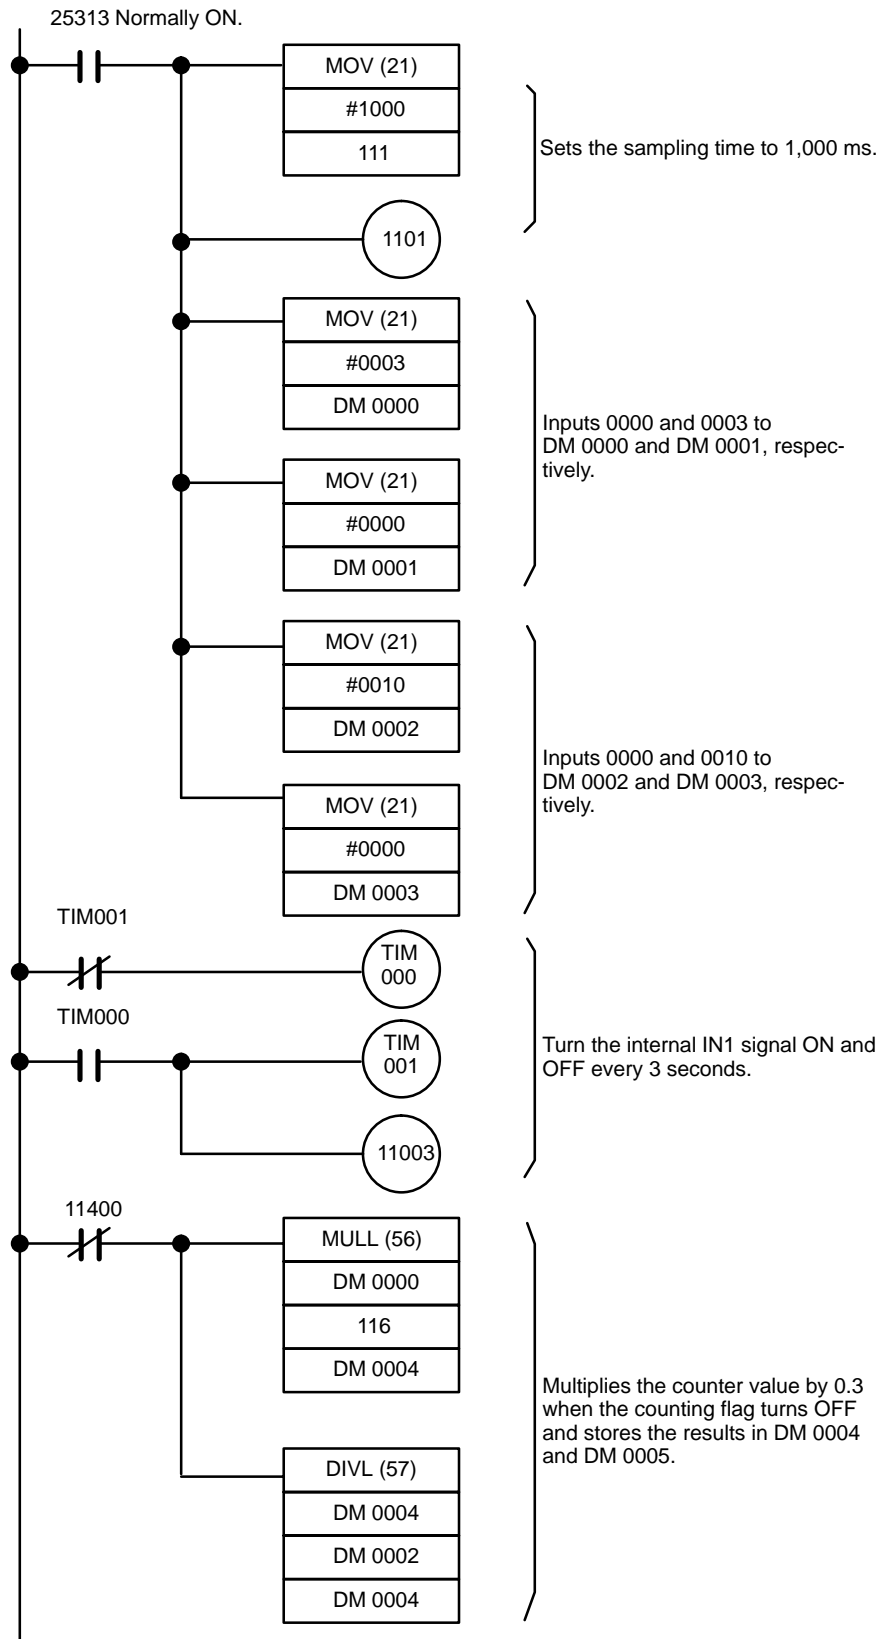

SECTION 5

Error Processing

This section presents possible errors and solutions and describes how to handle errors from the PC. The AR area Error and Restart Flags are described.

5-1	Error Indications	80
5-2	Troubleshooting from the PC	80

5-1 Error Indications

When an error occurs, the ERROR indicator will light and the error flag will turn ON. Error information is then output to IR word n+5 when READ ERROR is set. READ ERROR can be set as many times as necessary to access further error information. (Information for up to 30 errors will be saved in the system.)

Error information in IR word n+5 consists of the error location, which indicates the last two digits of the DM address where the error originates, and the error code, which classifies the error (Refer to *Appendix A Error Code List*). The error location is held in bits 07 through 00; the error, in bits 15 through 08.

If the counter value overflows, the ERROR indicator will light and the counter overflow flag will turn ON. The error flag will not turn ON for counter overflows, and error information will not be output to IR word n+5.

If an error occurs, correct the cause of the error and clear all PC error flags. Error information and the Counter Unit error flag will be cleared after all errors are read out with READ ERROR.

5-2 Troubleshooting from the PC

Errors in the Counter Unit can be monitored from the PC. The Counter Unit is monitored as a Special I/O Unit, and as such is treated the same as a Position Control Unit or any other Special I/O Unit.

Error List for Special I/O Units

Error	Possible cause and status	Correction
Waiting for Special I/O Unit startup.	<ul style="list-style-type: none"> ●Special I/O Unit has a hardware malfunction. ●PC will not begin operation. 	<ul style="list-style-type: none"> ●Replace the Special I/O Unit with a new Unit. (The malfunctioning Unit displays only \$s when I/O table is read.)
Too many Special I/O Units.	<ul style="list-style-type: none"> ●Same unit number has been assigned to more than one Special I/O Unit. ●PC will not begin operation. ●SR bit 25415 is ON. 	<ul style="list-style-type: none"> ●Set unit numbers so that each is used only once (Unit numbers can be accessed by reading I/O table.)
Error in Special I/O Unit.	<ul style="list-style-type: none"> ●Refreshing was not normally executed between CPU and the Special I/O Unit. ●Only the malfunctioning Unit will stop operation. ●SR bit 25415 is ON. 	<ul style="list-style-type: none"> ●Obtain the malfunctioning Unit number by reading AR bits 0000 to 0009, remove the cause of the error, and then restart by turning OFF, ON, then back off the appropriate restart flag (AR bits 0100 to 0109). If the Counter Unit does not recover normal operation after restarting, replace it with a new one.

AR Area Error and Restart Flags for Special I/O Units

Error Flags

The following error flags will turn ON when the same unit number is assigned to more than one Special I/O Unit, or when the refreshing operation between the PC and the Special I/O Unit is not normally executed.

Bit	Unit number
AR 000	0
AR 001	1
AR 002	2
AR 003	3
AR 004	4
AR 005	5
AR 006	6
AR 007	7
AR 008	8
AR 009	9

Restart Flags

The following restart flags are turned ON and OFF to restart Special I/O Units. It is not necessary to turn OFF Counter Unit power when its restart flag is used.

Bit	Unit number
AR 0100	0
AR 0101	1
AR 0102	2
AR 0103	3
AR 0104	4
AR 0105	5
AR 0106	6
AR 0107	7
AR 0108	8
AR 0109	9

Appendix A Error Codes

Code	Error type	Meaning
11	Numeric	Data is not BCD or data is 0.
12	Counting range	Data is less than -8,388,608 or greater than 8,388,607. (Circular mode: data is less than 0 or greater than 65,535.)
14	Inconsistent data	The mode setting on the front panel and the operating mode set in DM area are inconsistent, or upper and lower settings for ranges are reversed.
15	Parameter error	Error in parameters other than those covered under codes 11, 12, and 14, above.
32	Counter preset	The counter preset number is not between 00 and 19.
33	Transfer range no./transfer preset no.	The range number for TRANSFER DATA is not between 00 and 15 transfer preset no. or the preset number for TRANSFER DATA is not between 00 and 19.
34	Beginning word no.	The beginning word number for TRANSFER DATA is not acceptable.
35	Data area	The data area number for TRANSFER DATA is not acceptable.
36	Number of transfers	The number of transfers exceeds the specified maximum or is set to 0.

Appendix B Specifications

Item	Specification
Number of axes	One per Counter Unit
Operating modes	Any of the following six: Linear mode Circular mode Preset mode Gate mode Latch mode Sampling mode
Count input signals	Input A Input B
Counting signal level	CT001-V1: 5, 12, or 24 VDC (Selected when wiring). CT002: Same as RS-422 line driver (Am26LS31-compatible).
Input modes	Offset phases Separate up and down inputs Pulse and direction inputs
Counting speed	CT001-V1: 50 kcps max. CT002: 75 kcps max. (Depends on encoder when using offset phase inputs. Refer to <i>3-2-1 Offset phases</i>).
Other	Input multiplier (x2 or x4) available for offset phase inputs.
Input signals	Input Z Control input IN1 Control input IN2
External signal level	CT001-V1: 5, 12, or 24 VDC (Selected when wiring). CT002: Same as RS-422 line driver (Am26LS31-compatible).
External outputs	8 total
Output level	External output power supply: 5 to 24 VDC Switching capacity: 16 to 80 mA
Internal consumption	300 mA max. at 5 VDC (supplied from rack).
Weight	400 g max. (excluding connectors).


Maximum Required Response Speed (Pulse Input to Output)

No. of ranges	Linear mode	Circular mode
1	0.74 ms	0.66 ms
8	1.17 ms	1.02 ms
16	1.40 ms	1.10 ms





Note Add the I/O refresh time (approximately 3 ms) to the values in the above table to compute the response speed when the I/O refresh timing differs from the output timing.

I/O Specifications





Output Specifications (Outputs 0 through 7)

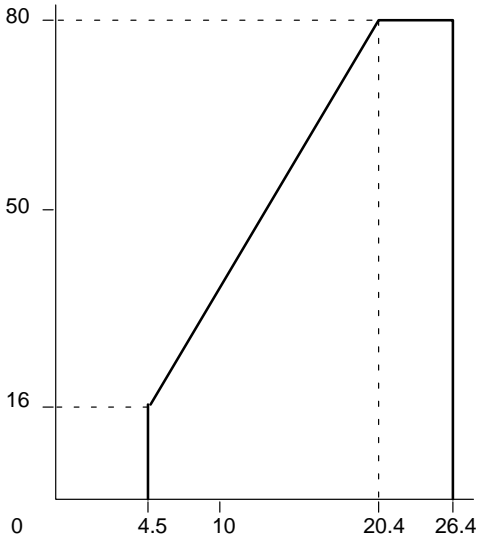Item	Specification								
Switching capacity	6 mA at 4.5 VDC to 80 mA at 26.4 VDC (Refer to table below.) Maximum: 320 mA/common								
Leak current	0.1 mA max.								
Residual voltage	0.4 V max.								
ON/OFF response time	High-speed counting process time 0.3 ms								
External power supply	5 to 24 VDC + 10% (50 mA max. at 26.4 VDC)								
Switching capacity	<p>Maximum Switching Capacity: Power Supply Characteristic. The maximum switching capacity is determined by the power supply as shown in the following diagram:</p>  <table border="1" data-bbox="746 632 1225 1167"> <caption>Maximum Switching Capacity: Power Supply Characteristic</caption> <thead> <tr> <th>External power supply (VDC)</th> <th>Switching capacity (mA)</th> </tr> </thead> <tbody> <tr> <td>4.5</td> <td>16</td> </tr> <tr> <td>20.4</td> <td>80</td> </tr> <tr> <td>26.4</td> <td>80</td> </tr> </tbody> </table>	External power supply (VDC)	Switching capacity (mA)	4.5	16	20.4	80	26.4	80
External power supply (VDC)	Switching capacity (mA)								
4.5	16								
20.4	80								
26.4	80								

C200H-CT001-V1 Input Specifications

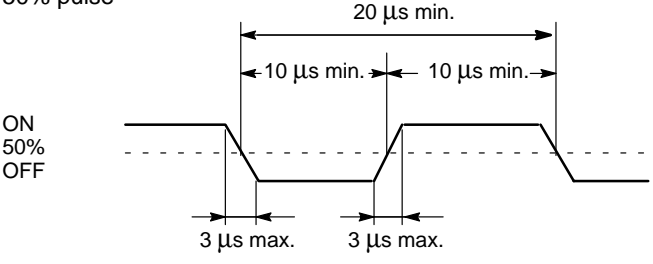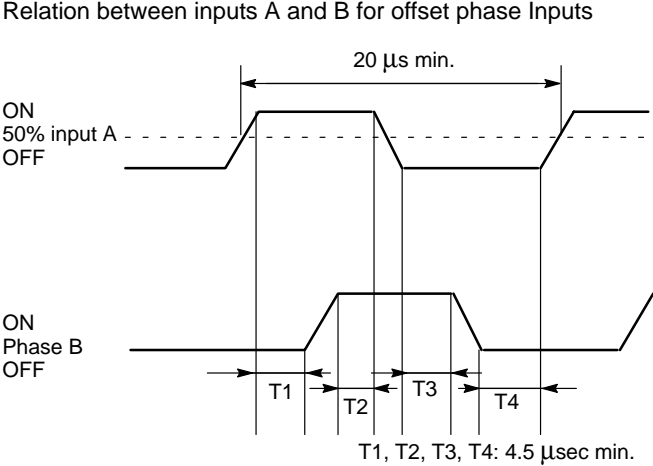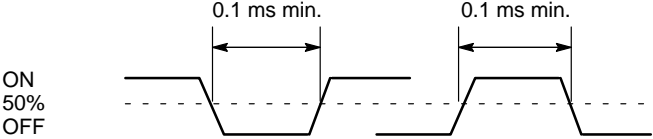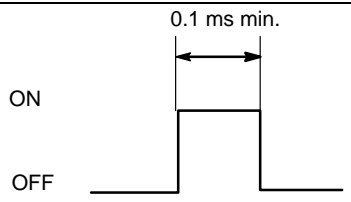Item	Inputs A, B, and Z			Control inputs IN1 and IN2	
	5 VDC±10%	12 VDC±10%	24 VDC±10%	5 VDC±10%	12 or 24 VDC±10%
Input current	12 mA typical (7.5 to 18 mA)			4 to 7 mA	4 to 13 mA
ON voltage (min.)	4.5 VDC	10.2 VDC	21.6 VDC	4.5 VDC	10.2 VDC
OFF voltage (max.)	2.0 VDC	3.0 VDC	4.0 VDC	2.0 VDC	3.0 VDC
ON/OFF response time	---			1 ms max.	
Minimum response time	<p>*Inputs A and B Waveform of inputs A and B Rise/fall time: 3µs max. 50 kHz, 50% pulse</p>  <p>ON 50% OFF</p> <p>20 µs min. 10 µs min. 10 µs min. 3 µs max. 3 µs max.</p> <p>Relation between inputs A and B for offset phase Inputs</p>  <p>ON 50% input A OFF</p> <p>ON Phase B OFF</p> <p>T1 T2 T3 T4 T1, T2, T3, T4: 4.5 µsec min.</p> <p>There must be at least a 4.5-µs interval between the change point of input A and that of input B.</p> <p>*Input Z A pulse width of at least 0.1 ms is required.</p>  <p>ON 50% OFF</p> <p>0.1 ms min. 0.1 ms min.</p>			 <p>ON OFF</p> <p>0.1 ms min.</p> <p>Note: These signals must remain ON for at least the length of the PC's cycle time to be accurately read from the PC.</p>	

C200H-CT002 Input Specifications

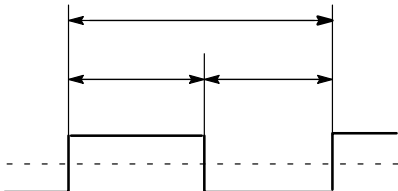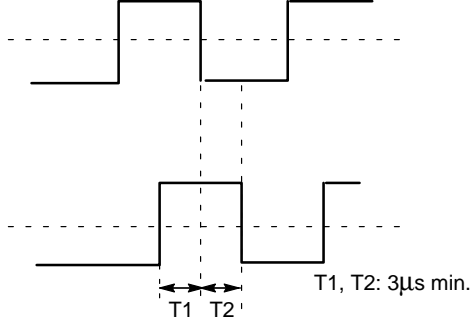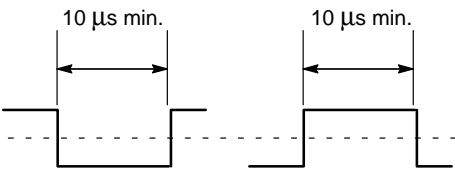Item	Inputs A, B, and Z	Control inputs IN1 and IN2	
Input voltage	Same as the RS-422 line driver (Am26LS31-compatible).	5 VDC±10%	12 or 24 VDC±10%
Input current		4 to 7 mA	4 to 13 mA
ON voltage (min.)		4.5 VDC	10.2 VDC
OFF voltage (max.)		2.0 VDC	3.0 VDC
ON/OFF response time		1 ms max.	
Minimum response time	<p>*Input A and B Waveform at positive terminals 75 kHz, 50% pulse</p>  <p>ON 0V OFF</p> <p>Relation between inputs A and B for offset phase Inputs</p>  <p>ON Input A 0V OFF</p> <p>ON Phase B 0V OFF</p> <p>T1, T2: 3µs min.</p> <p>There must be at least a 3 µs interval between the change point of input A and that of input B. *Input Z A pulse width of at least 10 µs is required.</p>  <p>ON 0V OFF</p>	<p>0.1 ms max.</p>  <p>ON OFF</p> <p>Note: These signals must remain ON for at least the length of the PC's cycle time to be accurately read from the PC.</p>	

Appendix C

IR Area Allocations

(n = 100 + 10 x unit no.)

Linear and Circular Operating Modes

Word		Bit																							
		15	14	13	12	11	10	09	08	07	06	05	04	03	02	01	00								
Output	n	#7	#6	#5	#4	#3	#2	#1	#0	Output force bits								ENABLE FORCED OUTPUT	RESET COUNTER	READ ERROR	CHANGE PRESET	⋮	ENABLE FORCED OUTPUT	TRANSFER DATA	START
	n+1	Range enable bits																							
	n+2	TRANSFER DATA beginning channel number																							
	n+3	Number of transfers								TRANSFER DATA data area															
	Input	n+4	---								Reset Completed	Count overflow flag	Error flag	Transfer completed flag	IN2 flag	IN1 flag	Z flag	Counting flag							
n+5		Error code								Error location															
n+6		Current counter value (rightmost 4 digits)																							
n+7		Current counter value (sign and leftmost 3 digits)																							
n+8		Range flags																							
n+9		Output flags																							

Preset Operating Mode

Word		Bit																							
		15	14	13	12	11	10	09	08	07	06	05	04	03	02	01	00								
Output	n	#7	#6	#5	#4	#3	#2	#1	#0	Output force bits								ENABLE FORCED OUTPUT	RESET COUNTER	READ ERROR	CHANGE PRESET	---	ENABLE FORCED OUTPUT	TRANSFER DATA	START
	n+1	Range enable bits																							
	n+2	TRANSFER DATA beginning channel number																							
	n+3	Number of transfers								TRANSFER DATA data area															
Input	n+4	#7	#6	#5	#4	#3	#2	#1	#0	Output flags								Reset flag	Count overflow flag	Error flag	Transfer completed flag	---	IN1 flag	---	Counting flag
	n+5	Error code								Error location															
	n+6	Current counter value, 7 digits																							
	n+7																								
	n+8	Range flags								---															

Gate, Latch, and Sampling Operating Modes

Word		Bit															
		15	14	13	12	11	10	09	08	07	06	05	04	03	02	01	00
Output	n	---								READ ERROR	Internal IN2	Internal IN1	---	Internal IN1	---		
	n+1	Sampling time															
Input	n+4	---								Count overflow flag	Error flag	---	IN2 flag	IN1 flag	---	Counting flag	
	n+5	Error code								Error location							
	n+6	Current counter value (rightmost 4 digits)															
	n+7	Current counter value (sign and leftmost 3 digits)															

Appendix D

DM Area Coding Sheets

$$m = 1000 + (100 \times \text{unit no.})$$

Linear and Circular Operating Modes DM 00 through 99

Word	15-00			Function	Word	15-00			Function	Word	15-00			Function	
00	0		0	0	Operating mode	35				Lower limit, range #5	70				Lower limit, range #12
01					Effective range bits	36					71				
02					Maximum counter value (circular mode only)	37				Upper limit, range #5	72				Upper limit, range #12
03	0	0	0			38					73				
04					Not used.	39				Output pattern, range #5	74				Output pattern, range #12
05						40				Lower limit, range #6	75				Lower limit, range #13
06						41					76				
07						42				Upper limit, range #6	77				Upper limit, range #13
08						43					78				
09															
10					Lower limit, range #0	44				Output pattern, range #6	79				Output pattern, range #13
11															
12					Upper limit, range #0	45				Lower limit, range #7	80				Lower limit, range #14
13						46					81				
14					Output pattern, range #0	47				Upper limit, range #7	82				Upper limit, range #14
						48					83				
15					Lower limit, range #1	49				Output pattern, range #7	84				Output pattern, range #14
16															
17					Upper limit, range #1	50				Lower limit, range #8	85				Lower limit, range #15
18						51					86				
19					Output pattern, range #1	52				Upper limit, range #8	87				Upper limit, range #15
						53					88				
20					Lower limit, range #2	54				Output pattern, range #8	89				Output pattern, range #15
21															
22					Upper limit, range #2	55				Lower limit, range #9	90				Not used.
23						56					91				
24					Output pattern, range #2	57				Upper limit, range #9	92				
						58					93				
25					Lower limit, range #3	59				Output pattern, range #9	94				
26											95				
27					Upper limit, range #3	60				Lower limit, range #10	96				
28						61					97				
29					Output pattern, range #3	62				Upper limit, range #10	98				
						63					99				
30					Lower limit, range #4	64				Output pattern, range #10					
31															
32					Upper limit, range #4	65				Lower limit, range #11					
33						66									
34					Output pattern, range #4	67				Upper limit, range #11					
						68									
						69				Output pattern, range #11					

Preset Operating Mode

Word	15-00				Function	Word	15-00				Function	Word	15-00				Function
00	0	3	0	0	Operating mode	34						68					
01					OFF counter value for output #0	35						69					
02	0					36							70				
03					ON counter value for output #1	37						71					
04	0					38							72				
05					OFF counter value for output #1	39						73					
06	0					40							74				
07					ON counter value for output #2	41						75					
08	0					42							76				
09					OFF counter value for output #2	43						77					
10	0					44							78				
11					ON time for outputs #4 through #7	45						79					
12						46							80				
13					Not used.	47						81					
14						48							82				
15					Preset #0	49						83					
16						50							84				
17					Preset #1	51						85					
18						52							86				
19					Preset #2	53						87					
20						54							88				
21					Preset #3	55						89					
22						56							90				
23					Preset #4	57						91					
24						58							92				
25					Preset #5	59						93					
26						60							94				
27					Preset #6	61						95					
28						62							96				
29					Preset #7	63						97					
30						64							98				
31					Preset #8	65						99					
32						66											
33					Preset #9	67											

Gate, Latch and Sampling Operating Modes

Word	15-00				Function
00	0		0	0	Operating mode (4: gate; 5: latch; or 6: sampling)
01	0		0		Control origin and gate mode type

Index

A

Am26LS31—compatible, 12
applications, precautions, ix
AR area, error and restart flags, 81

C

circular mode
description, 4
DM area allocation, 37
IR area allocation, 38
IR area settings/commands, 40
maximum counter value, 39
operation, 36
timing relationships, 46
use with Offset Phase input, 26
use with Pulse and Direction inputs, 28
use with Up and Down Pulse input, 28
command
CHANGE RANGES, in linear/circular mode, 40
ENABLE FORCED OUTPUT
in linear/circular mode, 40
in preset mode, 57
ENABLE OUTPUT
in linear/circular mode, 40
in preset mode, 56
PRESET COUNTER, in preset mode, 57
READ ERROR
in gate, latch and sampling mode, 66
in linear/circular mode, 45
in preset mode, 58
RESET COUNTER, in linear/circular mode, 40
SET TIME, in gate, latch and sampling mode, 65
START
in linear/circular mode, 40
in preset mode, 56
TRANSFER DATA
in linear/circular mode, 40
in preset mode, 57
connections, 2
connector
assembly, 12
differentiating input and output cables, 12
Fujitsu FCN—361J040, 10
input pin settings, 30
pin arrangement, 10
pin numbers, 12
solder type, 11
type, 10, 12
counting speed, Offset Phase input, 26
cycle time, transferring data, 31

D

data allocation, gate, latch and sampling modes, 64
data format, 36

data transfer, 26
See also Unit, Counter — transferring data
area, 40
delay precaution, 31
in Remote I/O Systems, 31
relation to PC scan time, 30
source, 41
DIP switch setting. *See* Unit, Counter — switch setting
DM area
allocation, 37
allocation in preset mode, 52
data allocation in gate, latch and sampling mode, 64
settings, 39, 65
settings in preset mode, 55
word allocation, 26, 34

E

error, flag/indicator operation, 80
example
12 VDC Voltage—Output Synch—Load Encoder, 19
24 VDC Open—collector Encoder, 18
5 VDC Voltage—Output Source—Load Encoder, 20
C200H—CT001—V1 input circuit wiring, 18
C200H—CT002, 21
circular mode, functioning as mechanical cam switches,
50
control input wiring, 22
determining acceptable product length, 3
external output wiring, 23
gate mode, measuring product length, 70
latch mode, monitoring quantity at a processing station,
72
Line—Driver Encoder, 21
linear mode, controlling conveyor processing, 47
Open—collector Encoder and Encoder Adapter, 21
preset mode, measuring and cutting rod, 61
sampling mode
measuring speed, 76
weighing objects, 75
to prevent chattering, 22
transferring range parameters, 42
transferring the counter value, 43
external outputs, modes, 4

F

flag
count overflow
in gate, latch and sampling mode, 66
in linear/circular mode, 45
in preset mode, 59
counting
in gate, latch and sampling mode, 66
in linear/circular mode, 44
in preset mode, 58
error
in gate, latch and sampling mode, 66

- in linear/circular mode, 45
- in preset mode, 58
- error in operation, 81
- IN1
 - in gate, latch and sampling mode, 66
 - in linear/circular mode, 45
 - in preset mode, 58
- IN2
 - in gate, latch and sampling mode, 66
 - in linear/circular mode, 45
- output
 - in linear/circular mode, 46
 - in preset mode, 59
- range, in linear/circular mode, 45
- reset
 - in linear/circular mode, 45
 - in preset mode, 59
- transfer complete, in preset mode, 58
- transfer completed, in linear/circular mode, 45
- Z, in linear/circular mode, 45

Fujitsu FCN-361J040 connector, 10

fuse, 13

G

gate mode

- description, 4
- operation, 63
- timing relationships, 67

I

I/O refresh cycle, 34

- transferring data, 31

incremental encoder, 2

input circuit, 13

- C200H-CT001-V1, 14
- C200H-CT002, 16

installation, precautions, ix

interference, 2, 13

IR area

- allocation, 38
- allocation in preset mode, 53
- commands, 40
- in gate, latch and sampling mode, 64
- settings, 40
- settings in preset mode, 56
- word allocation, 26, 34

L

latch mode

- description, 4
- operation, 63
- timing relationships, 68

LED indicators, 2

linear mode

- description, 4
- DM area allocation, 37
- IR area allocation, 38
- IR area settings/commands, 40

operation, 36

timing relationships, 46

use with Offset Phase input, 26

use with Pulse and Direction inputs, 28

use with Up and Down Pulse input, 28

M

multi-core cable, 11

N

noise, 2

noise resistance, 2

O

Offset Phase input. *See* Unit, Counter – Offset Phase input

operating environment, precautions, ix

operating mode, switch settings, 30

operating mode selector, 39

operating modes

- circular, 4
- gate, 4
- input types, 26
- latch, 4
- linear, 4
- preset, 4
- sampling, 5

output circuit, 13

- C200H-CT001-V1, 15
- C200H-CT002, 17

P

PC, max number of Special I/O Units, 3

power supply

- output current, 13
- preventing interference, 13
- terminals, 12
- voltage, 13

precaution

- data transfer delay, 31
- switch setting, 8
- wiring, 12

precautions, vii

- applications, ix
- general, viii
- operating environment, ix
- safety, viii

preset mode

- description, 4
- operation, 52
- timing relationships, 60

R

RS-422, 2

S

safety precautions. *See* precautions
sampling mode
 description, 5
 operation, 63
 timing relationships, 69
specifications, Encoder, 27
switch setting
 See also Unit, Counter – switch setting
 precaution, 8
 using the multiplier, 26
switch settings, 29

T

timing chart
 linear/circular mode, 46
 preset mode, 60
timing charts
 gate mode, 67
 latch mode, 68
 sampling mode, 69
transferring data. *See* data transfer

U

Unit, Counter
 assigning Unit numbers, 26
 circular mode, 36
 connector pin arrangement, 10
 dimensions, 24
 dimensions mounted, 24
 error code listing, 83
 error flags, 81
 error listing, 80
 example configuration, 3

 front view, 2
 indicators, 2
 input and output circuits, 13
 input circuit examples, 18
 input selection, 26
 linear mode, 36
 mounting location, 3
 Offset Phase input, 26
 operating modes, 4, 30
 operation, 26
 pin settings, 30
 Pulse Direction input, 28
 reset conditions, 29
 reset point, 29
 resetting, 4, 26
 restart flags, 81
 specifications, 85
 switch setting, 8
 switch settings, 29, 30
 the count range, 4
 transferring data, 26, 30
 Up and Down Pulse input, 28
 wiring, 10
 word allocation, 26

Unit, Special I/O
 assigning Unit numbers, 26
 error flags, 81
 error listing, 80
 max no. per PC, 3
 restart flags, 81
 word allocation, 26

W

wiring
 connector pin arrangement, 13
 precaution, 12
 the connector, 11